APPROVAL STAMPS

IRWIN PARTNER ARCHITECTURE

CONSULTING 245 Fischer Avenue

Costa Mesa California 92626 T: 714 557 2448 www.ipaoc.com

PALO ALTO COMMONS Wellquest Living

PROJECT DATA

4075 El Camino Way, Palo Alto, CA 94306

BOOK 132, PAGE 43, PARCEL 117, LOT A, J. J. MORRIS R.E. CO. SUB. OF THE COGAN TRACT,

ASSESSORS PARCEL NUMBER

PC - Planned Community (PC-3775 & PC-5116)

WITH MEMORY ISSUES. THE PROPOSED TOTAL OF UNITS WOULD BE 139 UNITS

BUILDING FOOTPRINT

53,849 SF (48.67%) with overhangs LOT COVERAGE (PROPOSED) 54,794 SF (49.52%) with overhangs

YEAR FIRST OCCUPIED: 1988

SPACES EXISITING TO REMAIN 57*

0.47 SPACES PER UNIT - EXISTING

SPACES REQUIRES: 18.52.040(C) TABLE 1

NO RESIDENTIAL CARE FACILITY REQUIREMENT LISTED PER PAMC CONVALESCENT IS SIMILAR (OUR RESIDENTS ARE LONG TERM VS TEMPOARARY BUT THE ALSO CAN'T DRIVE.)

1 SPACE PER 2.5 BEDS REQUIRED 141 BEDS / 2.5 = 56.4 **57 SPACES REQUIRED**

2 ADA, 8 COMPACT, 45 STANDARD

0.41 SPACES PER UNIT - PROPOSED

STAFF NEED TO REQUEST A PARKING PASS TO BE ABLE TO PARK PASS THE PARKING GATE. RESIDENTS DO NOT OWN NOR CAN DRIVE CARS. DURING A WORK DAY, 32 SPACES WERE BEING USED OUT OF THE 55 TOTAL. 21 OUT OF 41 SPACES WERE FOR STAFF AND 11 OUT OF 14

ELECTRICAL ENGINEER

Lake Forest, CA 92630

T: 949.267.9095

Taylor Johnson

GMEP Engineers 26439 Rancho Pkwy S., STE. #120

Qty Area (SF)

270

329

367

356

139

PARKING SUMMARY (PAC)

ADA VAN

C - COMPACT PARKING P - STANDARD PARKING

*AS PER PAMC 18.52.040(b)(8), ADA & ADA VAN SPACES SHALL COUNT AS AT LEAST 2 STANDARD PARKING SPACES FOR THE PURPOSES OF PARKING REQUIREMENTS.



PROJECT TEAM

Wellquest Living 30299 Buck Tail Drive, Canyon Lake, CA 92587 T: 951-757-2571 Charlene Kussner

ARCHITECT Irwin Partners Architects 245 Fischer Avenue, Suite B2 Costa Mesa, CA 92626 T: 714-556-5774 W: www.ipaoc.com Greg Irwin

INTERIOR DESIGNER Conley Design 7100 Northland Circle N, Unit 214 Minneapolis, MN 55428 T: 612-470-8602

UNIT MIX - PROPOSED

(E) Unit B-1

(E) Unit B-3

(E) Unit B-5

(E) Unit B-6

(E) Unit B-H

(E) Unit S-1

(N) Unit B-1

(N) Unit B-3

(N) Unit B-4

(N) Unit B-5

(N) Unit B-6

(N) Unit B-7

(N) Unit S-1

(N) Unit S-2

(N) Unit S-3

PROJECT INFORMATION

ASSISTED LIVING - 2 BED

ASSISTED LIVING - STUDIO

ASSISTED LIVING - STUDIO

ASSISTED LIVING - 1 BED

ASSISTED LIVING - STUDIO

ASSISTED LIVING - STUDIO

ASSISTED LIVING - STUDIO

ASSISTED LIVING - STUDIO

(N) Unit B-1 alt ASSISTED LIVING - 1 BED

(N) Unit S-3 Alt ASSISTED LIVING - STUDIO

PROPOSED UNIT COUNT: 139 (18 NEW UNITS)

EXISTING UNIT COUNT: 121

CODE REQUIREMENTS

CODE INFORMATION UTILIZED FOR PROJECT

THIS PROJECT IS PRIVATELY OWNED AND PRIVATELY FUNDED EXISTING MEANS OF EGRESS TO REMAIN

APPLICABLE CODES

ALL WORK SHALL BE IN CONFORMANCE WITH 2022 CALIFORNIA BUILDING CODE 2022 CALIFORNIA ELECTRICAL CODE 2022 CALIFORNIA MECHANICAL CODE 2022 CALIFORNIA PLUMBING CODE

> 2022 CALIFORNIA FIRE CODE 2022 CALIFORNIA ENERGY CODE CALIFORNIA GREEN BUILDING CODE (CALGreen) WITH LOCAL AMENDMENTS

PALO ALTO CODES AND ORDINANCES **BUILDING CONSTRUCTION**

OCCUPANCY TYPES:

R2.1, A2, A3, B; **NO CHANGE** TYPE V-A above TYPE I-A (UNDERGROUND PARKING); NO CHANGE CONSTRUCTION TYPE: SPRINKLERS:

ALLOWABLE BUILDING HEIGHT: 50' (R2.1 CBC TABLE 50.43) ACTUAL BUILDING HEIGHT: 32'-6"; **NO CHANGE**

ALLOWABLE NUMBER OF STORIES: 3 (R2.1 CBC TABLE 504.4) 3 (PC-3775 & PC-5116) ACTUAL NUMBER OF STORIES: 3; NO CHANGE

ALLOWABLE BUILDING AREA (SINGLE OCCUPANCY, MULTI-STORY, NON-SEPARATED USE): BASIC - 31,500 SF

34,125 SF per Floor

MULTISTORY - YES SPRINKLERS - YES (NFPA 13) FRONTAGE INCREASE - 0.25 (TABLE 506.3.3) $31,500 + (10,500 \times 0.25) =$

PALO ALTO COMMONS (EXISTING):	
BUILDING AREA (EXISTING)	
_	

	Area (SF)
Building A	
First Floor	20,798
Second Floor	17,412
Third Floor	11,448
	49,658 sq ft
Building B	
First Floor	12,434
Second Floor	11,607
Third Floor	9,812
	33,853 sq ft

1.18

THE AVANT (EXISTING):

BUILDING AREA: 47,500 SF **FAR CALCULATION (EXISTING)** TOTAL BUILDING AREA: 131,011 SF 110,642 SF


PALO ALTO COMMONS (PROPOSED): BUILDING AREA (PROPOSED)

•••	Area (SF
Building A	
First Floor	21,502
Second Floor	19,030
Third Floor	12,25
	52,795 sq f
Building B	
First Floor	12,670
Second Floor	12,67
Third Floor	12,19
	37,532 sq f
	90,327 sq t

83,511 sq ft THE AVANT (NO CHANGE; NOT IN SCOPE): BUILDING AREA: 47,500 SF

FAR CALCULATION (PROPOSED) TOTAL BUILDING AREA: 137,827 SF SITE AREA: FAR: 1.25

VICINITY MAP

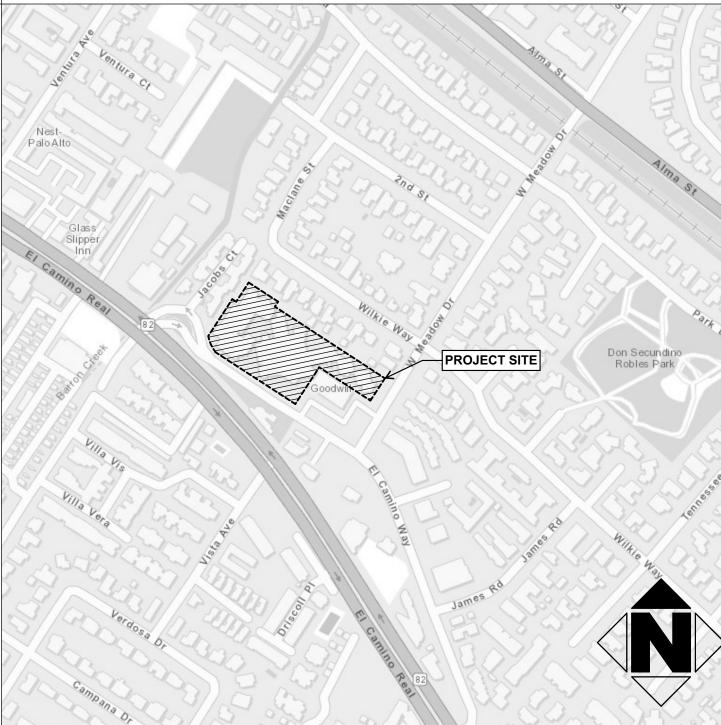

DEFERRED SUBMITIALS

SUBJECT TO REVIEW AND APPROVAL OF FIRE AUTHORITY: FIRE ALARM SYSTEMS

SUBMITTAL DOCUMENTS FOR DEFERRED SUBMITTAL ITEMS SHALL BE SUBMITTED TO THE ARCHITECT OR ENGINEER OF RECORD, WHO SHALL REVIEW THEM AND FORWARD THEM TO THE GENERAL CONTRACTOR WITH A NOTATION INDICATING THAT THE DEFERRED SUBMITTAL DOCUMENTS HAVE BEEN REVIEWED AND THAT THEY HAVE BEEN FOUND TO BE IN GENERAL CONFORMANCE WITH THE DESIGN OF THE BUILDING. THE DEFERRED SUBMITTAL ITEMS SHALL NOT BE INSTALLED UNTIL THEIR DESIGN AND SUBMITTAL DOCUMENTS HAVE BEEN APPROVED BY THE BUILDING OFFICIAL.

PLANS FOR THE DEFERRED SUBMITTAL ITEMS SHALL BE SUBMITTED TO THE BUILDING OFFICIAL BY THE GENERAL CONTRACTOR OR HIS SUB CONTRACTOR IN A TIMELY MANNER THAT ALLOWS A MINIMUM OF 30 WORKING DAYS FOR INITIAL PLAN REVIEW. ALL COMMENTS RELATED TO THE DEFERRED SUBMITTAL MUST BE ADDRESSED TO THE SATISFACTION OF THE BUILDING OFFICIAL PRIOR TO APPROVAL OF THE SUBMITTAL

SHEET INDEX

Tree Protection Sheet Cal Greens Notes GB-2 Cal Greens Notes

<u>TITLE</u>

Architectural Site Plan Landscape Site Plan Trash Site Plan Trash Enclosure & Bike Storage First Floor Plan Area A

First Floor Plan Area B Second Floor Plan Area A

Second Floor Plan Area B Third Floor Plan Area A Third Floor Plan Area B

Basement Floor Plan Floor Area Block Diagrams - 1st FLR Floor Area Block Diagrams - 2nd FLR

Floor Area Block Diagrams - 3rd FLR

Enlarged Unit Plans Enlarged Unit Plans **Enlarged Unit Plans**

Exterior Building Elevations - North Exterior Building Elevations - South Exterior Building Elevations - East

Exterior Building Elevations - West Exterior Building Elevations - N/E Courtyard Exterior Building Elevations - S/W Courtyard

Exterior Building Sections - Daylight Plane Exterior Building Tent Diagrams - Daylight Plane

Shadow Study - Dec 21 A5.11 Shadow Study - June 21

A5.12 Shadow Study w/ Trees- March 21 A5.13 Shadow Study w/ Trees - June 21 - 12 PM

A5.14 Shadow Study w/ Trees - Dec 21 - 12 PM A5.15 Shadow Study w/ Trees - Dec 21 - 4 PM

ELECTRICAL

E-1.0 ELECTRICAL GENERAL NOTES, SYMBOLS, & SHEET INDEX

E-1.1 ELECTRICAL SINGLE LINE DIAGRAM, LOAD CALCULATION, & PANEL SCHEDULE

RECEIVED, REVIEWED &

REVISION STAMPS

DATE OF ISSUE: 00/00/0000

Title Sheet


City of Palo Alto


Tree Protection - It's Part of the Plan!


Make sure your crews and subs do the job right!

Fenced enclosures around trees are essential to protect them by keeping the foliage canopy and branching structure clear from contact by equipment, materials and activities, preserving roots and soil conditions in an intact and non-compacted state, and identifying the Tree Protection Zone (TPZ) in which no soil disturbance is permitted and activities are restricted, unless otherwise approved. An approved tree protection report must be added to this sheet when project activity occurs within the TPZ of a regulated tree.


For detailed information on Palo Alto's regulated trees and protection during development, review the City Tree Technical Manual (TTM) found at www.cityofpaloalto.org/trees/.

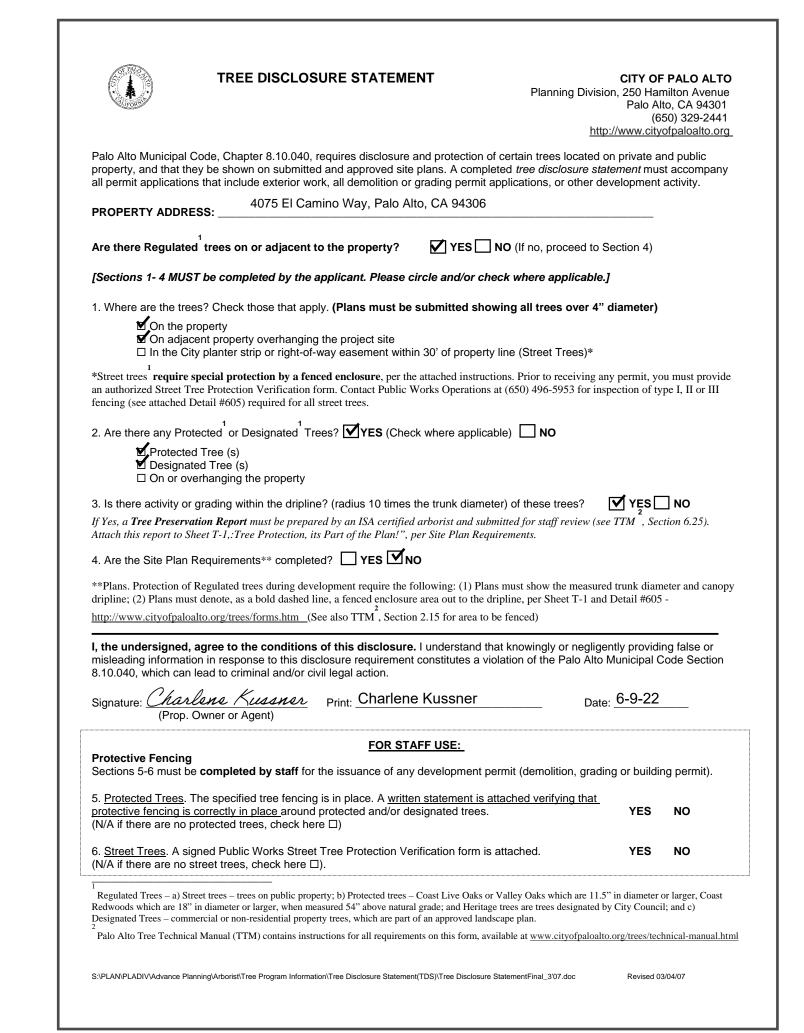

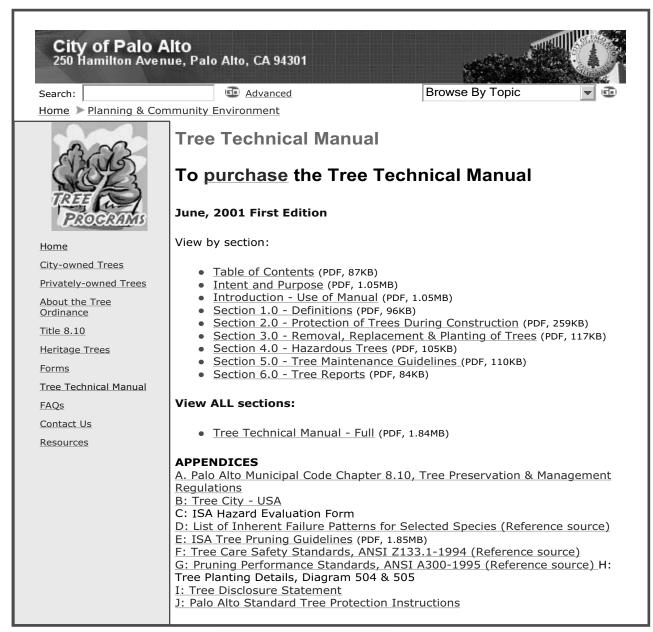


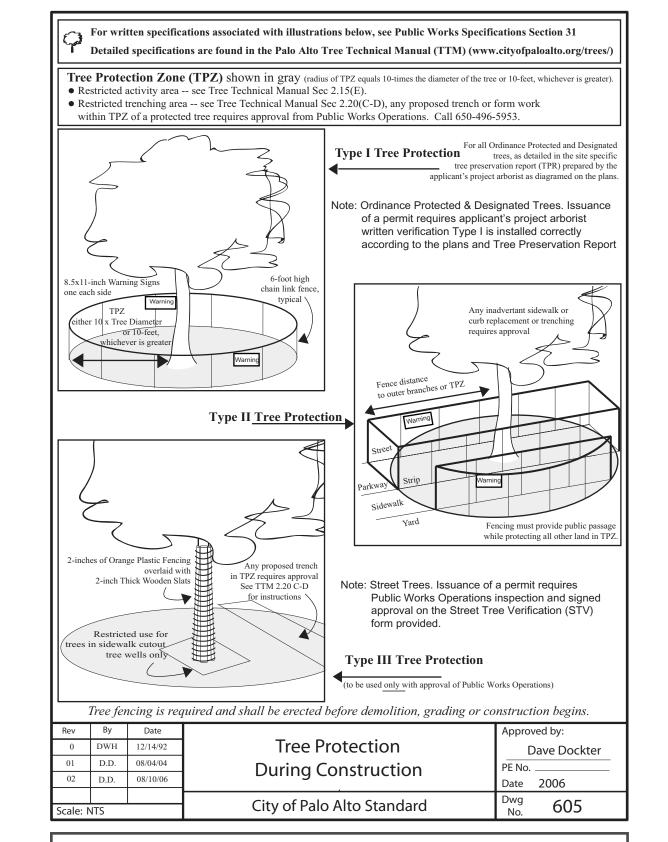

31-1 General a. b. 31-2 Referal a. b. c. 31-3 Executa a. d. e. f. f.	STREET TREE PI eral Tree protection has three primary functions,	PALO ALTO ROTECTION INSTRUCTIONS SECTION 31
a. b. 31-2 Reference a. b. c. 31-3 Executa a. d. e. f.	Tree protection has three primary functions,	SECTIONS
b. 31-2 Referra. b. c. 31-3 Execua. b. c. d.		
a. b. c. 31-3 Execu a. b. c. d.	non-compacted state and 3) to identify the T permitted and activities are restricted, unless of The Tree Protection Zone (TPZ) is a restricted	ed area around the base of the tree with a radius of ten-times
a. b. c. 31-3 Execu a. b. c. d.	the diameter of the tree's trunk or ten feet; which	never is greater, enclosed by fencing.
b. c. 31-3 Execua. b. c. d.	rence Documents	
31-3 Execu a. b. c. d.	 Detail 605 – Illustration of situations described be Tree Technical Manual (TTM) Forms (http://w Trenching Restriction Zones (TTM, Section 6.2. Arborist Reporting Protocol (TTM, Section 6.3.5) Site Plan Requirements (TTM, Section 6.3.5) Tree Disclosure Statement (TTM, Appendix 	vww.cityofpaloalto.org/trees/) 2.20(C)) 5.30)
a. b. c. d. e.	Street Tree Verification (STV) Form (http://ww	
a. b. c. d. f.	ution	
c. d. e. f.	Type I Tree Protection: The fence shall enclose life of the construction project. In some parking	se the entire TPZ of the tree(s) to be protected throughout the areas, if fencing is located on paving or concrete that will no l by an appropriate grade level concrete base, if approved by
d. e. f.	Type II Tree Protection: For trees situated wit	hin a planting strip, only the planting strip and yard side of in link protective fencing in order to keep the sidewalk and
e. f.	Type III Tree Protection: To be used only wit tree well or sidewalk planter pit, shall be wrappe the first branch and overlaid with 2-inch thick w	h approval of Public Works Operations. Trees situated in a ed with 2-inches of orange plastic fencing from the ground to vooden slats bound securely (slats shall not be allowed to dig fencing, caution shall be used to avoid damaging any fencing as directed by the City Arborist
f.	Size, type and area to be fenced. All trees to be link fences. Fences are to be mounted on two-in a depth of at least 2-feet at no more than 10-foor specifically approved on the STV Form.	be preserved shall be protected with six (6') foot high chain neh diameter galvanized iron posts, driven into the ground to t spacing. Fencing shall extend to the outer branching, unless
	intervals. The sign shall be minimum 8.5-inche "WARNING - Tree Protection Zone - This fence PAMC Section 8.10.110."	ther proof and prominently displayed on each fence at 20-foo is x 11-inches and clearly state in half inch tall letters: the shall not be removed and is subject to a fine according to
g.	place until final inspection of the project, except disturbance in the TPZ requires approval by the	demolition; grading or construction begins and remain in t for work specifically allowed in the TPZ. Work or soil project arborist or City Arborist (in the case of work around tht of way require a Street Work Permit from Public Works.
	During construction	
	 The applicant shall be responsible for the rethat are damaged during the course of const Municipal Code. The following tree preservation measures a No storage of material, topsoil, vel The ground under and around the 	hicles or equipment shall be permitted within the TPZ.
	END OF SE	ECTION
City of Palo Al Street Tree Ver	Alto 2004 Standard Drawings and Specifications	Revised 08/06

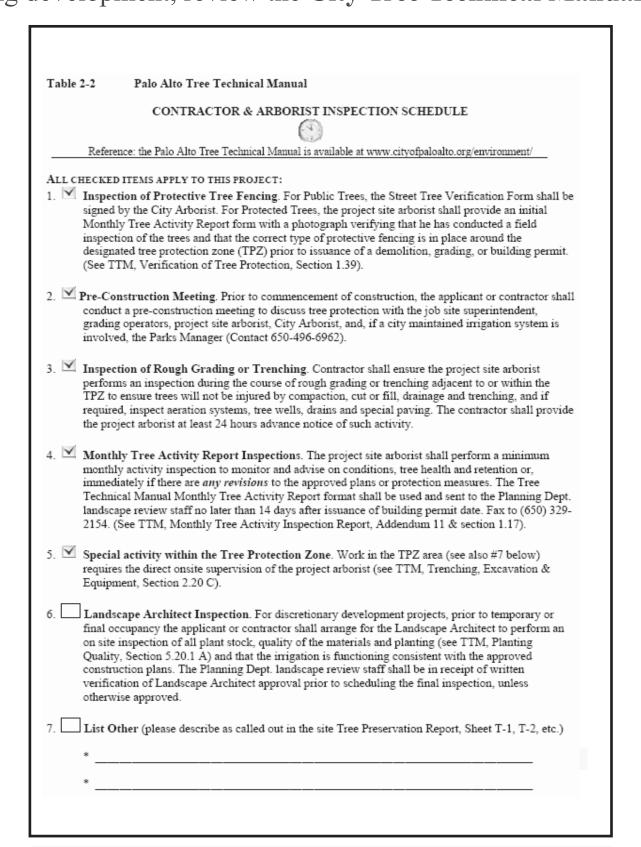

City of Palo A Tree Department Public Works Operations PO Box 10250 Palo Alto, C 650/496-5953 FAX: 650/88 treeprotection@CityofPalo/	CA 94303 52-9289	Verification of Street Tree Protection
Applicant Instructions: Complete upper po Disclosure Statement to Public Works Dep	rtion of this fo t. Public Wo	orm. Mail or FAX this form along with signed Tree rks Tree Staff will inspect and notify applicant.
APPLICATION DATE:		
ADDRESS/LOCATION OF STREET TREES TO BE PROTECTED:	4075	El Camino Way, Palo Alto, C
APPLICANT'S NAME:	Charlene	Kussner
APPLICANT'S ADDRESS:	185 S. St	tate Street, Suite 1500, Salt Lake City UT 84
APPLICANT'S TELEPHONE & FAX NUMBERS:	Cell: 9	951-757-2571
This section to be filled out by City Tree S	taff	
The Street Trees at the above address(es) are adequately		YES □ NO* □
protected. The type of protection used is:		* If NO, go to #2 below
Inspected by:		
Date of Inspection:		
The Street Trees at the above address are NOT adequately protected. The following modifications are required: Indicate how the required modifications were communicated to the applicant.		
Subsequent Inspection		
Street trees at above address were found to be adequately protected:		YES ☐ NO* ☐ If NO, indicate in "Notes" below the disposition of case.
Inpsected by:		
Date of Inspection:		
Notes: List City street trees by species, site, condition and type of tree protection installed. Also note if pictures were taken. Use back of sheet if necessary.		
	1	

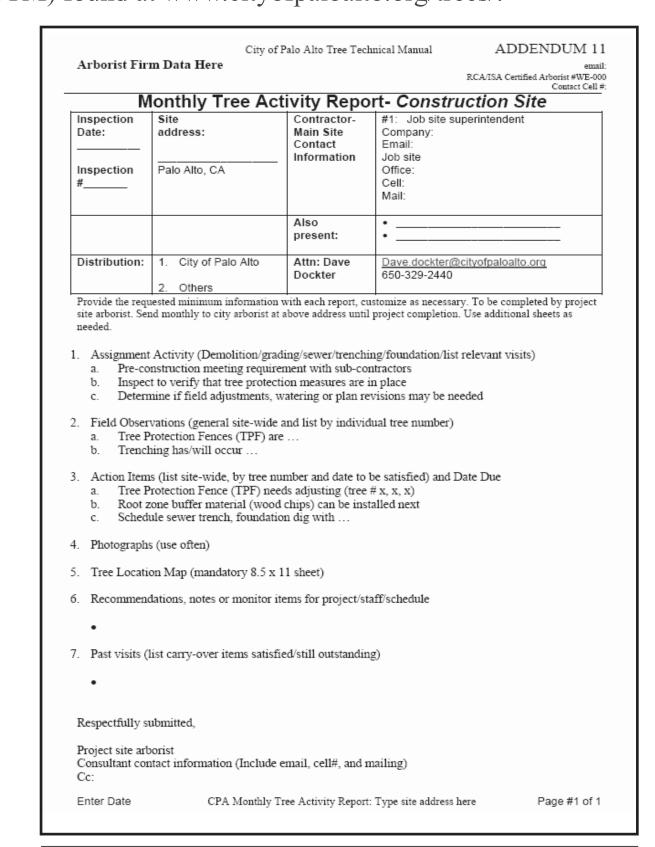

---WARNING--Tree Protection Zone

This fencing shall not be removed without City Arborist approval (650-496-5953)

Removal without permission is subject to a \$500 fine per day*

*Palo Alto Municipal Code Section 8.10.110

City of Palo Alto Tree Protection Instructions are located at http://www.city.palo-alto.ca.us/trees/technical-manual.htm

SPECIAL INSPECTIONS	PLANNING DEPARTMENT
TREE PROTECTION INSPECTIONS MA	NDATORY
AMC 8.10 PROTECTED TREES. CONTRACTOR SHALL ENSURE PROJECTEQUIRED TREE INSPECTION AND SITE MONITORING. PROVIDE WRITTIGEPORTS TO THE PLANNING DEPARTMENT LANDSCAPE REVIEW STAFFIGUILDING PERMIT ISSUANCE.	EN MONTHLY TREE ACTIVITY
BUILDING PERMIT DATE:	
DATE OF 1 ST TREE ACTIVITY REPORT:	
CITY STAFF:	
REPORTING DETAILS OF THE MONTHLY TREE ACTIVITY REPORT SHALI FERIFY THAT ALL TREE PROTECTION MEASURES ARE IMPLIMENTED AN ACTIVITY, SCHEDULED OR UNSCHEDULED, WITHIN A TREE PROTECTI BS SUBJECT TO VIOLATION OF PAMC 8.10.080. REFERENCE: PALO SECTION 2.00 AND ADDENDUM 11.	ND WILL INCLUDE ALL CONTRACTOR ION ROOT ZONE. NON-COMPLIANCE

Apply Tree Protection Report on sheet(s) T-2

Use addtional "T" sheets as needed

Project Data

0

T-1



All other tree-related reports shall be added to the space provided on this sheet (adding as needed) Include this sheet(s) on Project Sheet Index or Legend Page.

A copy of T-1 can be downloaded at http://www.cityofpaloalto.org/civica/filebank/blobdload.asp?BlobID=6460

Special Tree Protection Instruction Sheet City of Palo Alto



T-1

A4.407.7 X

							Compliance I	Path Ve	rification		
				Plan Sheet, Spec or	Plai	n Check	Rough GB Inspection IVR # 152	Part 1		Part 2	Part 2
4.5	Environmenta			Attachment Reference	CORI	F INITIAL	CORF INITIAL	CORR	INITIAL	CORR	INITIA
			Χ		п						
		Covering of duct openings, protection of mechanical equipment during construction 4.504.1 X	_	GB-2	П						
		Adhesives, sealants and caulks - Table 4.504.1 or 4.504.2 for VOC limits 4.504.2.1 X		GB-2	П						
	Mandatory	Paints and coatings - Table 4.504.3 for VOC limits 4.504.2.2 X		GB-2	П						
	Mandatory	Aerosol paints and coatings 4.504.2.3 X		GB-2	п						
	Mandatory	Verification - documentation to verify complaint VOC limit on finish materials 4.504.2.4 X		GB-2	п						
	Mandatorv	Carpet systems compliant with VOC limits 4.504.3 X		GB-2	П						
	Mandatory	Carpet systems: Carpet cushion 4.504.3.1 X	_	GB-2	П						
		Carpet systems: Carpet adhesive - Table 4.504.1 for VOC limits 4.504.3.2 X		GB-2	п						
_	Tier 1 Mand.	Resilient flooring systems for 90% - Tier 1 requirements AMC 16.16.070 & 16.14.080/ A4.504.2 X		GB-2	п						
ţ	Mandatory	Composite wood products 4.504.5 X		GB-2	п						
Mandatory	Mandatorv	Documentation 4.504.5.1 X		GB-2	.n.						
lar	Mandatorv	Concrete slab foundations - vapor retarder required 4.505.2 X		GB-2	П						
	Mandatory	Capillary break for slab-on-grade foundations 4.505.2.1 X		GB-2	П						
	Mandatory	Moisture content of building materials ≤ 19% for wall and floor framing 4.505.3 X		GB-2	n						
		Bathroom exhaust fans (when required) shall be provided with the following: 4.506.1 X		GB-2	П						
	Mandatory	1. ENERGY STAR fans ducted to outside of building.		GB-2	п						
	,	2. Humidity controlled OR functioning as a component of a whole-house ventilation system X		GB-2	П						
		3. Humidity controls with manual or automatic means of adjustment for relative humidity range of ≤ 50% to 80% max X		GB-2	П						
	Mandatory	Heating and air conditioning system design 4.507.2 X		GB-2	П						
	Mandatory	Indoor Air Quality Management Plan [MF] PAMC 16.14.390 X		GB-2	п						
	Mandatory	Water Heater Replacement (Residential Remodels or Additions: HPWH required when PAMC 16.14.110/ 4.509 X		GB-2							
		gas water heater is replaced or new water heater is added) Section 4.509			П						
	Elective	Compliance with formaldehyde limits PAMC 16.14.265/ A4.504.1 X		GB-2							
(1)	Elective	Thermal insulation PAMC 16.14.270/ A4.504.3	X		п						
Electives (Elective	Construction filters [HR] A4.506.2	X								
ec	Elective	Direct-vent appliances A4.506.3	Х		П						
□	Elective		X		iii						
	Legend:										

Y - Yes; the measure is in the scope of work N - No; the measure is not in the scope of work PAMC - Palo Alto Municipal Code; locally amended [N] - New Construction [MF] - Multi-family dwellings [AA] - Additions and alterations [HR] - High-rise building

The Green Building Survey is a required project submittal. The survey can be found at the following link. The online survey shall be completed and a Green Building Survey Report will be sent in an email. Include a copy of the survey report on a separate page in this plan set. Please indicate the reference page here _



in conformance with the CALGreen mandatory and elective measures claimed. I have reviewed and understand the afterconstruction requirements below.

Signature (Green Building Special Inspector)

Print Name Phone or Email

SECTION TO BE COMPLETED AFTER CONSTRUCTION

Development Center to schedule your final inspection: Construction debris receipts from an approved facility using If HERS testing was required per the homes energy report, attach the completed forms. If there were alterations during construction that impacted the energy report (i.e. R values, U factors, Equipment Types) rerun the report and attach it. I certify that:

After construction is complete submit the following at the City

CALGreen inspections were performed throughout construction. The home has met the CALGreen measures as claimed on this sheet. Those required for landscaping may be excluded from this confirmation if verified within 6 months

of final inspection.

Through a combination of onsite inspections and confirmation from the Contractor there have been no alterations that impacted the energy report for the home, unless the new report is provided as an attachment.

Signature (Green Building Special Inspector) Sign only after project is complete

Print Name

Addre roject

SID CHECKED BY: TB & MP DATE OF ISSUE: 00/00/0000 2022

PROJECT: 21003

DRAWN BY: YI, RA, & DB

IRWIN PARTNERS

ARCHITECTURE

PLANNING

CONSULTING

245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com

ARCHITECT

Cal Greens Notes DRAWING NUMBER

2022 RESIDENTIAL GREEN BUILDING APPLICATION CALGREEN MANDATORY + TIER 1

Elective Door protection Elective Roof overhangs

Elective Innovative concepts and local environmental conditions

GB-1 Mandatory +Tier '

2. A greyfield site is selected.

3. An EPA-recognized and remediated Brownfield site is

A4.103.2 Community connectivity. Facilitate community connectivity by one of the following methods: 1. Locate project within a 1/4-mile true walking distance of at least four basic services, readily accessible by pedestrians.

at least seven basic services, readily accessible by pedestrians. 3. Other methods increasing access to additional resources.

2. Locate project within a 1/2-mile true walking distance of

Note: Examples of services include, but are not limited to, bank, place of worship, convenience grocery, day care, cleaners, fire station, barber shop, beauty shop, hardware store, laundry, library, medical clinic, dental clinic, senior care facility, park, pharmacy, post office, restaurant, school, supermarket, theater, community center, fitness center, museum or farmers market. Other services may be considered on a case-by-case basis.

Site located walking distance from, Day care: 0.06 miles, Resturant: 0.08 Miles, School: 0.11 Miles, Place of Worship: 0.16

SECTION 4.106 SITE DEVELOPMENT

4.106.1 General. Preservation and use of available natural resources shall be accomplished through evaluation and careful planning to minimize negative effects on the site and adjacent areas. Preservation of slopes, management of storm water drainage and erosion controls shall comply with this section.

4.106.2 Storm water drainage and retention during

Projects which disturb less than one acre of soil and are not part of a larger common plan of development which in total disturbs one and Tier 2 projects and is amended to read: acre or more, shall manage storm water drainage during construction. In order to manage storm water drainage during construction, one or more of the following measures shall be implemented to prevent flooding of adjacent property, prevent erosion and retain soil runoff on the site. 1. Retention basins of sufficient size shall be utilized to retain

storm water on the site. 2. Where storm water is conveyed to a public drainage system, collection point, gutter or similar disposal method, water shall be filtered by use of a barrier system, wattle or other method approved by the enforcing agency. 3. Compliance with a lawfully enacted storm water management ordinance.

Note: Refer to the State Water Resources Control Board for projects which disturb one acre or more of soil, or are part of a larger common plan of development which in total disturbs one acre or more of soil. (Website:https://www.waterboards.ca.gov/water_issues/progra ms/stormwater/construction.html)

A4.106.2.3 Topsoil protection. Topsoil shall be protected or saved for reuse as specified in this section. Tier 1. Displaced topsoil shall be stockpiled for reuse in a designated area and covered or protected from ero-sion.

Note: Protection from erosion includes covering with tarps, straw, mulch, chipped wood, vegetative cover or other means acceptable to the enforcing agency to protect the topsoil for later use.

A4.106.3 Landscape design. Postconstruction landscape designs shall accomplish one or more of the following: 1. Areas disrupted during construction are restored to be consistent with native vegetation species and patterns. 2. Utilize at least 75 percent native California or drought tolerant plant and tree species appropriate for the climate zone

A4.106.4 Water permeable surfaces. Permeable paving is utilized for the parking, walking or patio surfaces in compliance with the following.

Tier 1. Not less than 20 percent of the total parking, walking or patio surfaces shall be permeable.

and one full flush.

1. The primary driveway, primary entry walkway and entry porch or landing shall not be included when calculating the area required to be a permeable surface. 2. Required accessible routes for persons with disabilities as required by California Code of Regulations, Title 24, Part 2, Chapter 11A and/or Chapter 11B as applicable.

Division 4.3 - WATER EFFICIENCY AND CONSERVATION

SECTION 4.303 INDOOR WATER USE

4.303.1 Water conserving plumbing fixtures and fittings. Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with Sections 4.303.1.1, 4.303.1.2, 4.303.1.3, and 4.303.1.4.

Note: All noncompliant plumbing fixtures in any residential real property shall be replaced with water-conserving plumbing fixtures. Plumbing fixture replacement is required prior to issuance of a certificate of final completion, certificate of occupancy, or final permit approval by the local building department. See Civil Code Section 1101.1, et seq., for the definition of a noncompliant plumbing fixture, types of residential buildings affected and other important enactment

4.303.1.1 Water closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-type Toilets.

Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume of two reduced flushes

4.303.1.3.1 Single showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of

the U.S. EPA WaterSense Specification for Showerheads.

4.303.1.4.1 Residential lavatory faucets. The maximum flow rate **A4.403.2.3.6. Enforcement.** As a condition prior to the of residential lavatory faucets shall not exceed 1.2 gallons per issuance of every building permit involving placement of minute at 60 psi. The minimum flow rate of residential lavatory concrete, the permit applicant shall be required to submit a faucets shall not be less than 0.8 gallons per minute at 20 psi. completed low-carbon concrete compliance form that shall be provided by and reviewed for compliance by the building **4.303.1.4.3 Metering faucets.** Metering faucets when installed in department prior to issuing the permit. As a condition of residential buildings shall not deliver more than 0.2 gallons per such building permits, and prior to approving construction inspections following placement of concrete, the permit applicant shall be required to submit batch certificates A4.303.1 Kitchen faucets. The maximum flow rate of kitchen and/or EPDs provided by the concrete provider that faucets shall not exceed 1.5 gallons per minute at 60 psi. Kitchen demonstrate compliance with the low-carbon concrete compliance form on file with the building permit. The batch faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must certificates and/or EPDs shall be reviewed for compliance default to a maximum flow rate of 1.5 gallons per minute at 60 psi. by the building department prior to approving any further inspections. When deviations from compliance with this **Note:** Where complying faucets are unavailable, aerators or other section occur, the chief building official or his designee is authorized to require evidence of equivalent carbon means may be used to achieve reduction. reductions from the portion. of remaining construction of 4.303.2 Standards for plumbing fixtures and fittings. the project to demonstrate alternative compliance with the Plumbing fixtures and fittings shall be installed in accordance with intent of this chapter. For projects involving placement of the California Plumbing Code, and shall meet the applicable concrete by, or on behalf of, a public works, parks, or standards referenced in Table 1701.1 of the California Plumbing similar department the director of such department, or his/her assignee, shall maintain accurate records of the total volume (in cubic yards) of all concrete placed, as well **A4.303.5 Hot water recirculation systems.** One- and two-family as the total compliant volume (in cubic yards) of all dwellings shall be equipped with a demand hot water recirculation concrete placed, and shall report this data annually to the system, as defined in Chapter 2. The demand hot water governing body in a form expressing an annual compliance

recirculation system shall be installed in accordance with the

California Plumbing Code, California Energy Code and the

SECTION 4.305

WATER REUSE SYSTEMS

residential developments, where disinfected tertiary recycled water

is available from a municipal source to a construction site, may be

required to have recycled water supply systems installed, allowing

4.305.1 Recycled water supply systems. Newly constructed

the use of recycled water for residential landscape irrigation

systems. See Chapter 15 of the California Plumbing Code.

16.14.240 Section A4.403.2 Reduction in cement use.

Section A4.403.2 of Appendix A4 of the California Green Building

Standards Code is adopted as a Mandatory measure for all Tier 1

A4.403.2.1 Purpose. The purpose of this chapter is to provide

concrete, as defined herein, that maintains adequate strength

and durability for the intended application and at the same time

reduces greenhouse gas emissions associated with concrete

composition. This code includes pathways for compliance with

either reduced cement levels or lower-emission supplementary

A4.403.2.2 Definitions. For the application of this section the

Concrete. Concrete is any approved combination of mineral

aggregates bound together into a hardened conglomerate in

Environmental product declaration (EPD). EPDs present

product to enable comparisons between products fulfilling the

scope (which covers product life cycle from resource extraction

to the factory). Upfront embodied carbon (embodied carbon).

transportation and manufacturing of a material corresponding

to life cycle stages A1 (extraction and upstream production).

A2 (transportation), and A3 (manufacturing). Definition is as

noted in ISO 21930 and as defined in the Product Category

https://www.nsf.org/ newsroom_pdf/concrete_pcr_2019.pdf

A4.403.2.3. Compliance. Compliance with the requirements of

(1) Cement and Embodied Carbon Limit Allowances. Cement

or Embodied Carbon limits shown in Table A4.403.2.3 can be

increased by 30% for concretes demonstrated to the Building

Official as requiring high early strength. Such concretes could

include, but are not limited to, precast, prestressed concrete;

(2) Approved Cements. The maximum cement content may

be increased proportionately above the tabulated value when

by approved EPD to have a plant-specific EPD lower than

1040 kg CO2e/metric ton. The increase in allowable cement

A4.403.2.3.2 Cement Limit Method - Mix. Cement content of

shown in the Table A4.403.2.3. Use of this method is limited to

a concrete mix using this method shall not exceed the value

concrete with specified compressive strength not exceeding

A4.403.2.3.3 Cement Limit Method - Project. Total cement

content shall be based on total cement usage of all concrete

project shall not exceed the value calculated according to

mix designs within the same project. Total cement content for a

Cem _{lim} = the maximum cement content for mixture_n per Table A4.403.2.3, kg/m³ or lb/yd³

Applicant can use yd³ or m³ for calculation, but must keep same units throughout

A4.403.2.3.4. Embodied Carbon Method - Mix. Embodied

A4.403.2.3.5. Embodied Carbon Method - Project. Total

embodied carbon (EC proj) of all concrete mix designs within

the same project shall not exceed the project limit (EC allowed)

determined using Table A4.403.2.3 and Equation A4.403.2.3.5.

environmental product declaration (EPD), shall not exceed the

using an approved cement, or blended cement, demonstrated

beams and slabs above grade; and shotcrete

content would be (1040/plant=specific EPD) %.

quantified environmental information on the life cycle of a

same function. EPDs must conform to ISO 14025, and EN

15804 or ISO 21930, and have at least a "cradle to gate"

The greenhouse gasses emitted in material extraction,

Rule for Concrete by NSF dated February 22nd, 2019.

this chapter shall be demonstrated through any of the

Table A4.403.2.3 Cement and Embodied Carbon Limit

compliance options in Sections 4.403.2.3.2 through

A4.403.2.3.1 Allowable Increases.

accordance with the requirements of this code.

practical standards and requirements for the composition of

Division 4.4 – MATERIAL CONSERVATION AND

A4.403.2 Low Carbon Concrete Requirements.

manufacturer's installation instructions.

RESOURCE EFFICIENCY

cementitious materials.

4.403.2.3.5:

Pathways

5,000 psi.

Equation A4.403.2.3.3.

Equation A4.403.2.3.3:

Cem proj < Cem allowed

Cem proj = Cem proj and Cem proj = Ce

n = the total number of *concrete* mixtures for the project

Cem _n = the cement content for mixture_n, kg/m^3 or lb/yd^3

v_n = the volume of mixture_n concrete to be placed, vd³ or m³

carbon of a concrete mix, based on an approved

value given in Table A4.403.2.3.

EC proj = EC n v n and EC allowed = EC lim v n

n = the total number of *concrete* mixtures for the project

 v_n = the volume of mixture_n concrete to be placed, yd³ or m³

EC _n = the embodied carbon potential for mixture n per mixture EPD, kg/m^3

EC _{lim} = the embodied carbon potential limit for mixture n per Table A4.403.2.3, kg/m³

Applicant can use yd³ or m³ for calculation, but must keep same units throughout.

Equation A4.403.2.3.5:

where

EC proj < EC allowed

following definitions shall apply:

A4.403.2.3.7. Exemptions (a) Hardship or infeasibility exemption. If an applicant for a project subject to this chapter believes that circumstances exist that make it a hardship or infeasible to meet the requirements of this chapter, the applicant may request an exemption as set forth below. In applying for an exemption, the burden is on the applicant to show hardship or infeasibility. The applicant shall identify in writing the specific requirements of the standards for compliance that the project is unable to achieve and the circumstances that make it a hardship or infeasible for the project to comply with this chapter. Circumstances that constitute hardship or infeasibility may

include, but are not limited to the following:

percentage derived from the quotient of total compliant

concrete volume placed divided by total concrete volume

(1) There is a lack of commercially available material necessary to comply with this chapter (2) The cost of achieving compliance is disproportionate to the overall cost of the project; (3) Compliance with certain requirements would impair the historic integrity of buildings listed on a local, state or federal list or register of historic structures as regulated by the California Historic Building Code (Title 24, Part 8).

(b) Granting of exemption. If the chief building official determines that it is a hardship or infeasible for the applicant to A4.4-8. fully meet the requirements of this chapter and that granting the requested exemption will not cause the building to fail to comply with the California Building Standards Code, the chief building official shall determine the maximum feasible threshold of compliance reasonably achievable for the project. In making this determination, the chief building official shall consider whether alternate, practical means of achieving the objectives of this chapter can be satisfied. If an exemption is granted, the applicant shall be required to comply with this chapter in all other respects and shall be required to achieve the threshold of compliance determined to be achievable by the chief building official.

(c) Denial of exception. If the chief building official determines that it is reasonably possible for the applicant to fully meet the requirements of this chapter, the request shall be **preconsumer) of each material provided in percentages** denied and the applicant shall be notified of the decision in writing. The project and compliance documentation shall be modified to comply with the standards for compliance.

A4.403.2 Reduction in cement use. As allowed by the enforcing agency, cement used in foundation mix design shall be reduced as

Tier 1. Not less than a 20 percent reduction in cement use.

Note: Products commonly used to replace cement in concrete mix designs include, but are not limited to: 1. Fly ash.

Slag. 3. Silica fume. 4. Rice hull ash.

A4.404.3 Building systems. Use premanufactured building systems to eliminate solid sawn lumber whenever possible. One or more of the following premanufactured building systems is used: 1. Composite floor joist or premanufactured floor framing system. 2. Composite roof rafters or premanufactured roof framing

3. Panelized (SIPS, ICF or similar) framing systems. 4. Other methods approved by the enforcing agency.

A4.405.3.1 Recycled content. Use materials, equivalent in performance to virgin materials with a total (combined) recycled content value (RCV) of:

Tier 1. The RCV shall not be less than 10 percent of the total material cost of the project. Required Total RCV (dollars) = Total Material Cost (dollars) × 10 percent (Equation A4. 4-1)

For the purposes of this section, materials used as components of the structural frame shall not be used to calculate recycled content. The structural frame includes the load bearing structural elements, such as wall studs, plates, sills, columns, beams, girders, joists, rafters and trusses.

1. Sample forms which allow user input and automatic calculation are located at http://www.hcd.ca.gov/buildingstandards/calgreen/cal-green-forms.html and may be used to simplify documenting compliance with this section and for calculating recycled content value of materials or assembly 2. Sources and recycled content of some recycled materials can be obtained from CalRecycle if not provided by the

manufacturer. A4.405.3.1.1 Total material cost. Total material cost is the total estimated or actual cost of materials and assembly products used in the project. The required total recycled content value for the project (in dollars) shall be determined by A4.408.1 Enhanced Construction Waste Reduction. Equation A4.4-1 or Equation A4.4-2. Total material cost shall be calculated by using one of the methods specified below:

1. **Simplified method.** To obtain the total cost of the project multiply the square footage of the residential structure by the square foot valuation established pursuant to the ICC Building Valuation Data (BVD) or other valuation data approved and/or established by the enforcing agency. The total material cost is 45 percent of the total cost of the project. Use Equations A4.4-3A or A4.4-3B to determine total material costs using the simplified method.

Total material costs = Project square footage × square foot valuation × 45 percent (Equation A4.4-3A)

Total estimated or actual cost of project × 45 percent (Equation A4.4-3B)

2. **Detailed method.** To obtain the total cost of the project, add the estimated and/or actual costs of materials used for the project, including the structure (steel, concrete, wood or masonry); the enclosure (roof, windows, doors and exterior walls); the interior walls, ceilings and finishes (gypsum board, ceiling tiles, etc.). The total estimated and/or actual costs shall for examination by the enforcing agency. not include fees, labor and installation costs, overhead, appliances, equipment, furniture or furnishings.

A4.405.3.1.2 Determination of total recycled content 4. Identify construction methods employed to reduce the value (RCV). Total RCV may be determined either by amount of construction and demolition waste generated. dollars or percentage as noted below. 5. Specify that the amount of construction and demolition 1. Total recycled content value for the project (in waste materials diverted shall be calculated by weight or dollars). This is the sum of the recycled content volume, but not by both. value of the materials and/or assemblies consid-ered and shall be determined by Equation A4.4-4. **4.408.3 Waste management company.** Utilize a waste

compared to Equations A4.4-1 and A4.4-2 to can provide verifiable documentation that the percentage of determine compliance with Tier 1 or Tier 2 prerequisites. construction and demolition waste material diverted from the landfill complies with Section 4.408.1. Total Recycled Content Value (dollars) = (RCVM + RCVA)

(by percentage). This is expressed as a percent-age of the total material cost and shall be determined **4.408.5 Documentation**. Documentation shall be provided to the by Equation A4.4-4 and Equation A4.4-5. enforcing agency which demonstrates compliance with Section The result of this calculation may be directly 4.408.2, Items 1 through 5, Section 4.408.3 or Section 4.408.4. compared for compliance with Tier 1 (10 percent)

Note: The owner or contractor may make the determination

SECTION 4.410

4.410.1 Operation and maintenance manual. At the time of

final inspection, a manual, compact disc, web-based reference

1. Directions to the owner or occupant that the manual

. Operation and maintenance instructions for the

shall remain with the building throughout the life cycle of

a. Equipment and appliances, including water-saving

b. Roof and yard drainage, including gutters and

3. Information from local utility, water and waste recovery

providers on methods to further reduce resource

5. Educational material on the positive impacts of an

6. Information about water-conserving landscape and

7. Instructions for maintaining gutters and downspouts

9. Information about state solar energy and incentive

10. A copy of all special inspection verifications required

SECTION 4.504

POLLUTANT CONTROL

rough installation, during storage on the construction site and until

final startup of the heating, cooling and ventilating equipment, all

acceptable to the enforcing agency to reduce the amount of water,

A4.504.1 Compliance with formaldehyde limits. Use composite

Note: Documentation must be provided that verifies that finish

materials are certified to meet the pollutant emission limits.

A4.504.2 Resilient flooring systems. Resilient flooring systems

installed in the building shall meet the percentages specified in this section and meet the requirements of the California Department of

Public Health, "Standard Method for the Testing and Evaluation of

Volatile Organic Chemical Emissions from Indoor Sources Using

Environmental Chambers," Version 1.2, January 2017 (Emission

https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/

Tier 1. At least 90 percent of the total area of resilient flooring

Note: Documentation must be provided that verifies that finish

materials are certified to meet the pollutant emission limits in this

4.504.2 Finish material pollutant control. Finish materials shall

4.504.2.1 Adhesives, sealants and caulks. Adhesives, sealants

and caulks used on the project shall meet the requirements of the

1. Adhesives, adhesive bonding primers, adhesive primers,

sealants, sealant primers, and caulks shall comply with local or

regional air pollution control or air quality management district

rules where applicable or SCAQMD Rule 1168 VOC limits, as

products also shall comply with the Rule 1168 prohibition on

trichloroethylene), except for aerosol products, as specified in

shown in Table 4.504.1 or 4.504.2, as applicable. Such

the use of certain toxic compounds (chloroform, ethylene

sealant or caulking compounds (in units of product, less

consist of more than 16 fluid ounces) shall comply with

Code of Regulations, Title 17, commencing with Section

4.504.2.2 Paints and coatings. Architectural paints and coatings

shall comply with VOC limits in Table 1 of the ARB Architectural

Suggested Control Measure, as shown in Table 4.504.3, unless

classifying the coating as a Flat, Nonflat or Nonflat-high Gloss

coating, based on its gloss, as defined in subsections 4.21, 4.36,

and 4.37 of the 2007 California Air Resources Board, Suggested

coatings that do not meet the definitions for the specialty coatings

more stringent local limits apply. The VOC content limit for

categories listed in Table 4.504.3 shall be determined by

high Gloss VOC limit in Table 4.504.3 shall apply.

statewide VOC standards and other requirements, including

prohibitions on use of certain toxic compounds, of California

dichloride, methylene chloride, perchloroethylene and

following standards unless more stringent local or regional air

pollution or air quality management district rules apply:

testing method for California Specification 01350).

certification programs and testing labs.

Pages/VOC.aspx

installed shall comply.

comply with this section.

Subsection 2 below.

See California Department of Public Health's website for

wood products made with either California Air Resources Board

approved no-added formaldehyde (NAF) resins or ultra-low

duct and other related air distribution component openings shall be

4.504.1 Covering of duct openings and protection of

covered with tape, plastic, sheetmetal or other methods

dust and debris, which may enter the system.

emitting formaldehyde (ULEF) resins.

mechanical equipment during construction. At the time of

Information on required routine maintenance measures

including, but not limited to, caulking, painting, grading

consumption, including recycle programs and locations.

interior relative humidity between 30-60 percent and what

methods an occupant may use to maintain the relative

irrigation design and controllers which conserve water.

and the importance of diverting water at least 5 feet away

4. Public transportation and/or carpool options available in

c. Space conditioning systems, including condensers

devices and systems, HVAC systems, photovoltaic

systems and other major appliances and equipment.

systems, electric vehicle chargers, water-heating

or other media acceptable to the enforcing agency which

includes all of the following shall be placed in the building:

the structure.

downspouts.

and air filters.

e. Water reuse systems.

humidity level in that range.

from the foundation.

programs available.

by the enforcing agency or this code.

Division 4.5 – ENVIRONMENTAL QUALITY

around the building, etc.

d. Landscape irrigation systems.

following:

the area.

BUILDING MAINTENANCE AND OPERATION

if the construction and demolition waste materials will

be diverted by a waste management company.

or Tier 2 (15 percent) prerequisites. 1. Sample forms found in "A Guide to the California Green Total Recycled Content Value (percent) = Building Standards Code (Residential)" located at [Total Recycled Content Value (dollars) ÷ http://www.hcd.ca.gov/building-stan-dards/calgreen/calgreen-Total Material Cost (dollars)] × 100 (Equation A4.4-5) form.shtml may be used to assist in documenting compliance

with this section. A4.405.3.1.3 Determination of recycled content 2. Mixed construction and demolition debris (C&D) processors can be located at the California Department of value of materials (RCVM). The recycled content value of each material (RCVM) is calculated by multiplying Resources Recycling and Recovery (CalRecycle). the cost of material, as defined by the recycled content. See Equations A4.4-6 and A4.4-7.

RCVM (dollars) = Material cost (dollars) × RC_M (percent) (Equation A4.4-6)

The result of this calculation may be directly

2. Total recycled content value for the project

(Equation A4.4-4)

RCM (percent) = Postconsumer content percentage + (1/2) Preconsumer content percentage (Equation A4.4-7)

1. If the postconsumer and preconsumer recycled content is provided in pounds, Equation A4.4-7 may be used, but the final result (in pounds) must be multiplied by 100 to show RCM as a percentage 2. If the manufacturer reports total recycled content of a material as one percentage in lieu of separately reporting preconsumer and post-consumer values, the total shall be considered preconsumer recycled material.

A4.405.3.1.4 Determination of recycled content value of assemblies - (RCVA). Recycled content value of assemblies is calculated by multiplying the total cost of the assembly by the total recycled content of the assembly (RCA), and shall be determined by Equation

RCVA (dollars) = Assembly cost (dollars) × Total RCA (percent) (Equation A4.4-8)

If not provided by the manufacturer, Total RCA (percent) is the sum (Σ) of the Proportional Recycled Content (PRCM) of each material in the assembly. RCA shall be determined by Equation A4.4-9.

RCA = Σ PRCM (Equation A4.4-9) PRCM of each material may be calculated by one of two

methods using the following formulas:

Method 1: Recycled content (postconsumer and

PRC_M (percent) = Weight of material (percent) × RC_M (percent) (Equation A4.4-10)

Weight of material (percent) = [Weight of material (lbs) ÷ Weight of assembly (lbs)] × 100 (Equation A4.4-11) RC_M (percent) = Postconsumer content

percentage + (1/2) Preconsumer content percentage (See Equation A4.4-7)

Method 2: Recycled content (postconsumer and preconsumer) provided in pounds

PRC_M (percent) = [RC_M (lbs) ÷ Weight of material (lbs)] × 100 (Equation A4.4-12)

RC_M (lbs) = Postconsumer content (lbs) + (1/2) Preconsumer content (lbs) (Equation A4.4-13)

material as one percentage in lieu of separately reporting preconsumer and postconsumer values, the total shall be considered preconsumer recycled material. A4.405.3.1.5 Alternate method for concrete. When

Note: If the manufacturer reports total recycled content of a

Supplementary Cementitious Materials (SCMs), such as fly ash or ground blast furnace slag cement, are used in concrete, an alternate method of calculating and reporting recycled content in concrete products shall be permitted. When determining the recycled content value, the percent recycled content shall be multiplied by the cost of the cementitious materials only, not the total cost of the concrete.

SECTION 4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE **4.406.1 Rodent proofing.** Annular spaces around pipes, electric cables, conduits or other openings in sole/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency.

A4.407.4 Material protection. Protect building materials delivered to the construction site from rain and other sources

SECTION 4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING

PAMC 16.14.250 Section A4.408.1 Enhanced construction waste reduction. Section A4.408.1 of Appendix A4 of the California Green Building Standards Code is adopted as a mandatory measure and is amended to read:

Nonhazardous construction and demolition debris generated at the site is diverted to recycle or salvage in compliance with the

Projects with a given valuation of \$25,000 or more must have at least an 80-percent reduction. Any mixed recyclables that are sent to mixed-waste recycling facilities shall include a qualified third party verified facility average diversion rate. Verification of diversion rates shall meet minimum certification eligibility guidelines, acceptable to the local enforcing agency. **Exceptions:**

Commercial stand-alone mechanical, electrical or plumbing **A4.408.1.1 Documentation.** Documentation shall be provided

to the enforcing agency which demonstrates compliance with all

1. Residential stand-alone mechanical, electrical or plumbing

construction and demolition waste reduction requirements. **4.408.2 Construction waste management plan.** Submit a construction waste management plan in conformance with Items 1 through 5. The construction waste management plan shall be updated as necessary and shall be available during construction

1. Identify the construction and demolition waste materials to be diverted from disposal by recycling, reuse on the project or salvage for future use or sale. 2. Specify if construction and demolition waste materials will be sorted on-site (source-separated) or bulk mixed

(single stream). 3. Identify diversion facilities where the construction and demolition waste material will be taken.

4.504.2.3 Aerosol paints and coatings. Aerosol paints and coatings shall meet the Product-weighted MIR Limits for ROC in Section 94522(a)(2) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(e)(1) and (f)(1) of California Code of Regulations, Title 17, commencing with Section 94520; and in management company, approved by the enforcing agency, which areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 8, Rule 49.

> **4.504.2.4 Verification**. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:

1. Manufacturer's product specification. 2. Field verification of on-site product containers.

4.504.3 Carpet systems. All carpet installed in the building interior shall meet the testing and product requirements of one of the 1. Carpet and Rug Institute's Green Label Plus Program.

2. California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.1, February 2010 (also known as Specification 01350.) 3. NSF/ANSI 140 at the Gold level. 4. Scientific Certifications Systems Indoor Advantage™

4.504.3.1 Carpet cushion. All carpet cushion installed in the

building interior shall meet the requirements of the Carpet and

Rug Institute's Green Label program. **4.504.3.2 Carpet adhesive.** All carpet adhesive shall meet the requirements of Table 4.504.1

4.504.5 Composite wood products. Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the building shall meet the requirements for formaldehyde as specified in ARB's Air Toxics Control Measure for Composite Wood (17 CCR 93120 et seq.), by or before the dates specified in those sections, as shown in Table 4.504.5.

4.504.5.1 Documentation. Verification of compliance with this section shall be provided as requested by the enforcing agency. Documentation shall include at least one of the

following: Product certifications and specifications. 2. Chain of custody certifications.

3. Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seq.). 4. Exterior grade products marked as meeting the PS-1 or PS 2 standards of the Engineered Wood Association, the Australian AS/NZS 2269, European 6363S, and Canadian CSA O121, CSA O151, CSA O153 and CSA O325 standards.

SECTION 4.505

4.505.1 General. Buildings shall meet or exceed the provisions of the California Building Standards Code.

INTERIOR MOISTURE CONTROL

Other methods acceptable to the enforcing agency.

4.505.2 Concrete slab foundations. Concrete slab foundations required to have a vapor retarder by the California Building Code, Chapter 19 or concrete slab-on-ground floors required to have a vapor retarder by the California Residential Code, Chapter 5, shall also comply with this section.

4.505.2.1 Capillary break. A capillary break shall be installed in compliance with at least one of the following: 1. A 4-inch-thick (101.6 mm) base of 1/2 inch (12.7 mm) or larger clean aggregate shall be provided with a vapor retarder in direct contact with concrete and a concrete mix design, which will address bleeding, shrinkage, and curling, shall be used. For additional information, see American Concrete Institute, ACI 302.2R-06. 2. Other equivalent methods approved by the enforcing 3. A slab design specified by a licensed design

4.505.3 Moisture content of building materials. Building materials with visible signs of water damage shall not be installed. Wall and floor framing shall not be enclosed when the framing members exceed 19-percent moisture content. Moisture content shall be verified in compliance with the following:

professional.

1. Moisture content shall be determined with either a probe type or contact-type moisture meter. Equivalent moisture verification methods may be approved by the enforcing agency and shall satisfy requirements found in Section 101.8 of this code.

2. Moisture readings shall be taken at a point 2 feet (610 mm) to 4 feet (1219 mm) from the grade stamped end of each piece to be verified.

3. At least three random moisture readings shall be performed on wall and floor framing with documentation acceptable to the enforcing agency provided at the time of approval to enclose the wall and floor framing. Insulation products which are visibly wet or have a high

moisture content shall be replaced or allowed to dry prior to enclosure in wall or floor cavities. Wet-applied insulation products shall follow the manufacturers' drying recommendations prior to enclosure.

> **SECTION 4.506** INDOOR AIR QUALITY AND EXHAUST

4.506.1 Bathroom exhaust fans. Each bathroom shall be

mechanically ventilated and shall comply with the following: 1. Fans shall be ENERGY STAR compliant and be ducted to terminate outside the building.

2. Unless functioning as a component of a whole house ventilation system, fans must be controlled by a humidity a. Humidity controls shall be capable of adjustment

between a relative humidity range of ≤ 50 percent to a

maximum of 80 percent. A humidity control may utilize manual or automatic means of adjustment. b. A humidity control may be a separate component to the exhaust fan and is not required to be integral (i.e.,

1. For the purposes of this section, a bathroom is a room which contains a bathtub, shower, or tub/ shower combination

2. Lighting integral to bathroom exhaust fans shall comply with the California Energy Code. **SECTION 4.507**

ENVIRONMENTAL COMFORT

2. Aerosol adhesives, and smaller unit sizes of adhesives, and 4.507.2 Heating and air-conditioning system design. Heating packaging, which do not weigh more than 1 pound and do not and air-conditioning systems shall be sized, designed and hav

design software or methods.

their equipment selected using the following methods: 1. The heat loss and heat gain is established according to ANSI/ACCA 2 Manual J—2016 (Residential Load Calculation), ASHRAE handbooks or other equivalent

2. Duct systems are sized according to ANSI/ACCA 1 Manual D—2016 (Residential Duct Systems), ASHRAE handbooks or other equivalent design software or methods. 3. Select heating and cooling equipment according to

Exception: Use of alternate design temperatures necessary to

ANSI/ACCA 3 Manual S—2014 (Residential Equipment

Selection) or other equivalent design software or methods.

16.14.110 Section 4.509 Water heater replacement. Control Measure, and the corresponding Flat, Nonflat or Non-flat-Section 4.509 of Chapter 4 of the California Green Building Standards Code is added to read:

ensure the systems function are acceptable.

remodels or additions where the gas water heater is replaced or new water heater is added, the new water heater shall be a heat pump water heater (HPWH).

4.509 Water heater replacement. For existing residential building

RESIDENTIAL MANDATORY MEASURES

TABLE 4.504.1

ADHESIVE VOC LIMIT^{1, 2}

Less Water and Less Exempt Compounds in Grams per Liter

ARCHITECTURAL APPLICATIONS	VOC LIMIT	Less Water and Less Exempt Con	•
Indoor carpet adhesives	50	COATING CATEGORY	VOC LIMIT
Carpet pad adhesives	50	Flat coatings	50
Outdoor carpet adhesives	150	Nonflat coatings	100
Wood flooring adhesive	100	Nonflat-high gloss coatings	150
Rubber floor adhesives	60	SPECIALTY COATINGS	
Subfloor adhesives	50	Aluminum roof coatings	400
Ceramic tile adhesives	65	Basement specialty coatings	400
VCT and asphalt tile adhesives	50	Bituminous roof coatings	50
Drywall and panel adhesives	50	Bituminous roof primers	350
Cove base adhesives	50	Bond breakers	350
Multipurpose construction adhesives	70	Concrete curing compounds	350
Structural glazing adhesives	100	Concrete/masonry sealers	100
Single-ply roof membrane adhesives	250	Driveway sealers	50
Other adhesives not specifically listed	50	Dry fog coatings	150
SPECIALTY APPLICATIONS		Faux finishing coatings	350
PVC welding	510	Fire resistive coatings	350
CPVC welding	490	Floor coatings	100
ABS welding	325	Form-release compounds	250
Plastic cement welding	250	Graphic arts coatings (sign paints)	500
Adhesive primer for plastic	550	High temperature coatings	420
Contact adhesive	80	Industrial maintenance coatings	250
Special purpose contact adhesive	250	Low solids coatings ¹	120
Structural wood member adhesive	140	Magnesite cement coatings	450
Top and trim adhesive	250	Mastic texture coatings	100
SUBSTRATE SPECIFIC APPLICATIONS		Metallic pigmented coatings	500
Metal to metal	30	Multicolor coatings	250
Plastic foams	50	Pretreatment wash primers	420
Porous material (except wood)	50	Primers, sealers, and undercoaters	100
Wood	30	Reactive penetrating sealers	350
Fiberglass	80	Recycled coatings	250
1. If an adhesive is used to bond dissimilar s	ubstrates together, the adhesive	Roof coatings	50
with the highest VOC content shall be allo		Rust preventative coatings	250
2. For additional information regarding method	ds to measure the VOC content	Shellacs	
specified in this table, see South Coast Air Q	uality Management District Rule	Clear	730
1168.		Opaque	550
TABLE 4.504		Specialty primers, sealers and undercoaters	100
SEALANT VOC I		Stains	250
Less Water and Less Exempt Compo	VOC LIMIT	Stone consolidants	450
Architectural	250	Swimming pool coatings	340
	760	Traffic marking coatings	100
Marine deck		Tub and tile refinish coatings	420
Nonmembrane roof	300	Waterproofing membranes	250
Roadway	250	Wood coatings	275
Single-ply roof membrane	450	Wood preservatives	350
Other	420	Zinc-rich primers	340
SEALANT PRIMERS		<u> </u>	
Architectural		Grams of VOC per liter of coating, including water	er and including ex
Nonporous	250	compounds.	
Porous	775	2. The specified limits remain in effect unless revi	sed limits are list
Modified bituminous 500		subsequent columns in the table.	

2019 CALIFORNIA GREEN BUILDING STANDARDS CODE

TABLE 4.504.5

Values in this table are derived from those specified by the California Air

Resources Board, Architectural Coatings Suggested Control Measure,

February 1, 2008. More information is available from the Air Resources Board.

TABLE 4.504.3

VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS^{2, 3}

Grams of VOC per Liter of Coating,

FORMALDEHYDE LIMITS¹ Maximum Formaldehyde Emissions in Parts per Million **CURRENT LIMIT** dwood plywood veneer core 0.05 0.05 ardwood plywood composite core 0.09 Particleboard Medium density fiberboard 0.11 0.13 Thin medium density fiberboard²

1. Values in this table are derived from those specified by the California Air Resources Board, Air Toxics Control Measure for Composite Wood as tested in accordance with ASTM E1333. For additional information, see California Code of Regulations, Title 17, Sections 93120 through 93120.12. 2. Thin medium density fiberboard has a maximum thickness of ⁵/₁₆ inch (8 mm).

Table A4.403.2.3 Cement and Embodied Carbon Limit Pathways or use with any compliance for use with any compliance method A4.403.2.3.2 to method A4.403.2.3.2 to Maximum ordinary Portland CO₂e/m³, per EPD cement content, lbs/yd³ (2) 3000 5000 5000 light weight

PALO ALTO WATER QUAILTY

(1) For concrete strengths between the stated values, use linear interpretation to determine

ement and/or embodied carbon limits.

(2) Portland cement of any type per ASTM C150.

Stormwater Best Management Practices (BMPs) associated with refuse management (including actions related to refuse pick-up and the enclosure itself) shall be followed to ensure pollution prevention and preventing potential discharges to the City's storm drain system. Stormwater BMPS include, but are not limited to, power washing the pavement on both the private property and in the right-of-way and sidewalk a minimum of once per year before the wet season begins on October 1st; utilizing a power washing contractor that is a Recognized Surface Cleaner by the Bay Area Stormwater Management Agencies Association (BASMAA); disposing of wash water according to the Recognized Surface Cleaner certification requirements; and removing any potential trash build-up on a regular basis.

0 O

IRWIN PARTNERS

ARCHITECTURE

PLANNING

CONSULTING

245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com


ARCHITECT




PROJECT: 21003
DRAWN BY: YI, RA, & DB
CHECKED BY: TB & MP
DATE OF ISSUE: 00/00/0000
DRAWING DESCRIPTION

DRAWING NUMBER

Cal Greens Notes

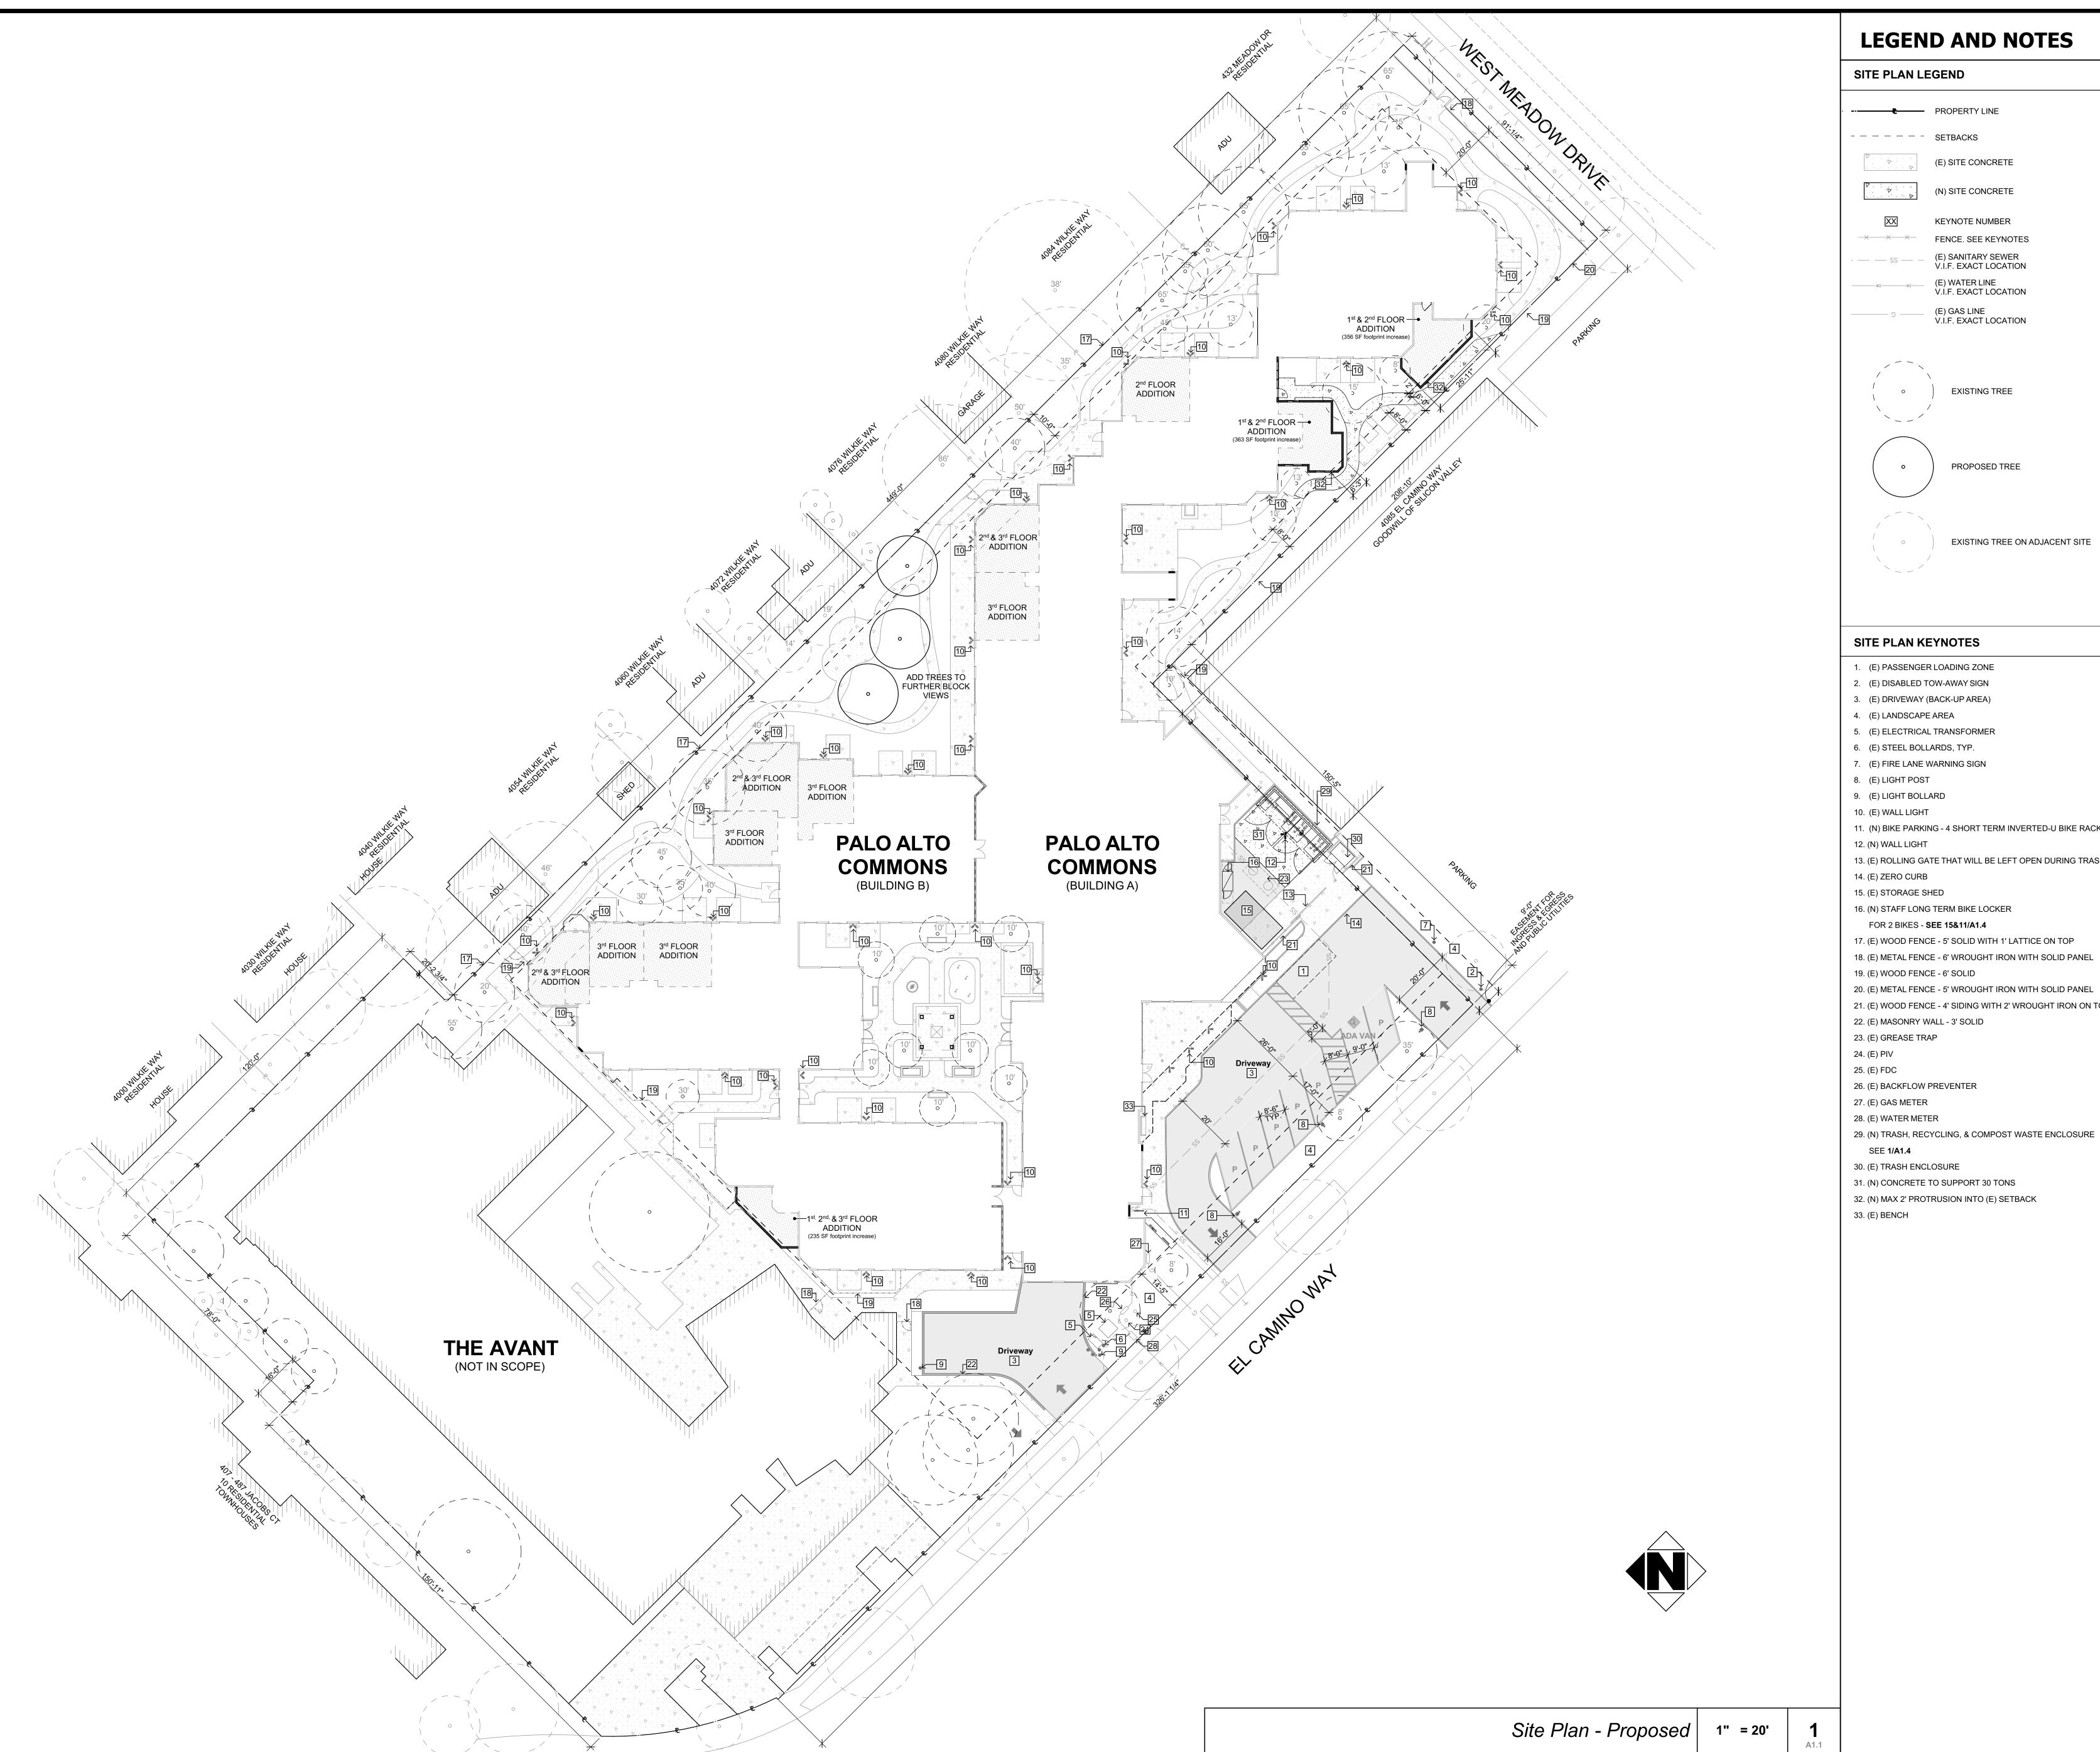

SITE PLAN LEGEND --- PROPERTY LINE ---- SETBACKS (E) SITE CONCRETE (N) SITE CONCRETE KEYNOTE NUMBER FENCE. SEE KEYNOTES (E) SANITARY SEWER V.I.F. EXACT LOCATION (E) WATER LINE V.Í.F. EXACT LOCATION (E) GAS LINE V.I.F. EXACT LOCATION

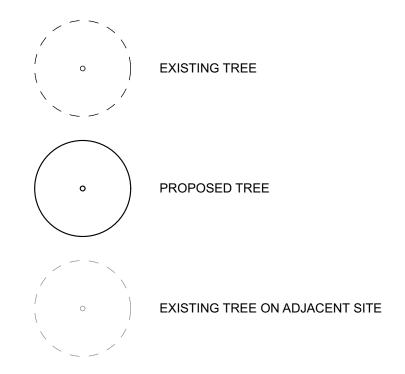


SITE PLAN KEYNOTES


- 1. (E) PASSENGER LOADING ZONE
- 2. (E) DISABLED TOW-AWAY SIGN
- 3. (E) DRIVEWAY (BACK-UP AREA)
- 6. (E) STEEL BOLLARDS, TYP.
- 7. (E) FIRE LANE WARNING SIGN
- 8. (E) LIGHT POST
- 9. (E) LIGHT BOLLARD
- 11. (N) BIKE PARKING 4 SHORT TERM INVERTED-U BIKE RACKS SEE 20&13/A1.4 12. (N) WALL LIGHT
- 13. (E) ROLLING GATE THAT WILL BE LEFT OPEN DURING TRASH PICKUP TIMES
- 14. (E) ZERO CURB 15. (E) STORAGE SHED
- 16. (N) STAFF LONG TERM BIKE LOCKER FOR 2 BIKES - SEE 15&11/A1.4
- 17. (E) WOOD FENCE 5' SOLID WITH 1' LATTICE ON TOP
- 18. (E) METAL FENCE 6' WROUGHT IRON WITH SOLID PANEL 19. (E) WOOD FENCE - 6' SOLID
- 20. (E) METAL FENCE 5' WROUGHT IRON WITH SOLID PANEL
- 21. (E) WOOD FENCE 4' SIDING WITH 2' WROUGHT IRON ON TOP
- 22. (E) MASONRY WALL 3' SOLID

- 26. (E) BACKFLOW PREVENTER
- 28. (E) WATER METER
- SEE 1/A1.4
- 30. (E) TRASH ENCLOSURE
- 31. (N) CONCRETE TO SUPPORT 30 TONS
- 32. (N) MAX 2' PROTRUSION INTO (E) SETBACK





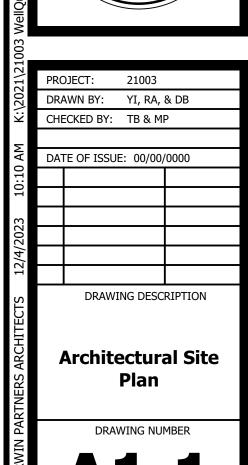

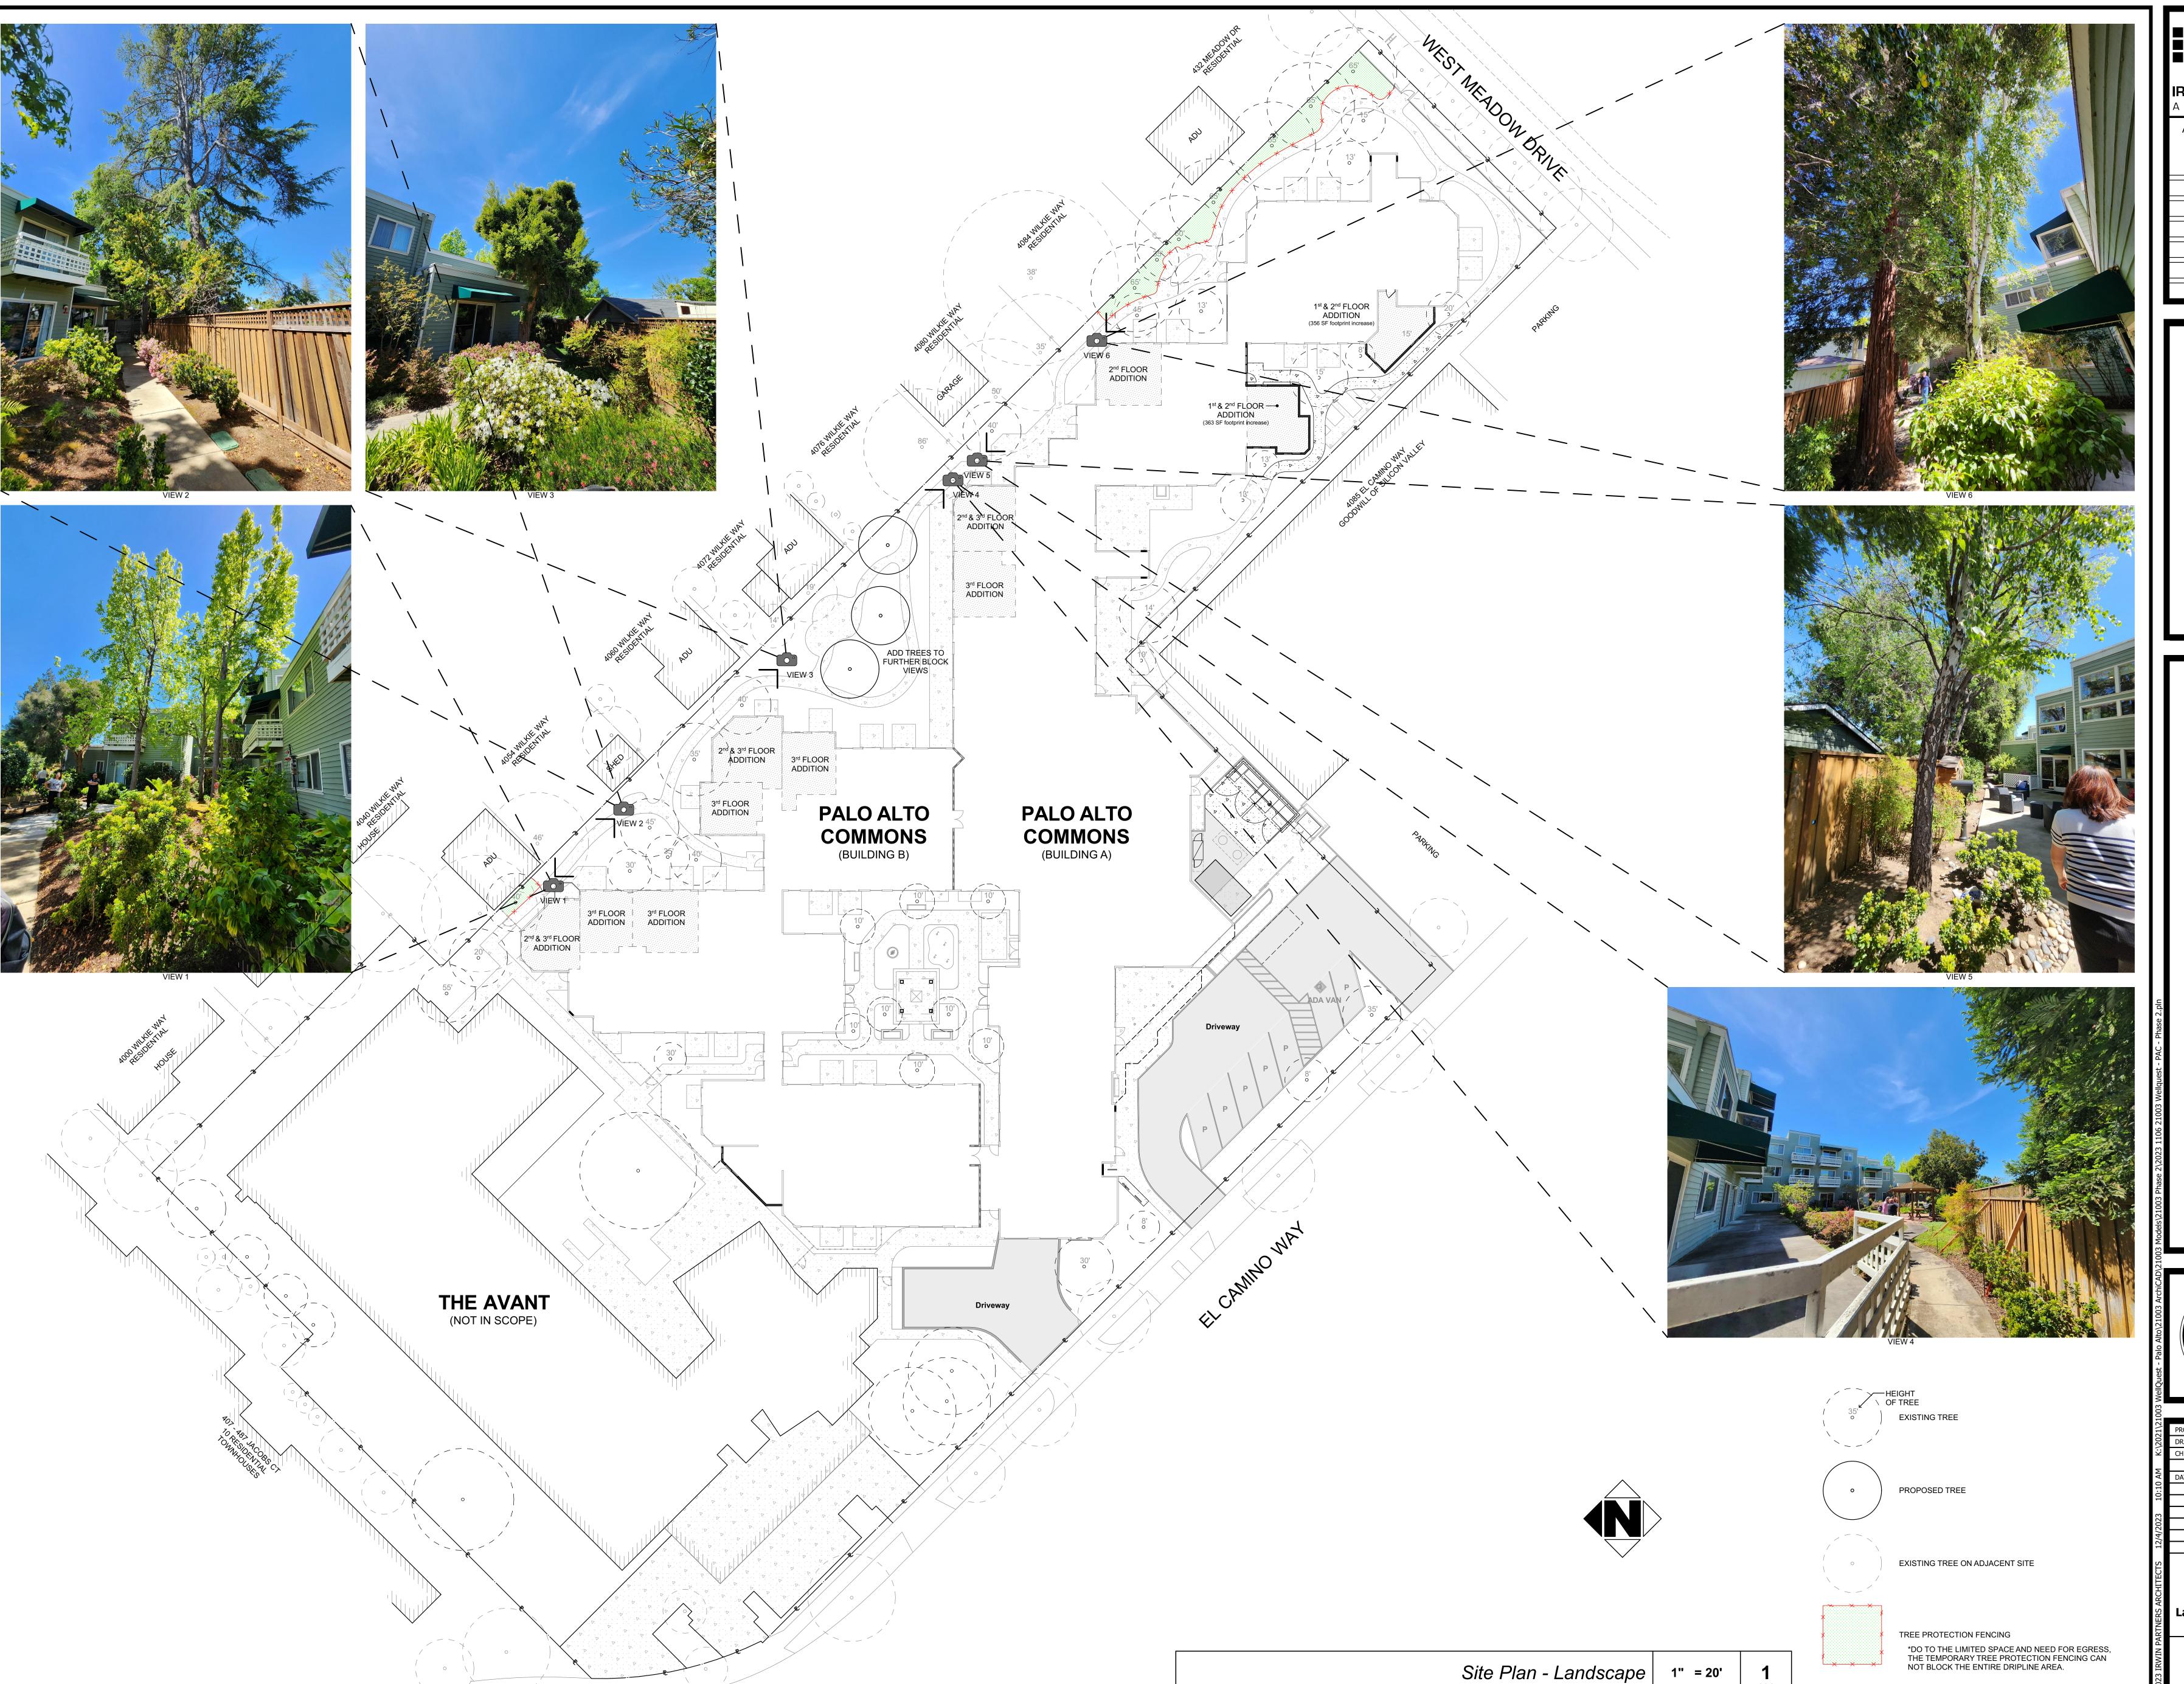

ARCHITECTURE PLANNING

CONSULTING 245 Fischer Avenue

Suite B-2


Costa Mesa California 92626 T: 714 557 2448

www.ipaoc.com


CHECKED BY: TB & MP

DRAWN BY: YI, RA, & DB DATE OF ISSUE: 00/00/0000 DRAWING DESCRIPTION

Landscape Site Plan

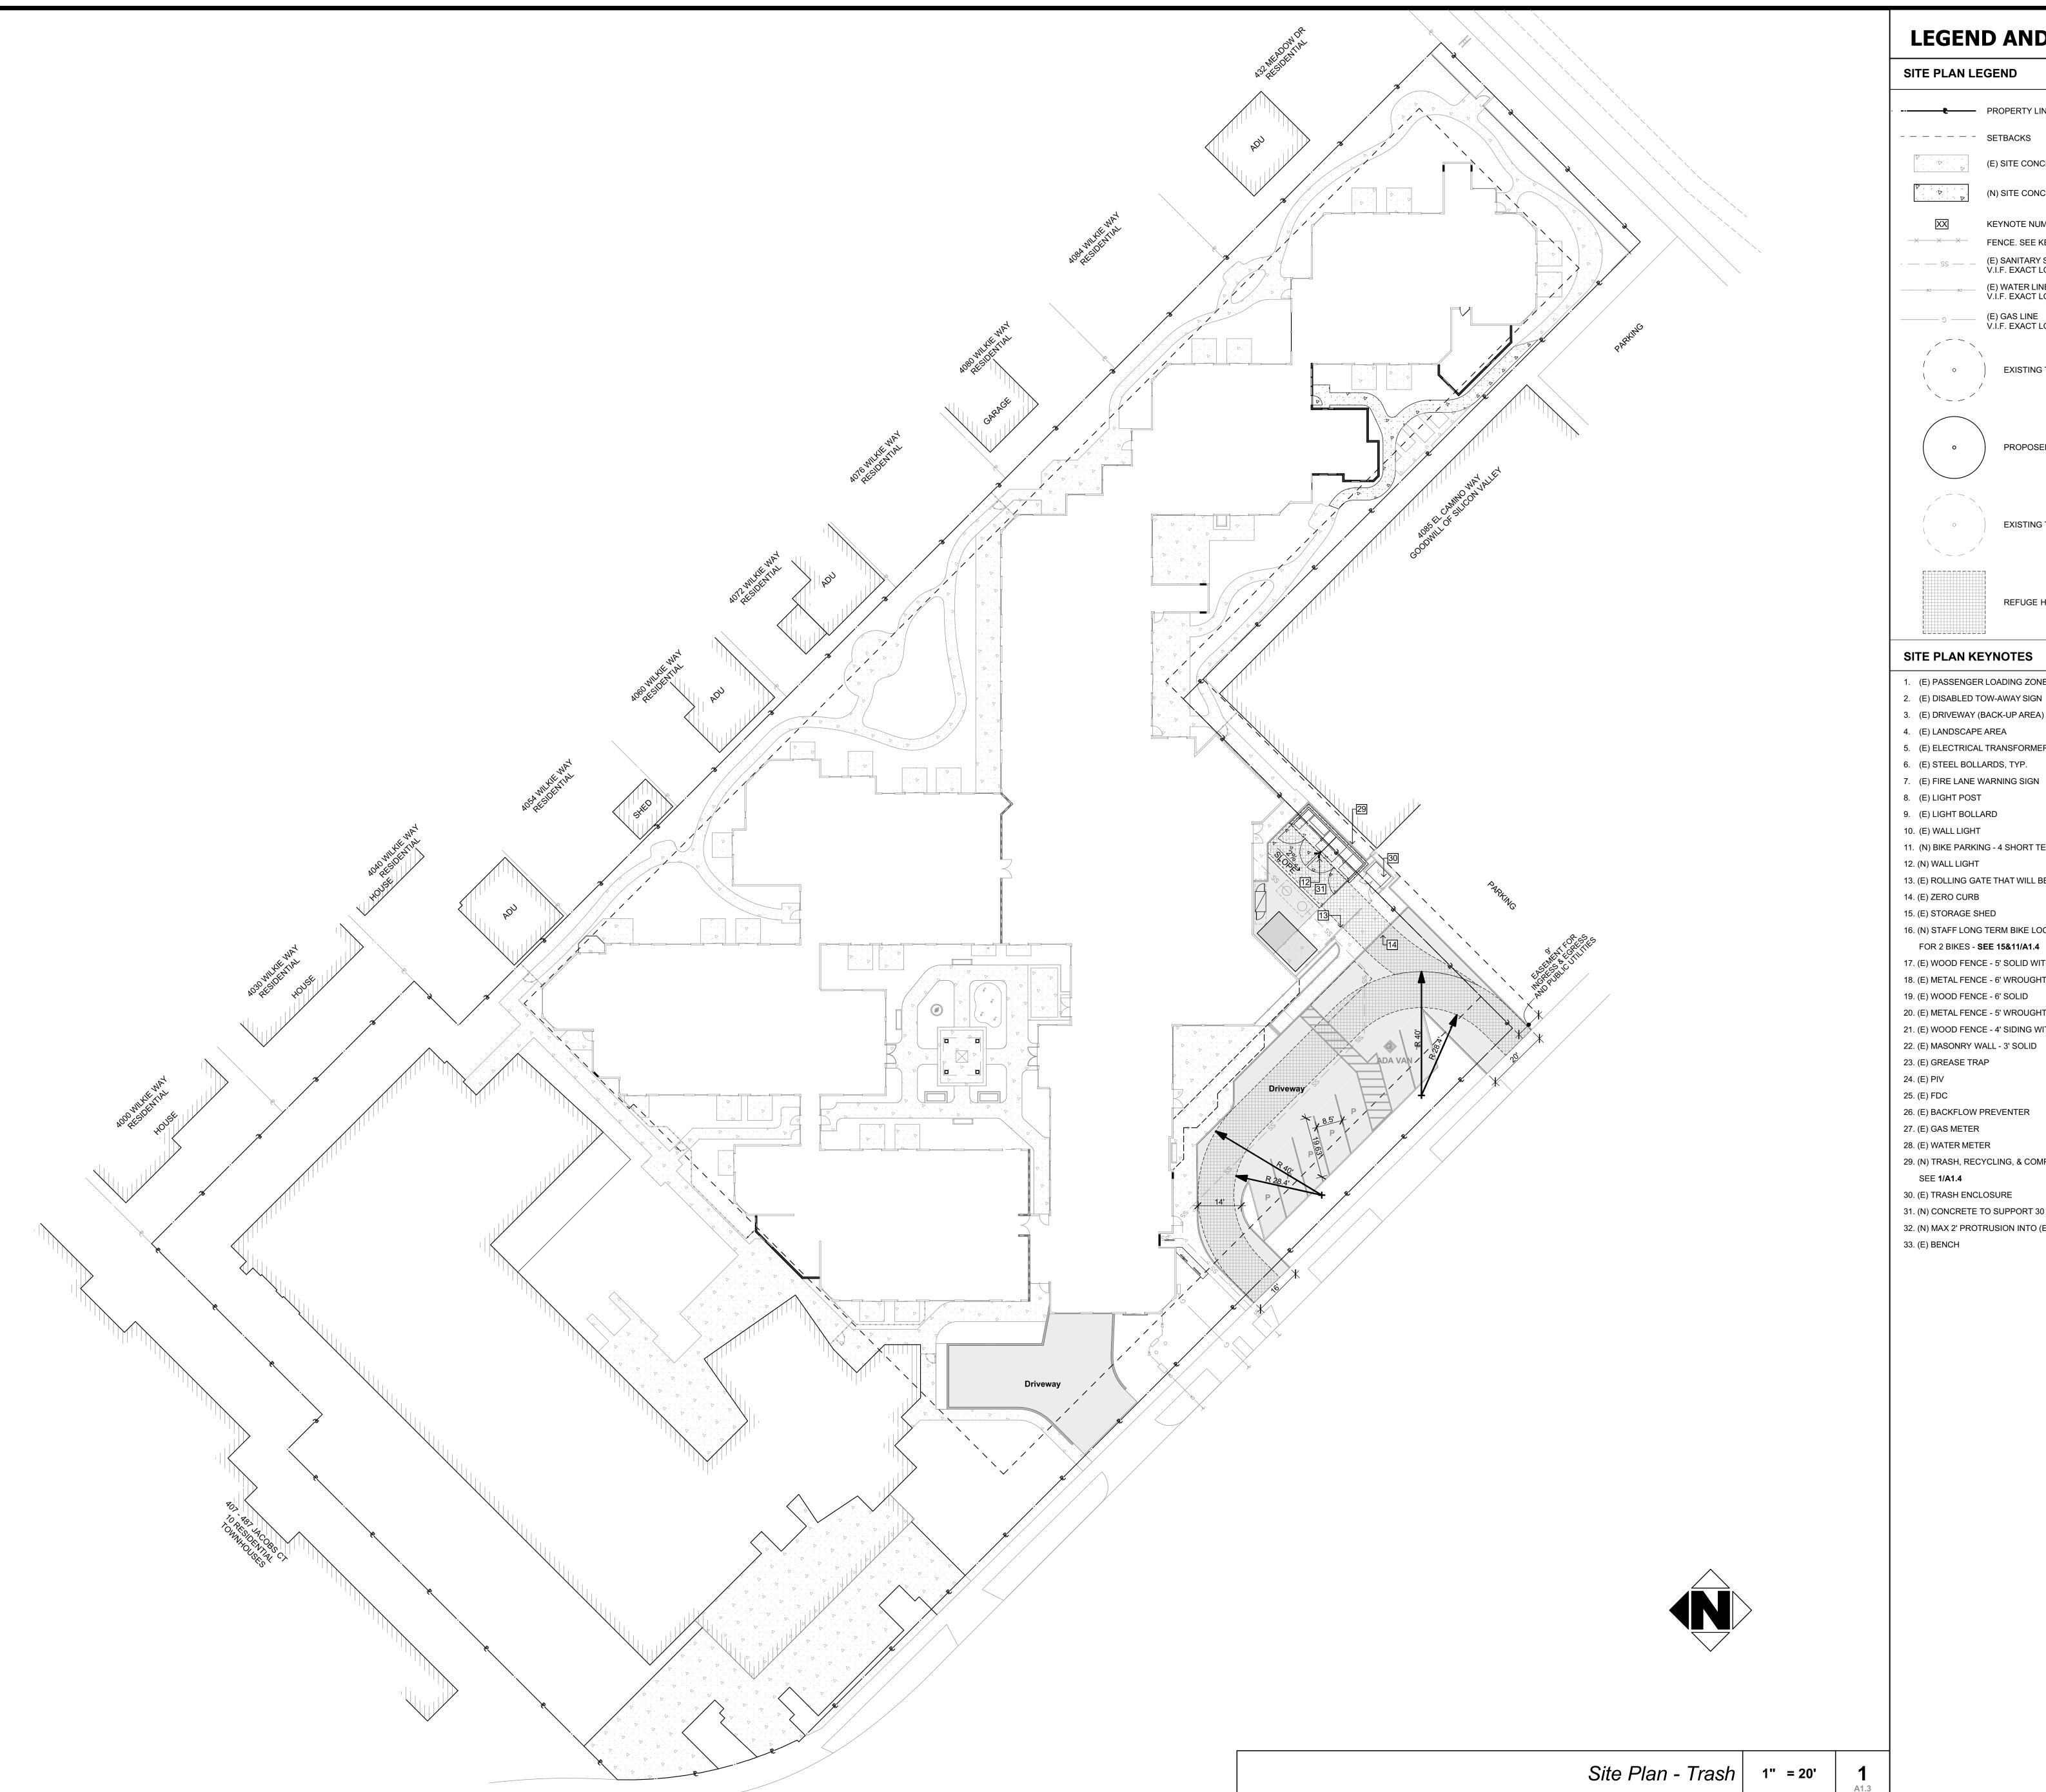



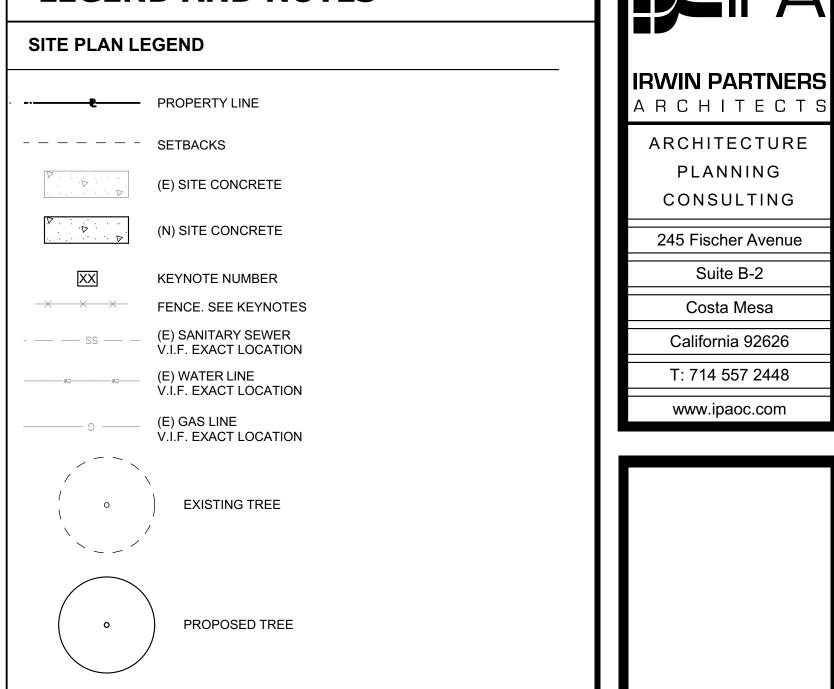

SITE PLAN KEYNOTES

- 1. (E) PASSENGER LOADING ZONE
- 2. (E) DISABLED TOW-AWAY SIGN
- 6. (E) STEEL BOLLARDS, TYP.


- 10. (E) WALL LIGHT 11. (N) BIKE PARKING - 4 SHORT TERM INVERTED-U BIKE RACKS - SEE 20&13/A1.4
- 13. (E) ROLLING GATE THAT WILL BE LEFT OPEN DURING TRASH PICKUP TIMES

EXISTING TREE ON ADJACENT SITE

REFUGE HAULER PATH OF TRAVEL

- 15. (E) STORAGE SHED
- 16. (N) STAFF LONG TERM BIKE LOCKER
- FOR 2 BIKES SEE 15&11/A1.4 17. (E) WOOD FENCE - 5' SOLID WITH 1' LATTICE ON TOP
- 18. (E) METAL FENCE 6' WROUGHT IRON WITH SOLID PANEL
- 19. (E) WOOD FENCE 6' SOLID
- 20. (E) METAL FENCE 5' WROUGHT IRON WITH SOLID PANEL
- 21. (E) WOOD FENCE 4' SIDING WITH 2' WROUGHT IRON ON TOP
- 22. (E) MASONRY WALL 3' SOLID


- 28. (E) WATER METER
- 29. (N) TRASH, RECYCLING, & COMPOST WASTE ENCLOSURE
- 30. (E) TRASH ENCLOSURE
- 31. (N) CONCRETE TO SUPPORT 30 TONS
- 32. (N) MAX 2' PROTRUSION INTO (E) SETBACK



Suite B-2

Costa Mesa

DRAWING DESCRIPTION **Trash Site Plan**

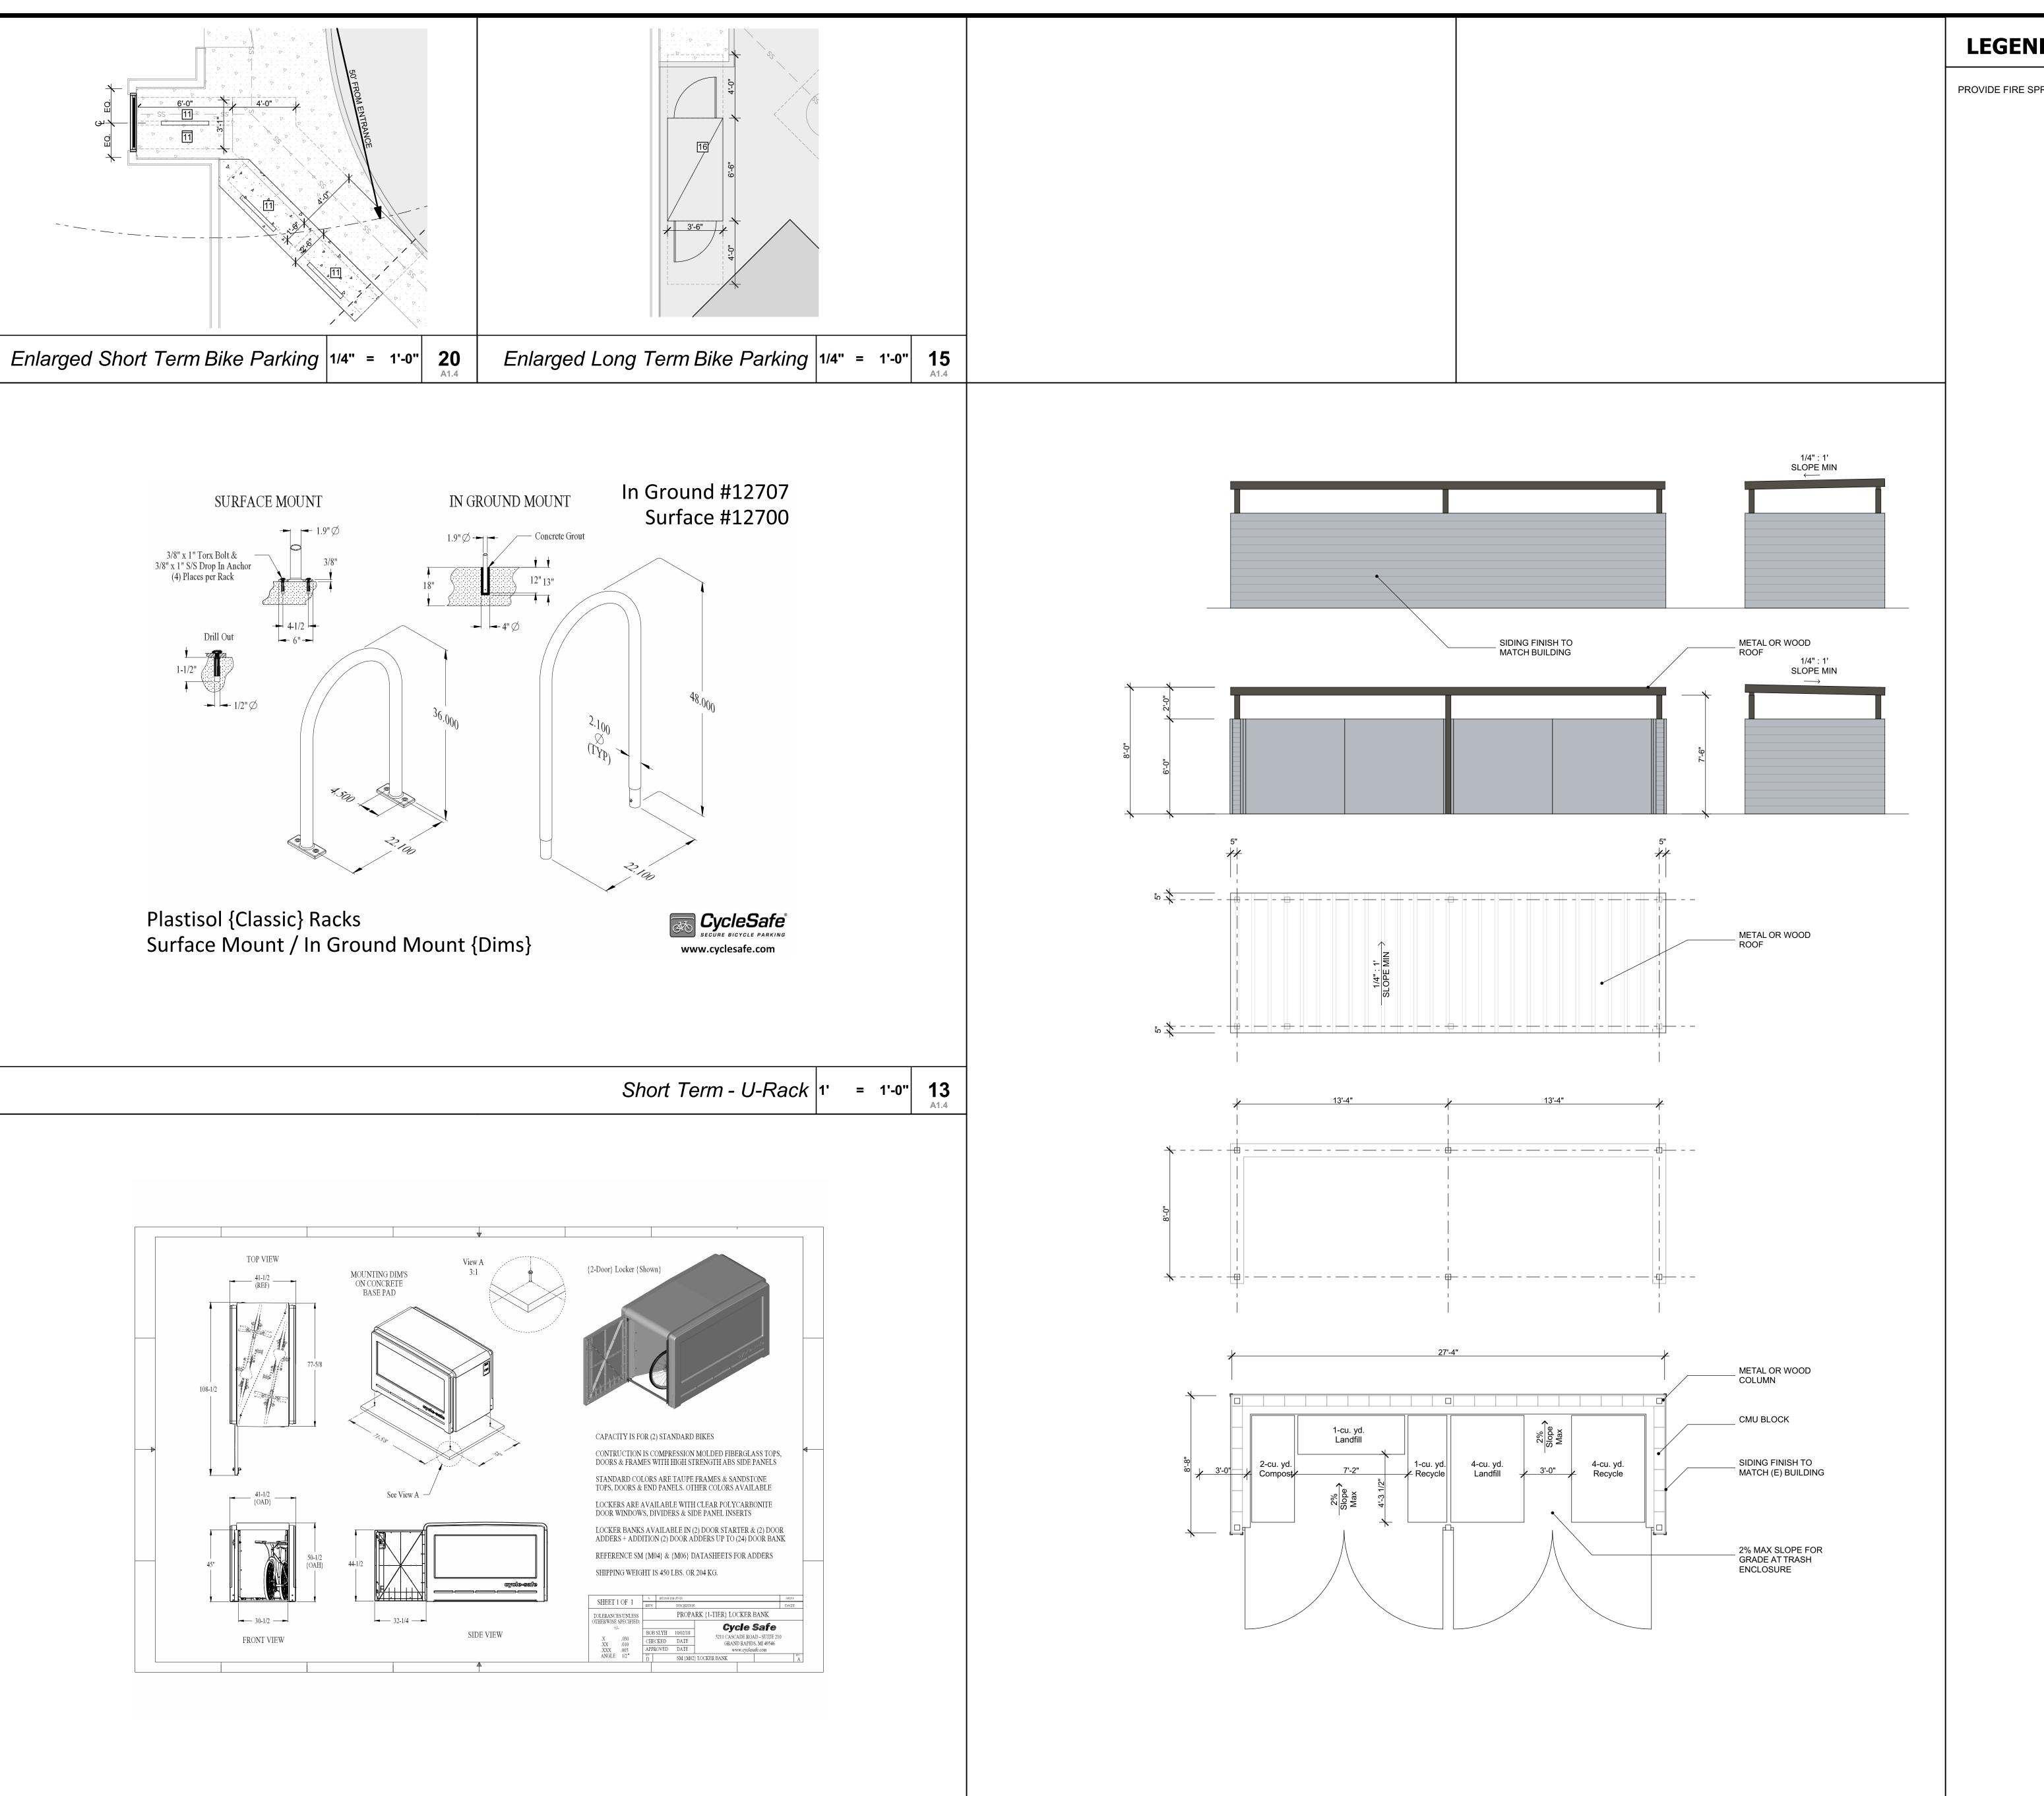

Trash, Recycling, & Compost Waste Enclosure Plan | 1/4" = 1'-0" | 1

Long Term - ProPark Locker - 2 Doors | 1' = 1'-0" | 11

LEGEND AND NOTES

PROVIDE FIRE SPRINKLER PROTECTION FOR PROPOSED TRASH ENCLOSURE

IRWIN PARTNERS
ARCHITECTS

ARCHITECTURE
PLANNING
CONSULTING

245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626 T: 714 557 2448

www.ipaoc.com

PALO ALTO COMMONS

Wellquest Living
El Camino Way, Palo Alto, CA 943



PROJECT: 21003

DRAWN BY: YI, RA, & DB


CHECKED BY: TB & MP

DATE OF ISSUE: 00/00/0000

DRAWING DESCRIPTION

Trash Enclosure & Bike Storage

DRAWING NUMBER

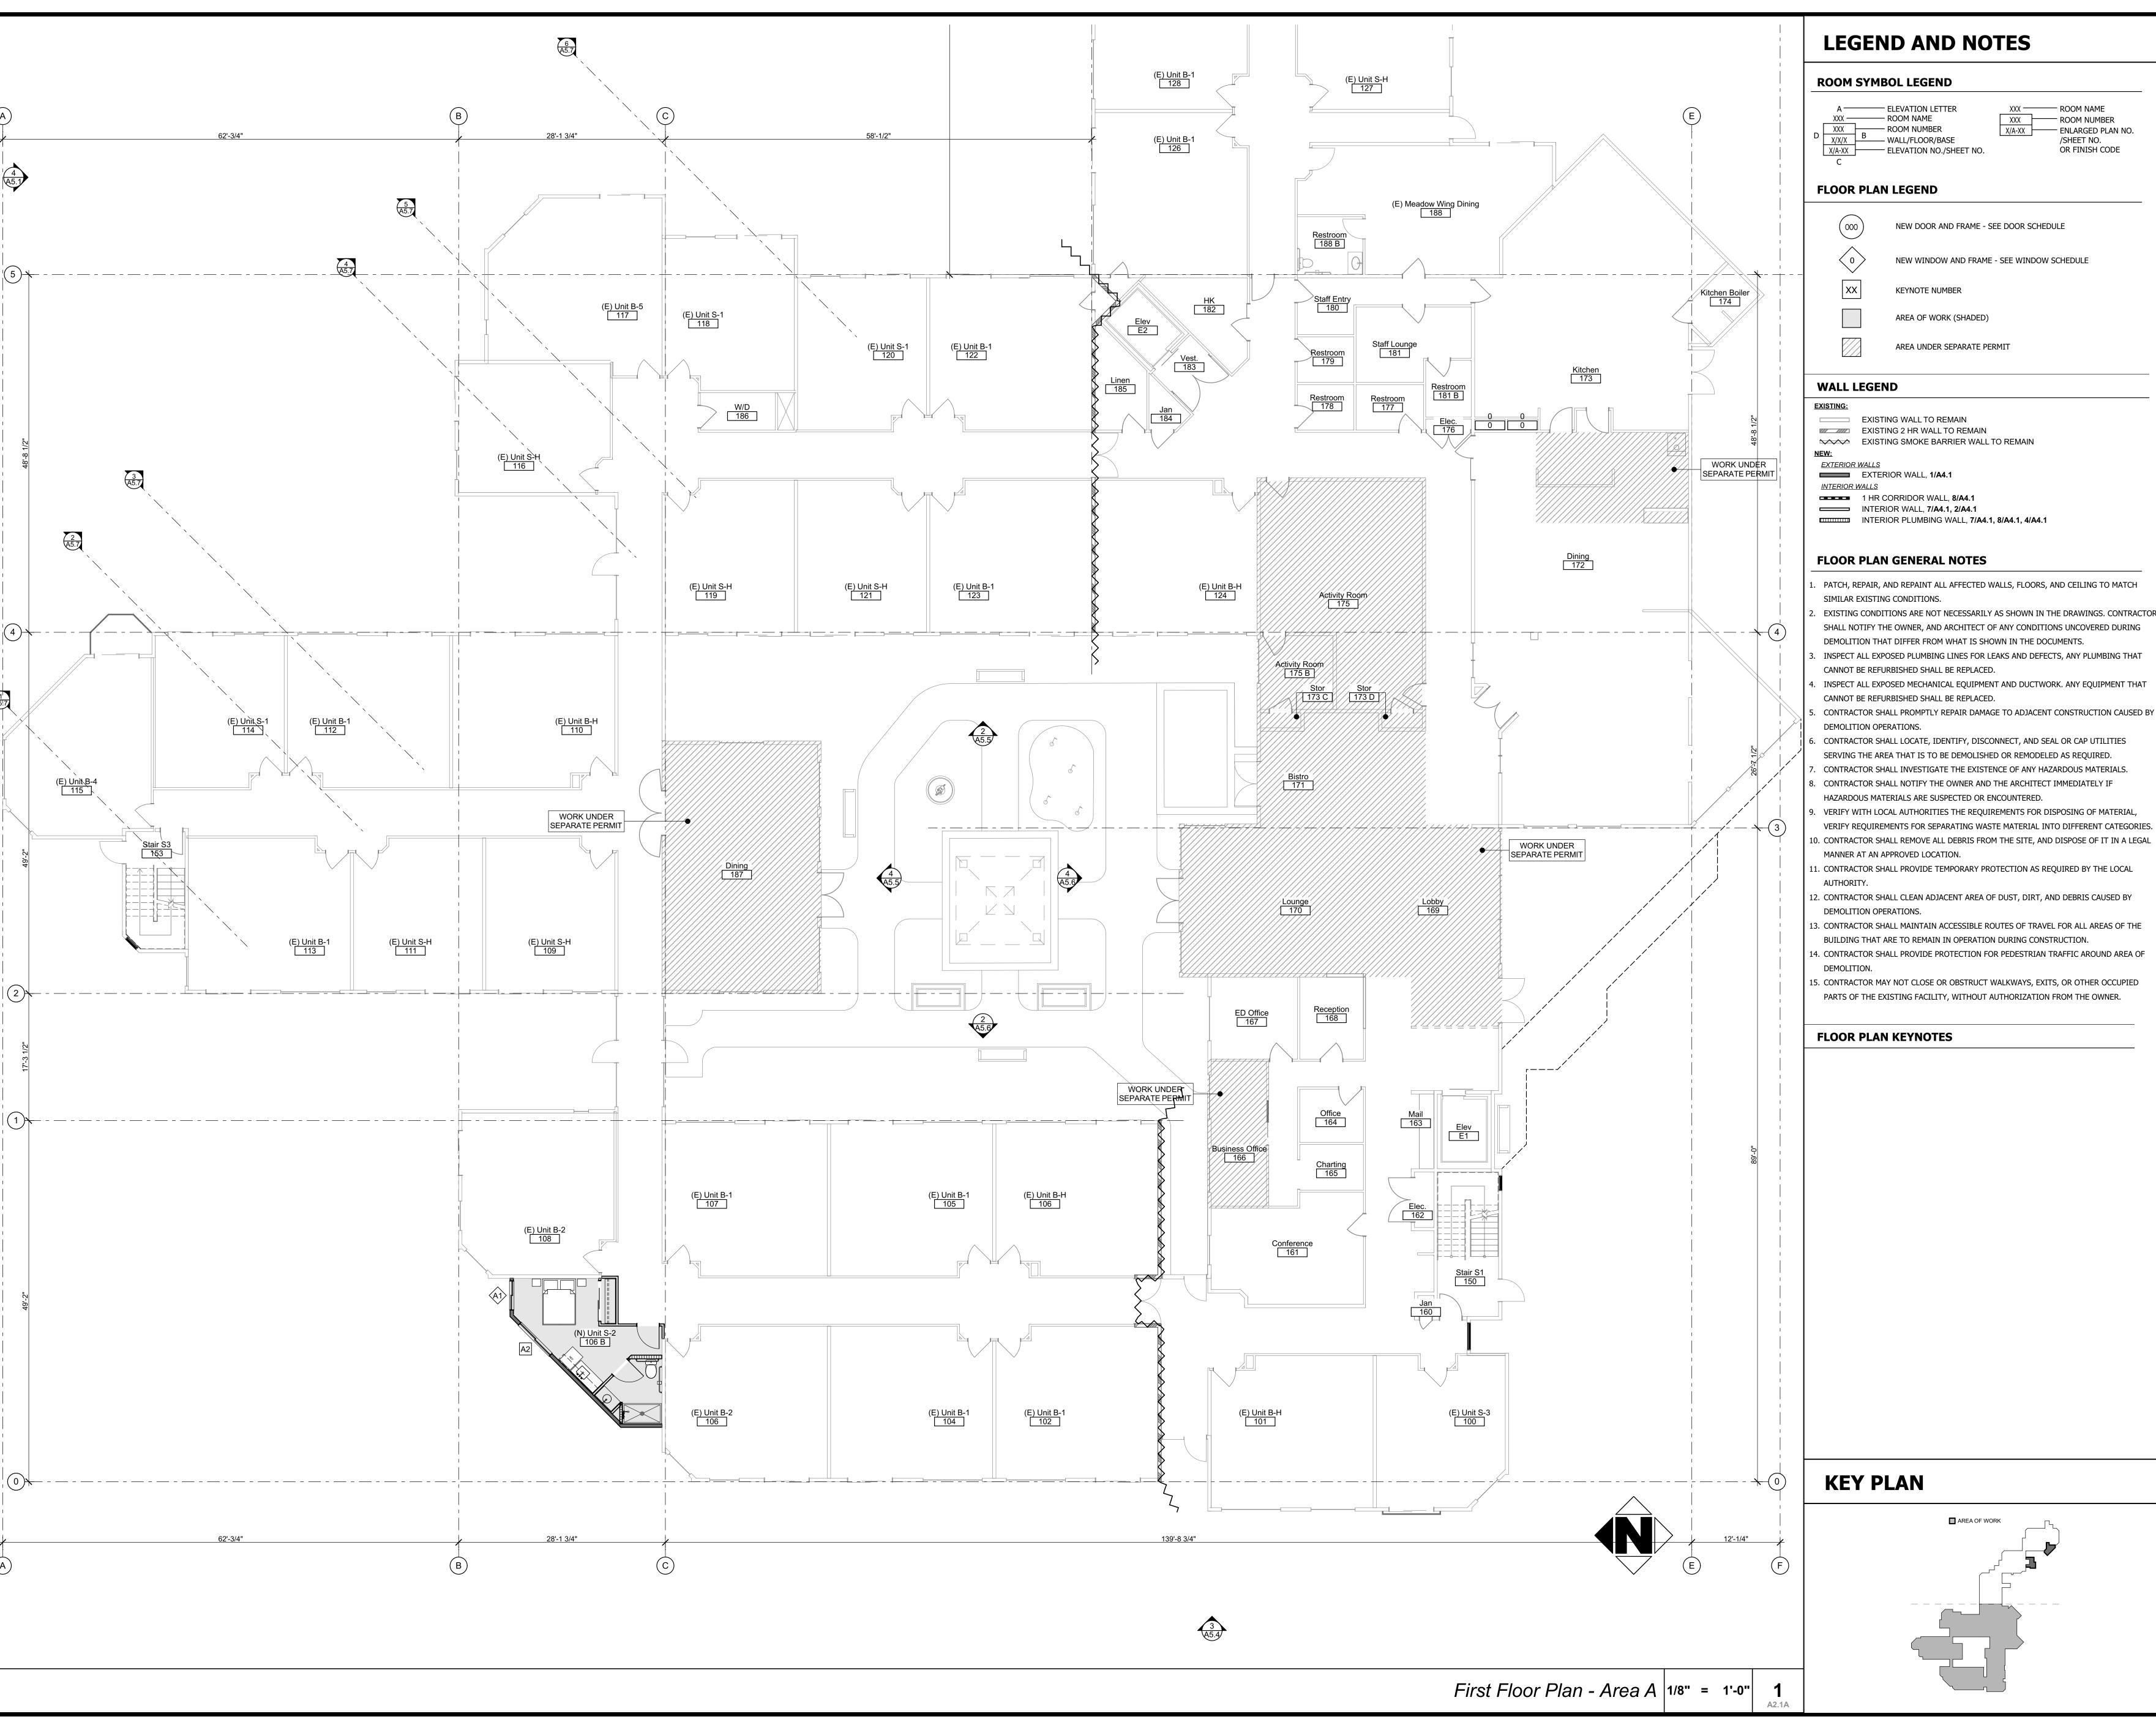

ROOM SYMBOL LEGEND

A — ELEVATION LETTER XXX ROOM NUMBER XXX — ROOM NAME X/A-XX ENLARGED PLAN NO. XXX ROOM NUMBER B WALL/FLOOR/BASE /SHEET NO. X/A-XX ELEVATION NO./SHEET NO. OR FINISH CODE

FLOOR PLAN LEGEND

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

KEYNOTE NUMBER

AREA OF WORK (SHADED)

AREA UNDER SEPARATE PERMIT

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN EXISTING SMOKE BARRIER WALL TO REMAIN

EXTERIOR WALL, 1/A4.1

1 HR CORRIDOR WALL, 8/A4.1 INTERIOR WALL, **7/A4.1**, **2/A4.1**

INTERIOR PLUMBING WALL, 7/A4.1, 8/A4.1, 4/A4.1

FLOOR PLAN GENERAL NOTES


- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS. EXISTING CONDITIONS ARE NOT NECESSARILY AS SHOWN IN THE DRAWINGS. CONTRACTOR
- SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- CANNOT BE REFURBISHED SHALL BE REPLACED.
- INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- DEMOLITION OPERATIONS.
- CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED.
- CONTRACTOR SHALL INVESTIGATE THE EXISTENCE OF ANY HAZARDOUS MATERIALS. CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT IMMEDIATELY IF
- HAZARDOUS MATERIALS ARE SUSPECTED OR ENCOUNTERED. VERIFY WITH LOCAL AUTHORITIES THE REQUIREMENTS FOR DISPOSING OF MATERIAL,
- VERIFY REQUIREMENTS FOR SEPARATING WASTE MATERIAL INTO DIFFERENT CATEGORIES. 10. CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE, AND DISPOSE OF IT IN A LEGAL
- 1. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 12. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY
- 13. CONTRACTOR SHALL MAINTAIN ACCESSIBLE ROUTES OF TRAVEL FOR ALL AREAS OF THE
- BUILDING THAT ARE TO REMAIN IN OPERATION DURING CONSTRUCTION. 14. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 15. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED
- PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.

FLOOR PLAN KEYNOTES


IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING 245 Fischer Avenue

Suite B-2 Costa Mesa California 92626 T: 714 557 2448

www.ipaoc.com





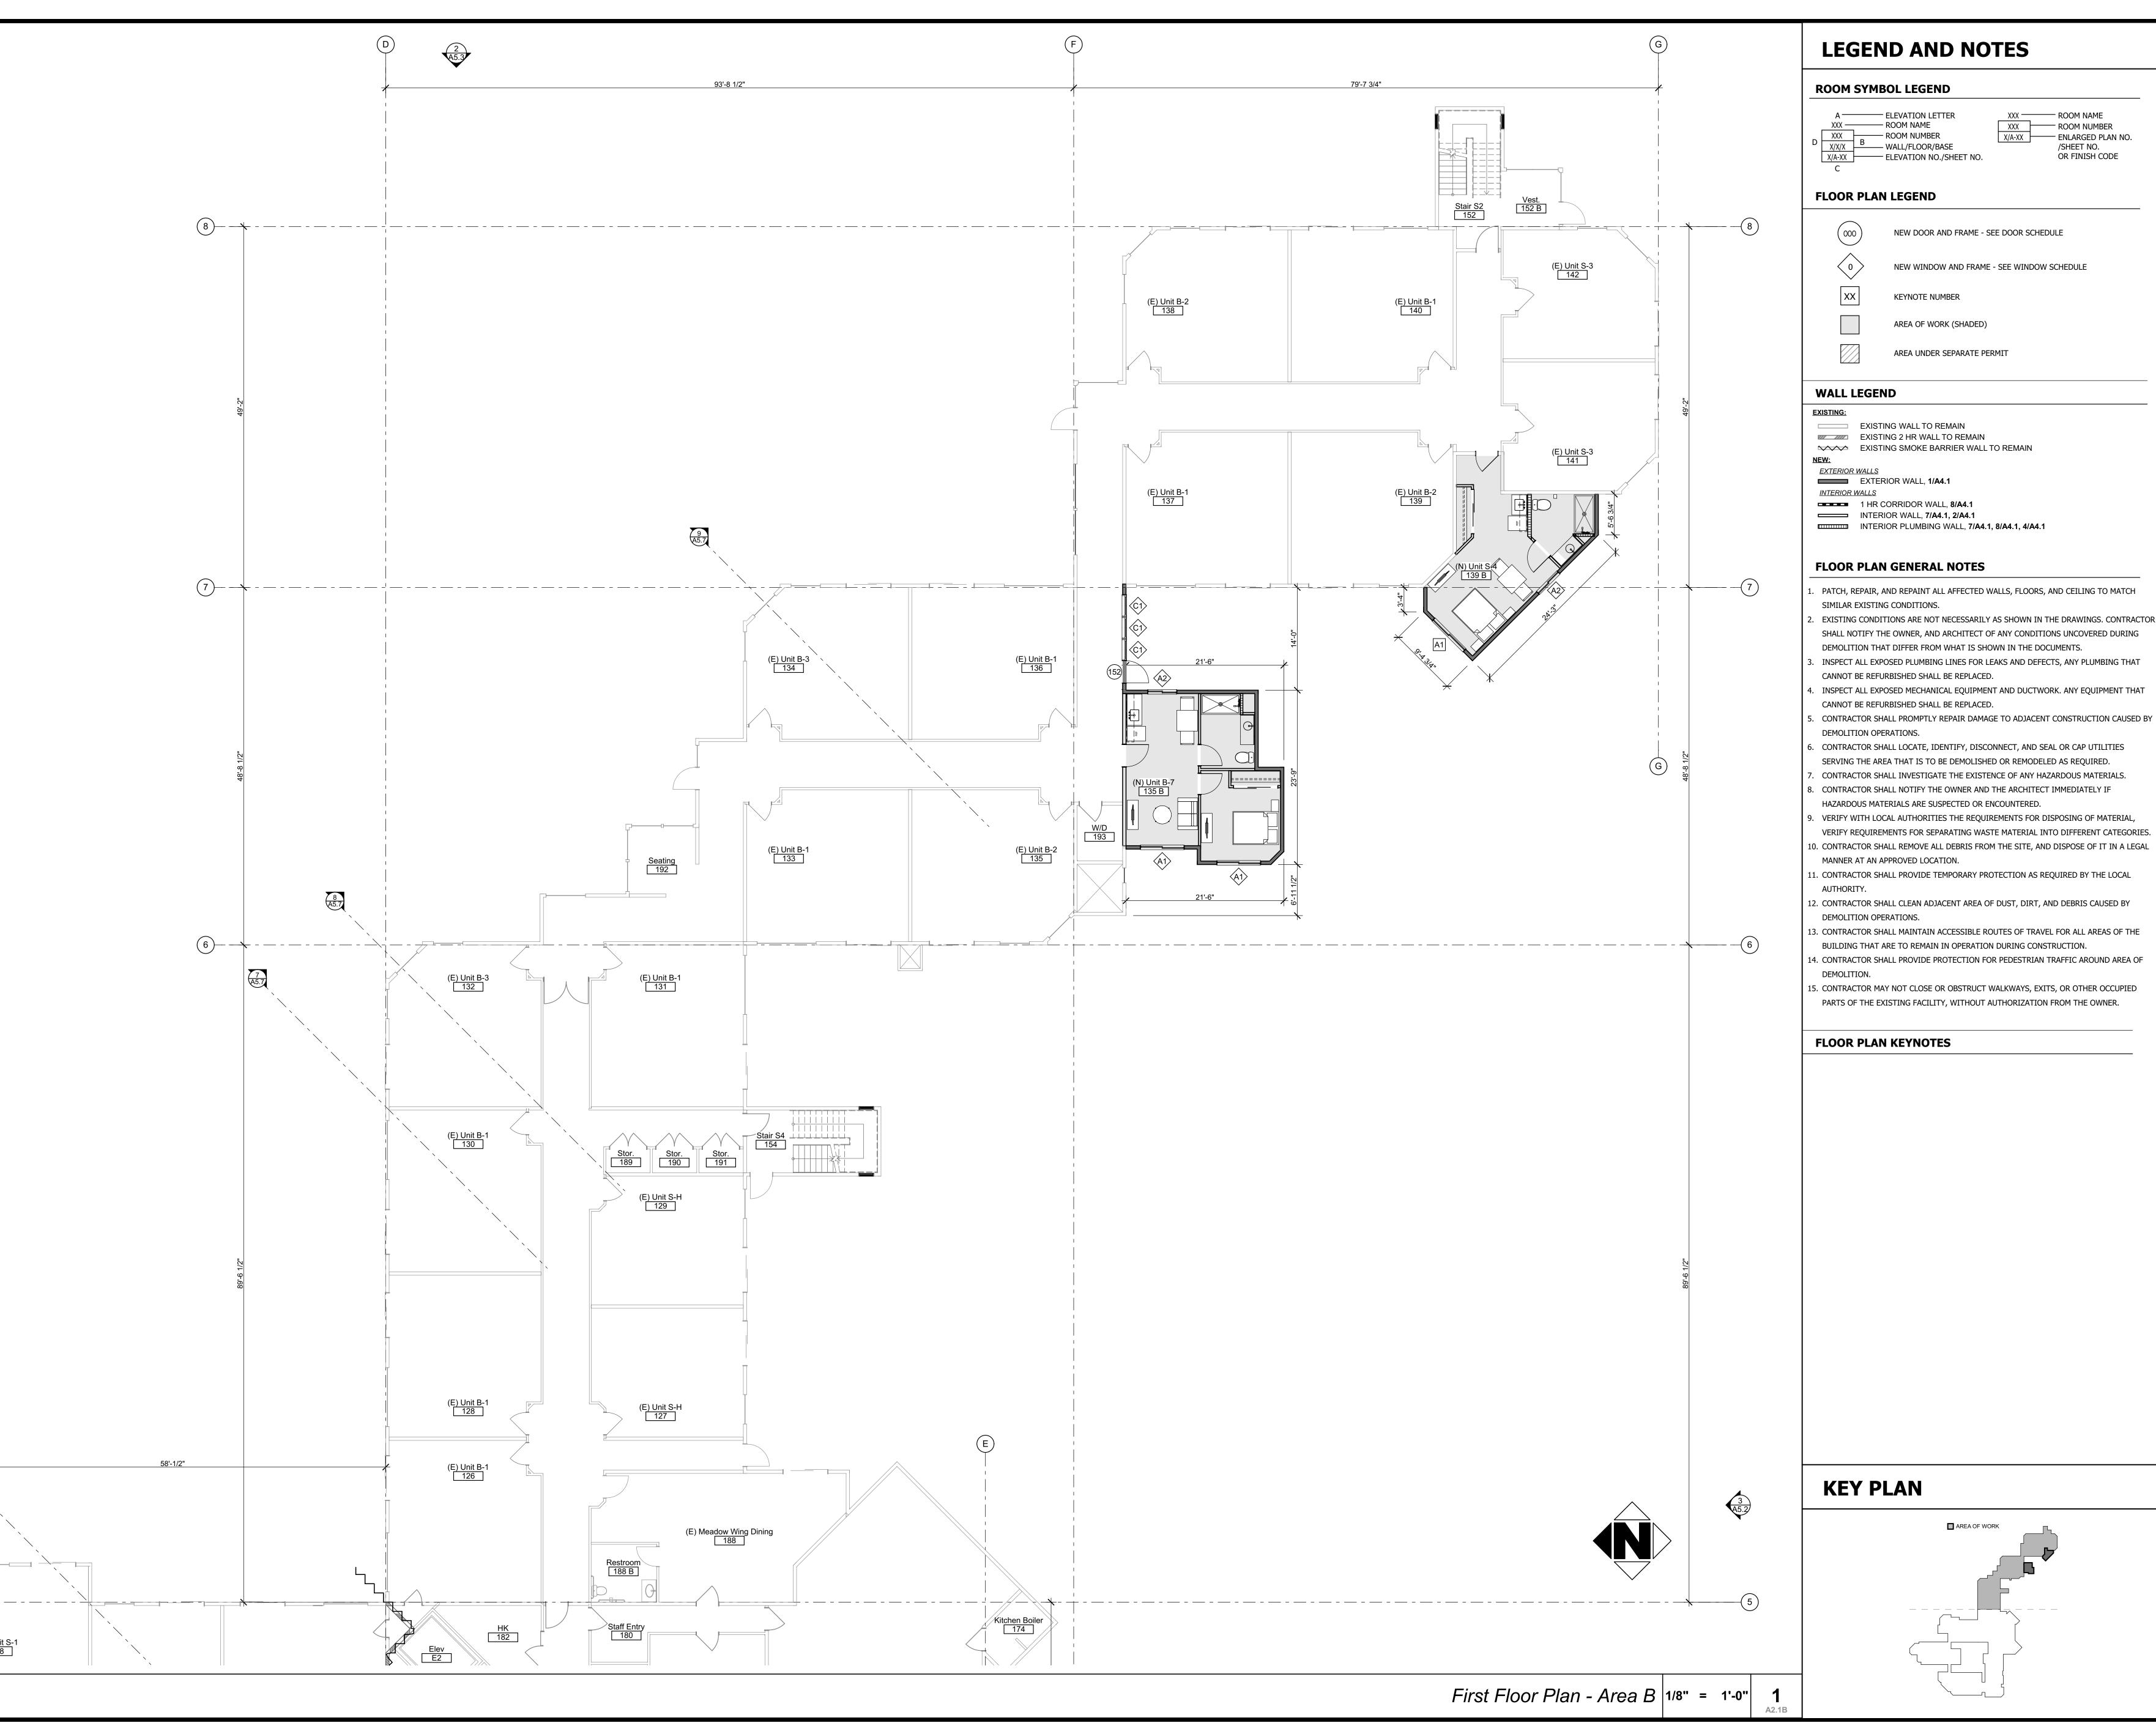

ROOM SYMBOL LEGEND

A ELEVATION LETTER XXX — ROOM NAME D XXX B ROOM NUMBER WALL/FLOOR/BASE X/A-XX ELEVATION NO./SHEET NO.

XXX ---- ROOM NAME XXX ROOM NUMBER X/A-XX ENLARGED PLAN NO. /SHEET NO. OR FINISH CODE

FLOOR PLAN LEGEND

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

KEYNOTE NUMBER

AREA OF WORK (SHADED)

AREA UNDER SEPARATE PERMIT

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN

EXTERIOR WALL, 1/A4.1

1 HR CORRIDOR WALL, 8/A4.1 ——— INTERIOR WALL, **7/A4.1, 2/A4.1**

INTERIOR PLUMBING WALL, **7/A4.1, 8/A4.1, 4/A4.1**

FLOOR PLAN GENERAL NOTES

- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS.
- SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- INSPECT ALL EXPOSED PLUMBING LINES FOR LEAKS AND DEFECTS, ANY PLUMBING THAT CANNOT BE REFURBISHED SHALL BE REPLACED. . INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT
- CANNOT BE REFURBISHED SHALL BE REPLACED. 5. CONTRACTOR SHALL PROMPTLY REPAIR DAMAGE TO ADJACENT CONSTRUCTION CAUSED BY
- DEMOLITION OPERATIONS.
- SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED.
- CONTRACTOR SHALL INVESTIGATE THE EXISTENCE OF ANY HAZARDOUS MATERIALS. CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT IMMEDIATELY IF
- HAZARDOUS MATERIALS ARE SUSPECTED OR ENCOUNTERED. . VERIFY WITH LOCAL AUTHORITIES THE REQUIREMENTS FOR DISPOSING OF MATERIAL,
- VERIFY REQUIREMENTS FOR SEPARATING WASTE MATERIAL INTO DIFFERENT CATEGORIES. 10. CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE, AND DISPOSE OF IT IN A LEGAL
- 11. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 12. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY DEMOLITION OPERATIONS.
- 13. CONTRACTOR SHALL MAINTAIN ACCESSIBLE ROUTES OF TRAVEL FOR ALL AREAS OF THE BUILDING THAT ARE TO REMAIN IN OPERATION DURING CONSTRUCTION.
- 14. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 15. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.

FLOOR PLAN KEYNOTES

IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING


245 Fischer Avenue Suite B-2 Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com

First Floor Plan Area

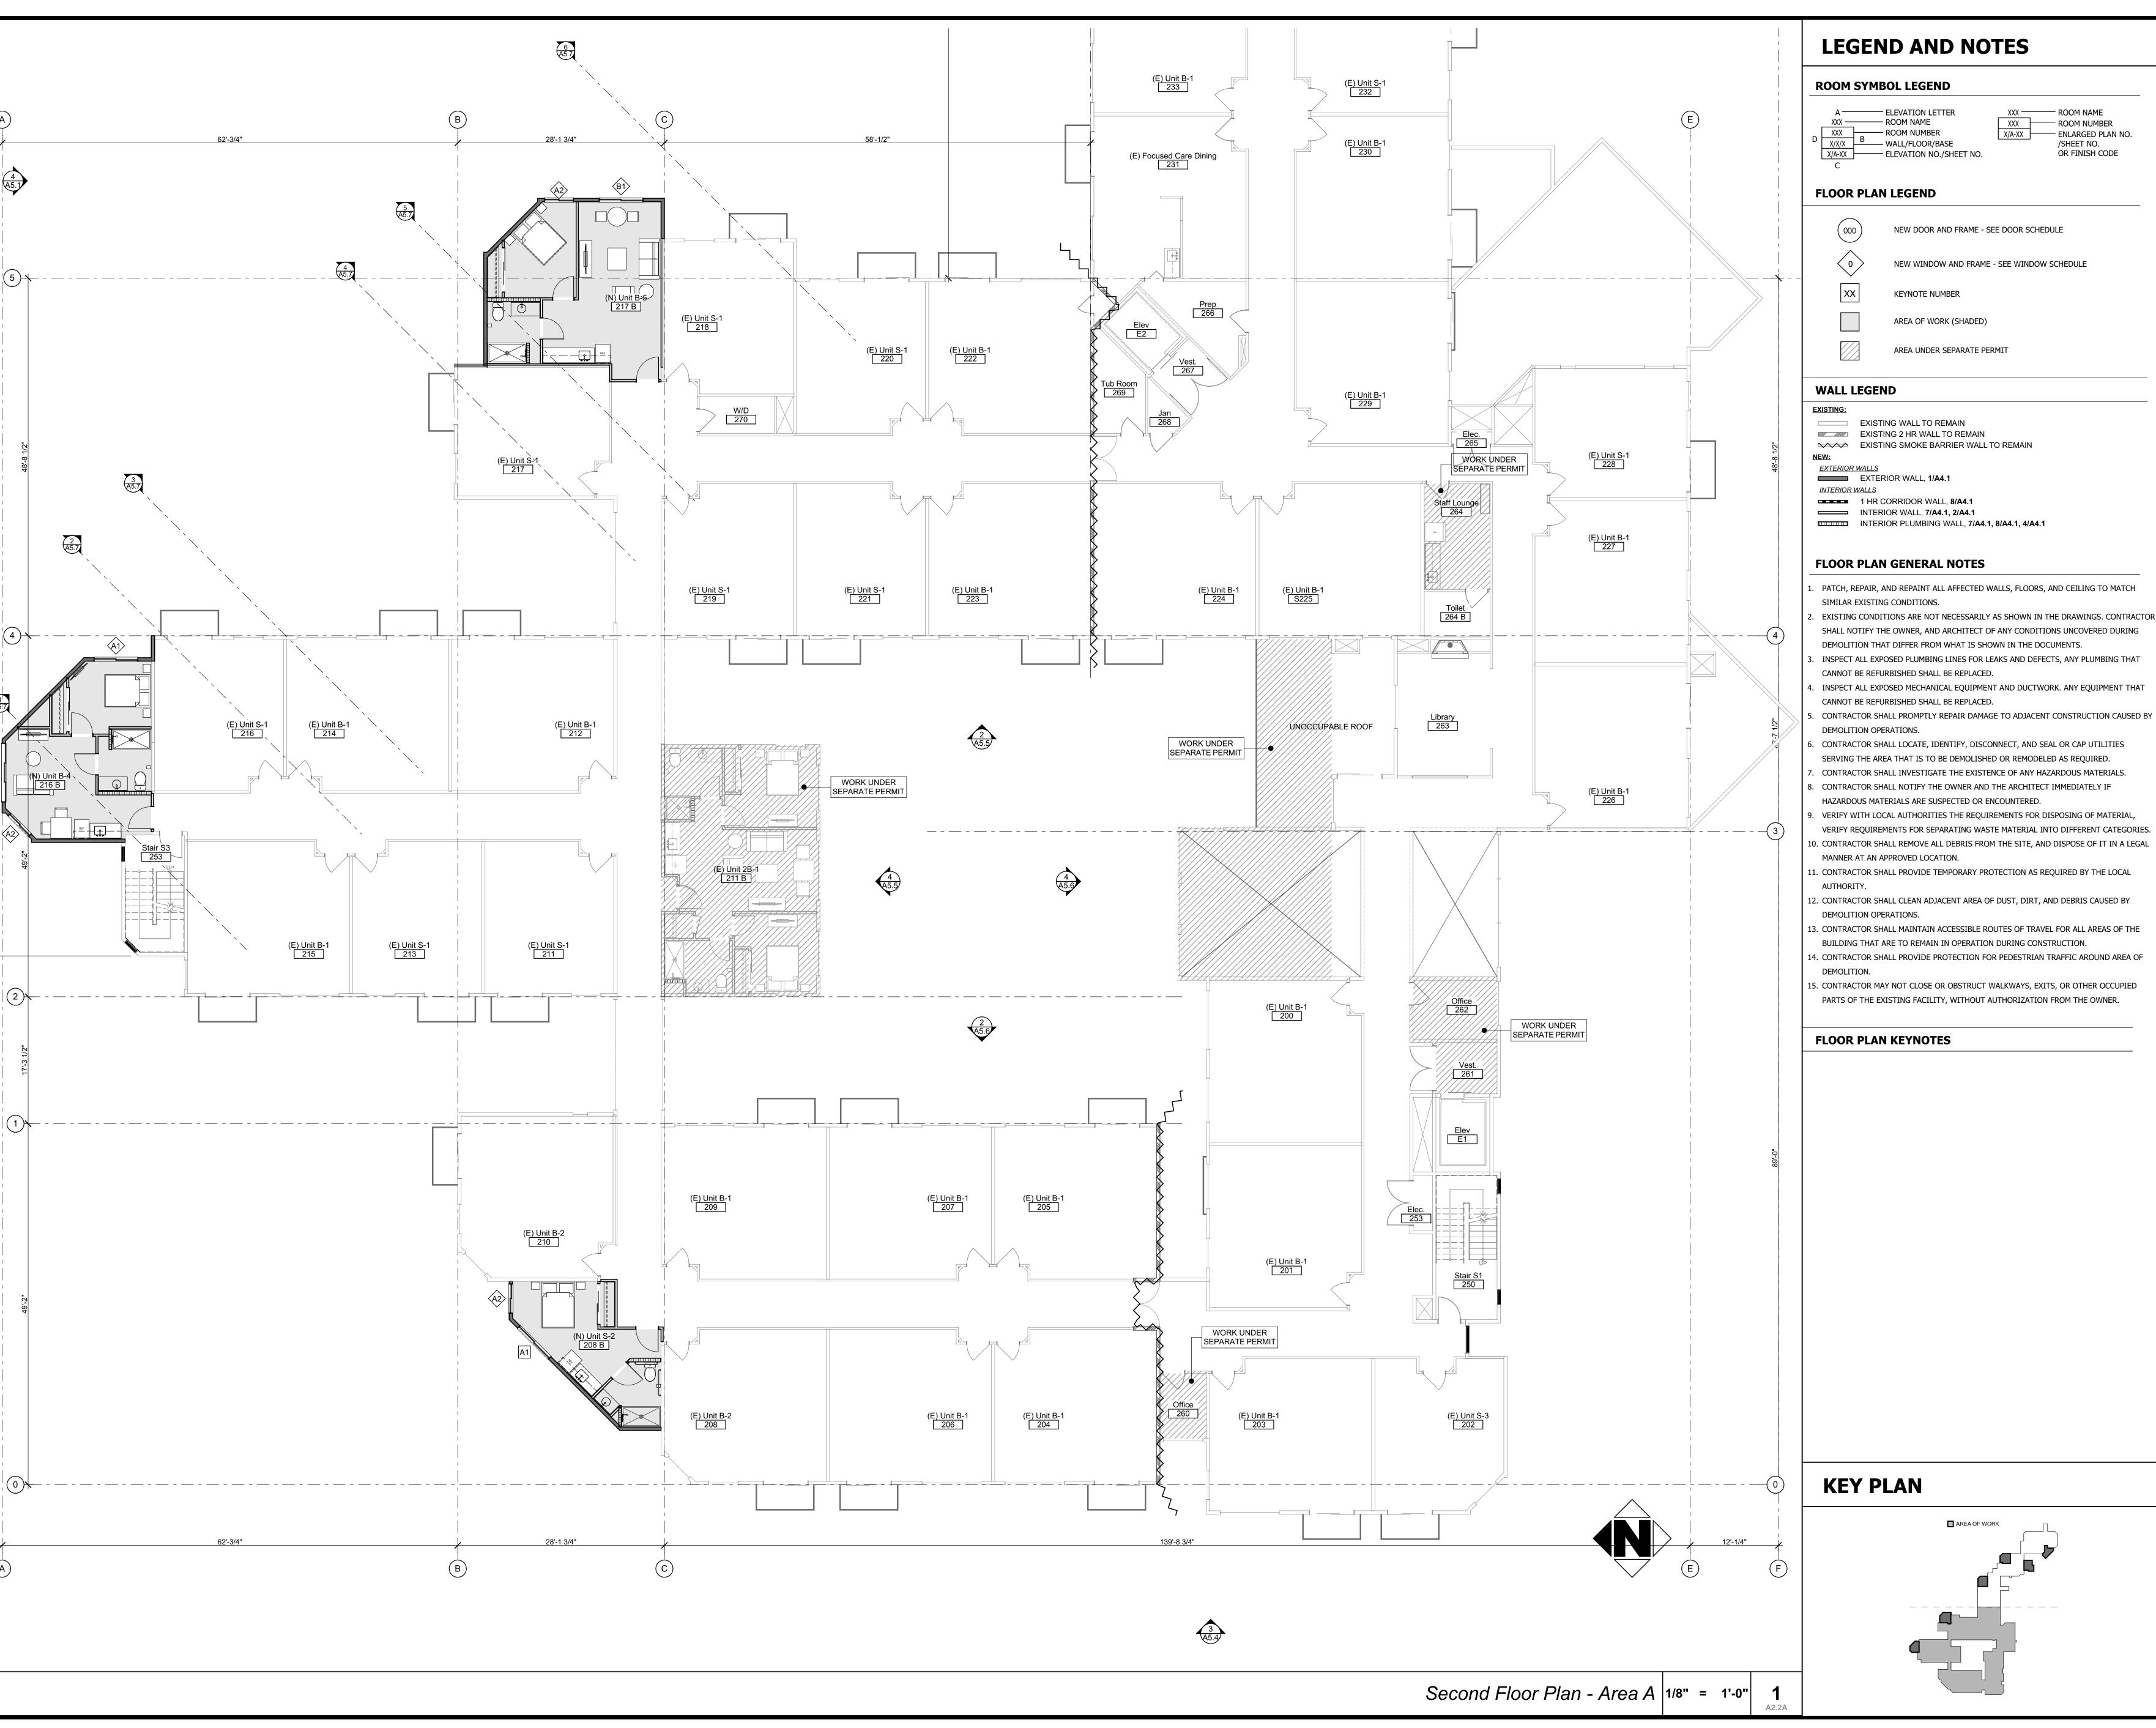

ROOM SYMBOL LEGEND

A ELEVATION LETTER XXX ---- ROOM NAME XXX ROOM NUMBER XXX — ROOM NAME X/A-XX ENLARGED PLAN NO. D XXX B ROOM NUMBER WALL/FLOOR/BASE /SHEET NO. OR FINISH CODE X/A-XX ELEVATION NO./SHEET NO.

FLOOR PLAN LEGEND

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

KEYNOTE NUMBER

AREA OF WORK (SHADED)

AREA UNDER SEPARATE PERMIT

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN

EXTERIOR WALL, 1/A4.1 **INTERIOR WALLS**

1 HR CORRIDOR WALL, 8/A4.1 ——— INTERIOR WALL, **7/A4.1, 2/A4.1** INTERIOR PLUMBING WALL, 7/A4.1, 8/A4.1, 4/A4.1

FLOOR PLAN GENERAL NOTES

- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS.
- SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- CANNOT BE REFURBISHED SHALL BE REPLACED. . INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT
- CANNOT BE REFURBISHED SHALL BE REPLACED.
- . CONTRACTOR SHALL PROMPTLY REPAIR DAMAGE TO ADJACENT CONSTRUCTION CAUSED BY
- CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES
- SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED. CONTRACTOR SHALL INVESTIGATE THE EXISTENCE OF ANY HAZARDOUS MATERIALS.
- CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT IMMEDIATELY IF
- HAZARDOUS MATERIALS ARE SUSPECTED OR ENCOUNTERED.
- . VERIFY WITH LOCAL AUTHORITIES THE REQUIREMENTS FOR DISPOSING OF MATERIAL, VERIFY REQUIREMENTS FOR SEPARATING WASTE MATERIAL INTO DIFFERENT CATEGORIES.
- MANNER AT AN APPROVED LOCATION. 11. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 12. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY DEMOLITION OPERATIONS.
- 13. CONTRACTOR SHALL MAINTAIN ACCESSIBLE ROUTES OF TRAVEL FOR ALL AREAS OF THE BUILDING THAT ARE TO REMAIN IN OPERATION DURING CONSTRUCTION.
- 14. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 15. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.

FLOOR PLAN KEYNOTES

IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING

245 Fischer Avenue Suite B-2 Costa Mesa


California 92626

T: 714 557 2448

www.ipaoc.com





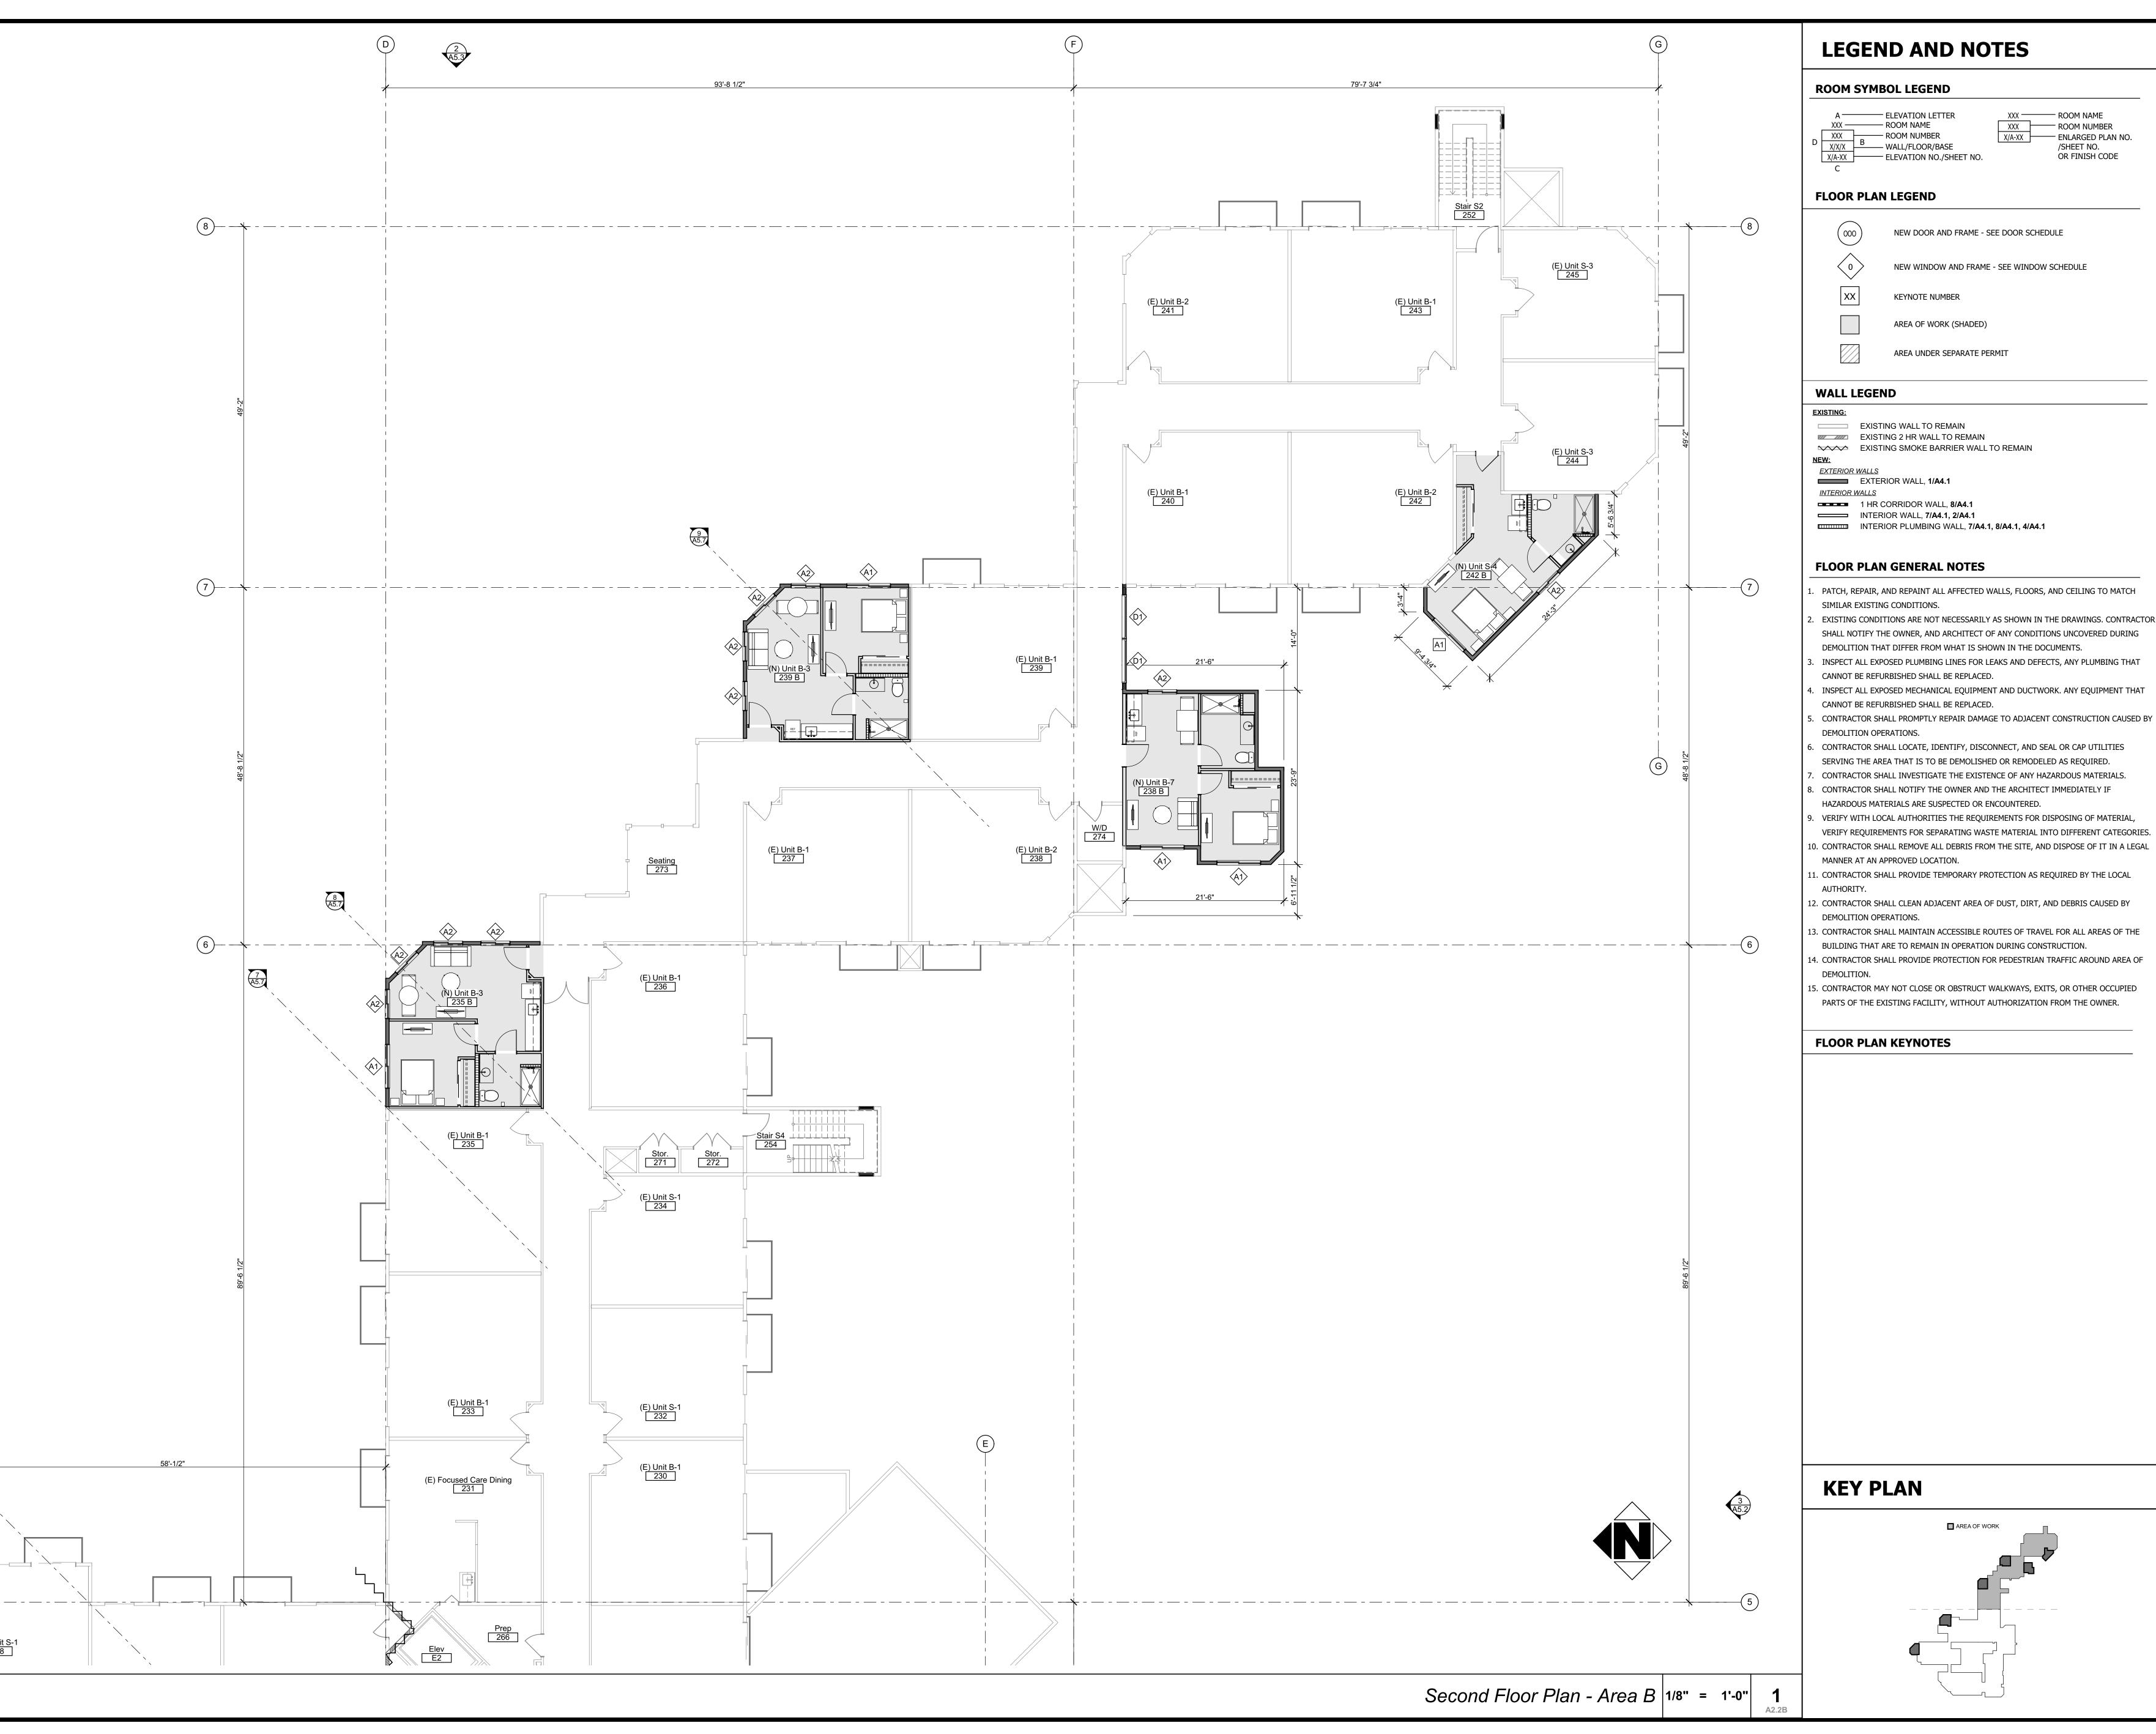

ROOM SYMBOL LEGEND

A ELEVATION LETTER XXX — ROOM NAME D XXX B ROOM NUMBER WALL/FLOOR/BASE X/A-XX ELEVATION NO./SHEET NO.

XXX ---- ROOM NAME XXX ROOM NUMBER X/A-XX ENLARGED PLAN NO. /SHEET NO. OR FINISH CODE

FLOOR PLAN LEGEND

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

AREA OF WORK (SHADED)

KEYNOTE NUMBER

AREA UNDER SEPARATE PERMIT

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN

EXTERIOR WALL, 1/A4.1

1 HR CORRIDOR WALL, 8/A4.1 ——— INTERIOR WALL, **7/A4.1, 2/A4.1** INTERIOR PLUMBING WALL, **7/A4.1**, **8/A4.1**, **4/A4.1**

FLOOR PLAN GENERAL NOTES

- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS.
- SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- INSPECT ALL EXPOSED PLUMBING LINES FOR LEAKS AND DEFECTS, ANY PLUMBING THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- . INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- 5. CONTRACTOR SHALL PROMPTLY REPAIR DAMAGE TO ADJACENT CONSTRUCTION CAUSED BY
- . CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES
- SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED. CONTRACTOR SHALL INVESTIGATE THE EXISTENCE OF ANY HAZARDOUS MATERIALS.
- CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT IMMEDIATELY IF HAZARDOUS MATERIALS ARE SUSPECTED OR ENCOUNTERED.
- . VERIFY WITH LOCAL AUTHORITIES THE REQUIREMENTS FOR DISPOSING OF MATERIAL, VERIFY REQUIREMENTS FOR SEPARATING WASTE MATERIAL INTO DIFFERENT CATEGORIES.
- 10. CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE, AND DISPOSE OF IT IN A LEGAL MANNER AT AN APPROVED LOCATION.
- 11. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 12. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY DEMOLITION OPERATIONS.
- BUILDING THAT ARE TO REMAIN IN OPERATION DURING CONSTRUCTION.
- 14. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 15. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.


FLOOR PLAN KEYNOTES


IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING 245 Fischer Avenue


Suite B-2 Costa Mesa California 92626

T: 714 557 2448

www.ipaoc.com



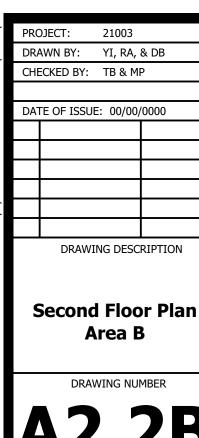

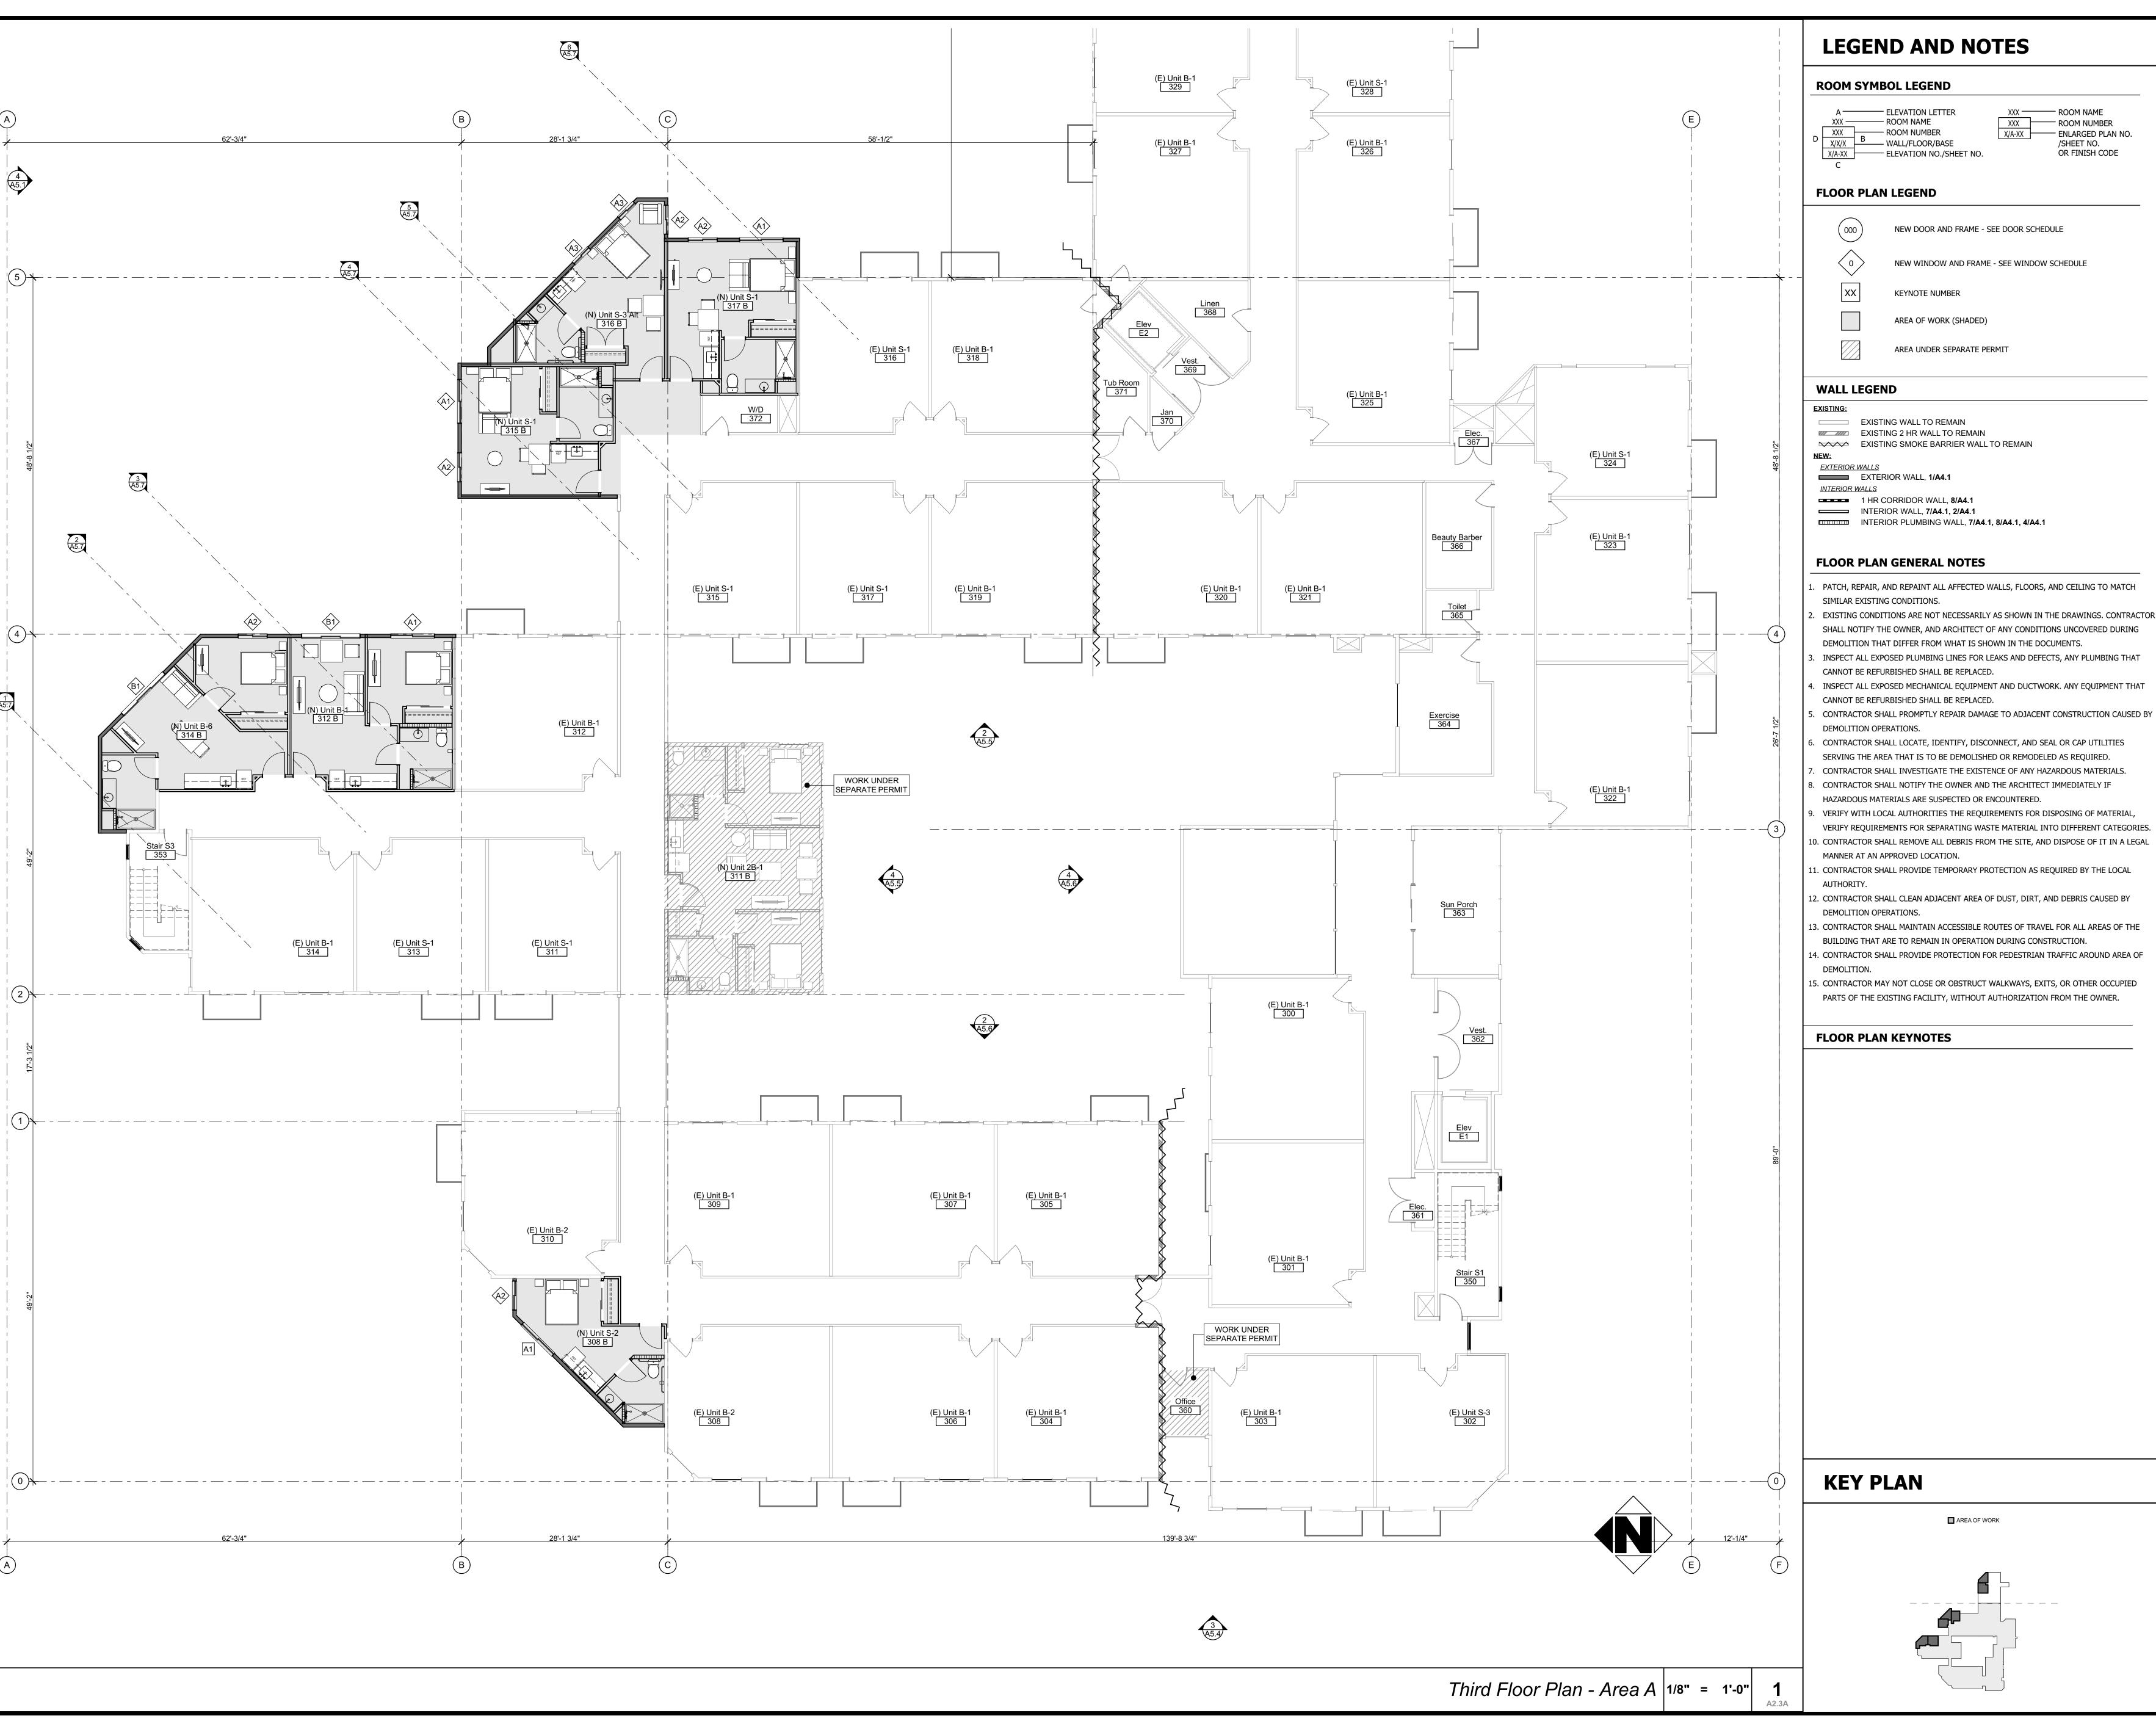

ROOM SYMBOL LEGEND

A ELEVATION LETTER XXX ROOM NUMBER XXX — ROOM NAME X/A-XX ENLARGED PLAN NO. XXX ROOM NUMBER B WALL/FLOOR/BASE /SHEET NO. OR FINISH CODE X/A-XX ELEVATION NO./SHEET NO.

FLOOR PLAN LEGEND

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

KEYNOTE NUMBER

AREA OF WORK (SHADED)

AREA UNDER SEPARATE PERMIT

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN

EXTERIOR WALL, 1/A4.1

——— INTERIOR WALL, **7/A4.1, 2/A4.1** INTERIOR PLUMBING WALL, 7/A4.1, 8/A4.1, 4/A4.1


FLOOR PLAN GENERAL NOTES


- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS.
- SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- INSPECT ALL EXPOSED PLUMBING LINES FOR LEAKS AND DEFECTS, ANY PLUMBING THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- . INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- . CONTRACTOR SHALL PROMPTLY REPAIR DAMAGE TO ADJACENT CONSTRUCTION CAUSED BY
- . CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES
- SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED.
- CONTRACTOR SHALL INVESTIGATE THE EXISTENCE OF ANY HAZARDOUS MATERIALS. 8. CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT IMMEDIATELY IF
- HAZARDOUS MATERIALS ARE SUSPECTED OR ENCOUNTERED.
- 9. VERIFY WITH LOCAL AUTHORITIES THE REQUIREMENTS FOR DISPOSING OF MATERIAL, VERIFY REQUIREMENTS FOR SEPARATING WASTE MATERIAL INTO DIFFERENT CATEGORIES.
- 10. CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE, AND DISPOSE OF IT IN A LEGAL MANNER AT AN APPROVED LOCATION.
- 11. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 12. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY DEMOLITION OPERATIONS.
- 13. CONTRACTOR SHALL MAINTAIN ACCESSIBLE ROUTES OF TRAVEL FOR ALL AREAS OF THE
- 14. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 15. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED
- PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.


FLOOR PLAN KEYNOTES



245 Fischer Avenue Suite B-2 Costa Mesa California 92626 T: 714 557 2448 www.ipaoc.com



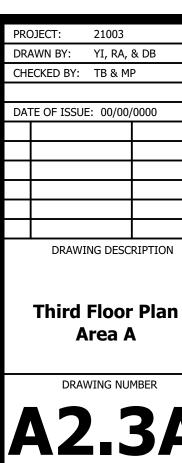

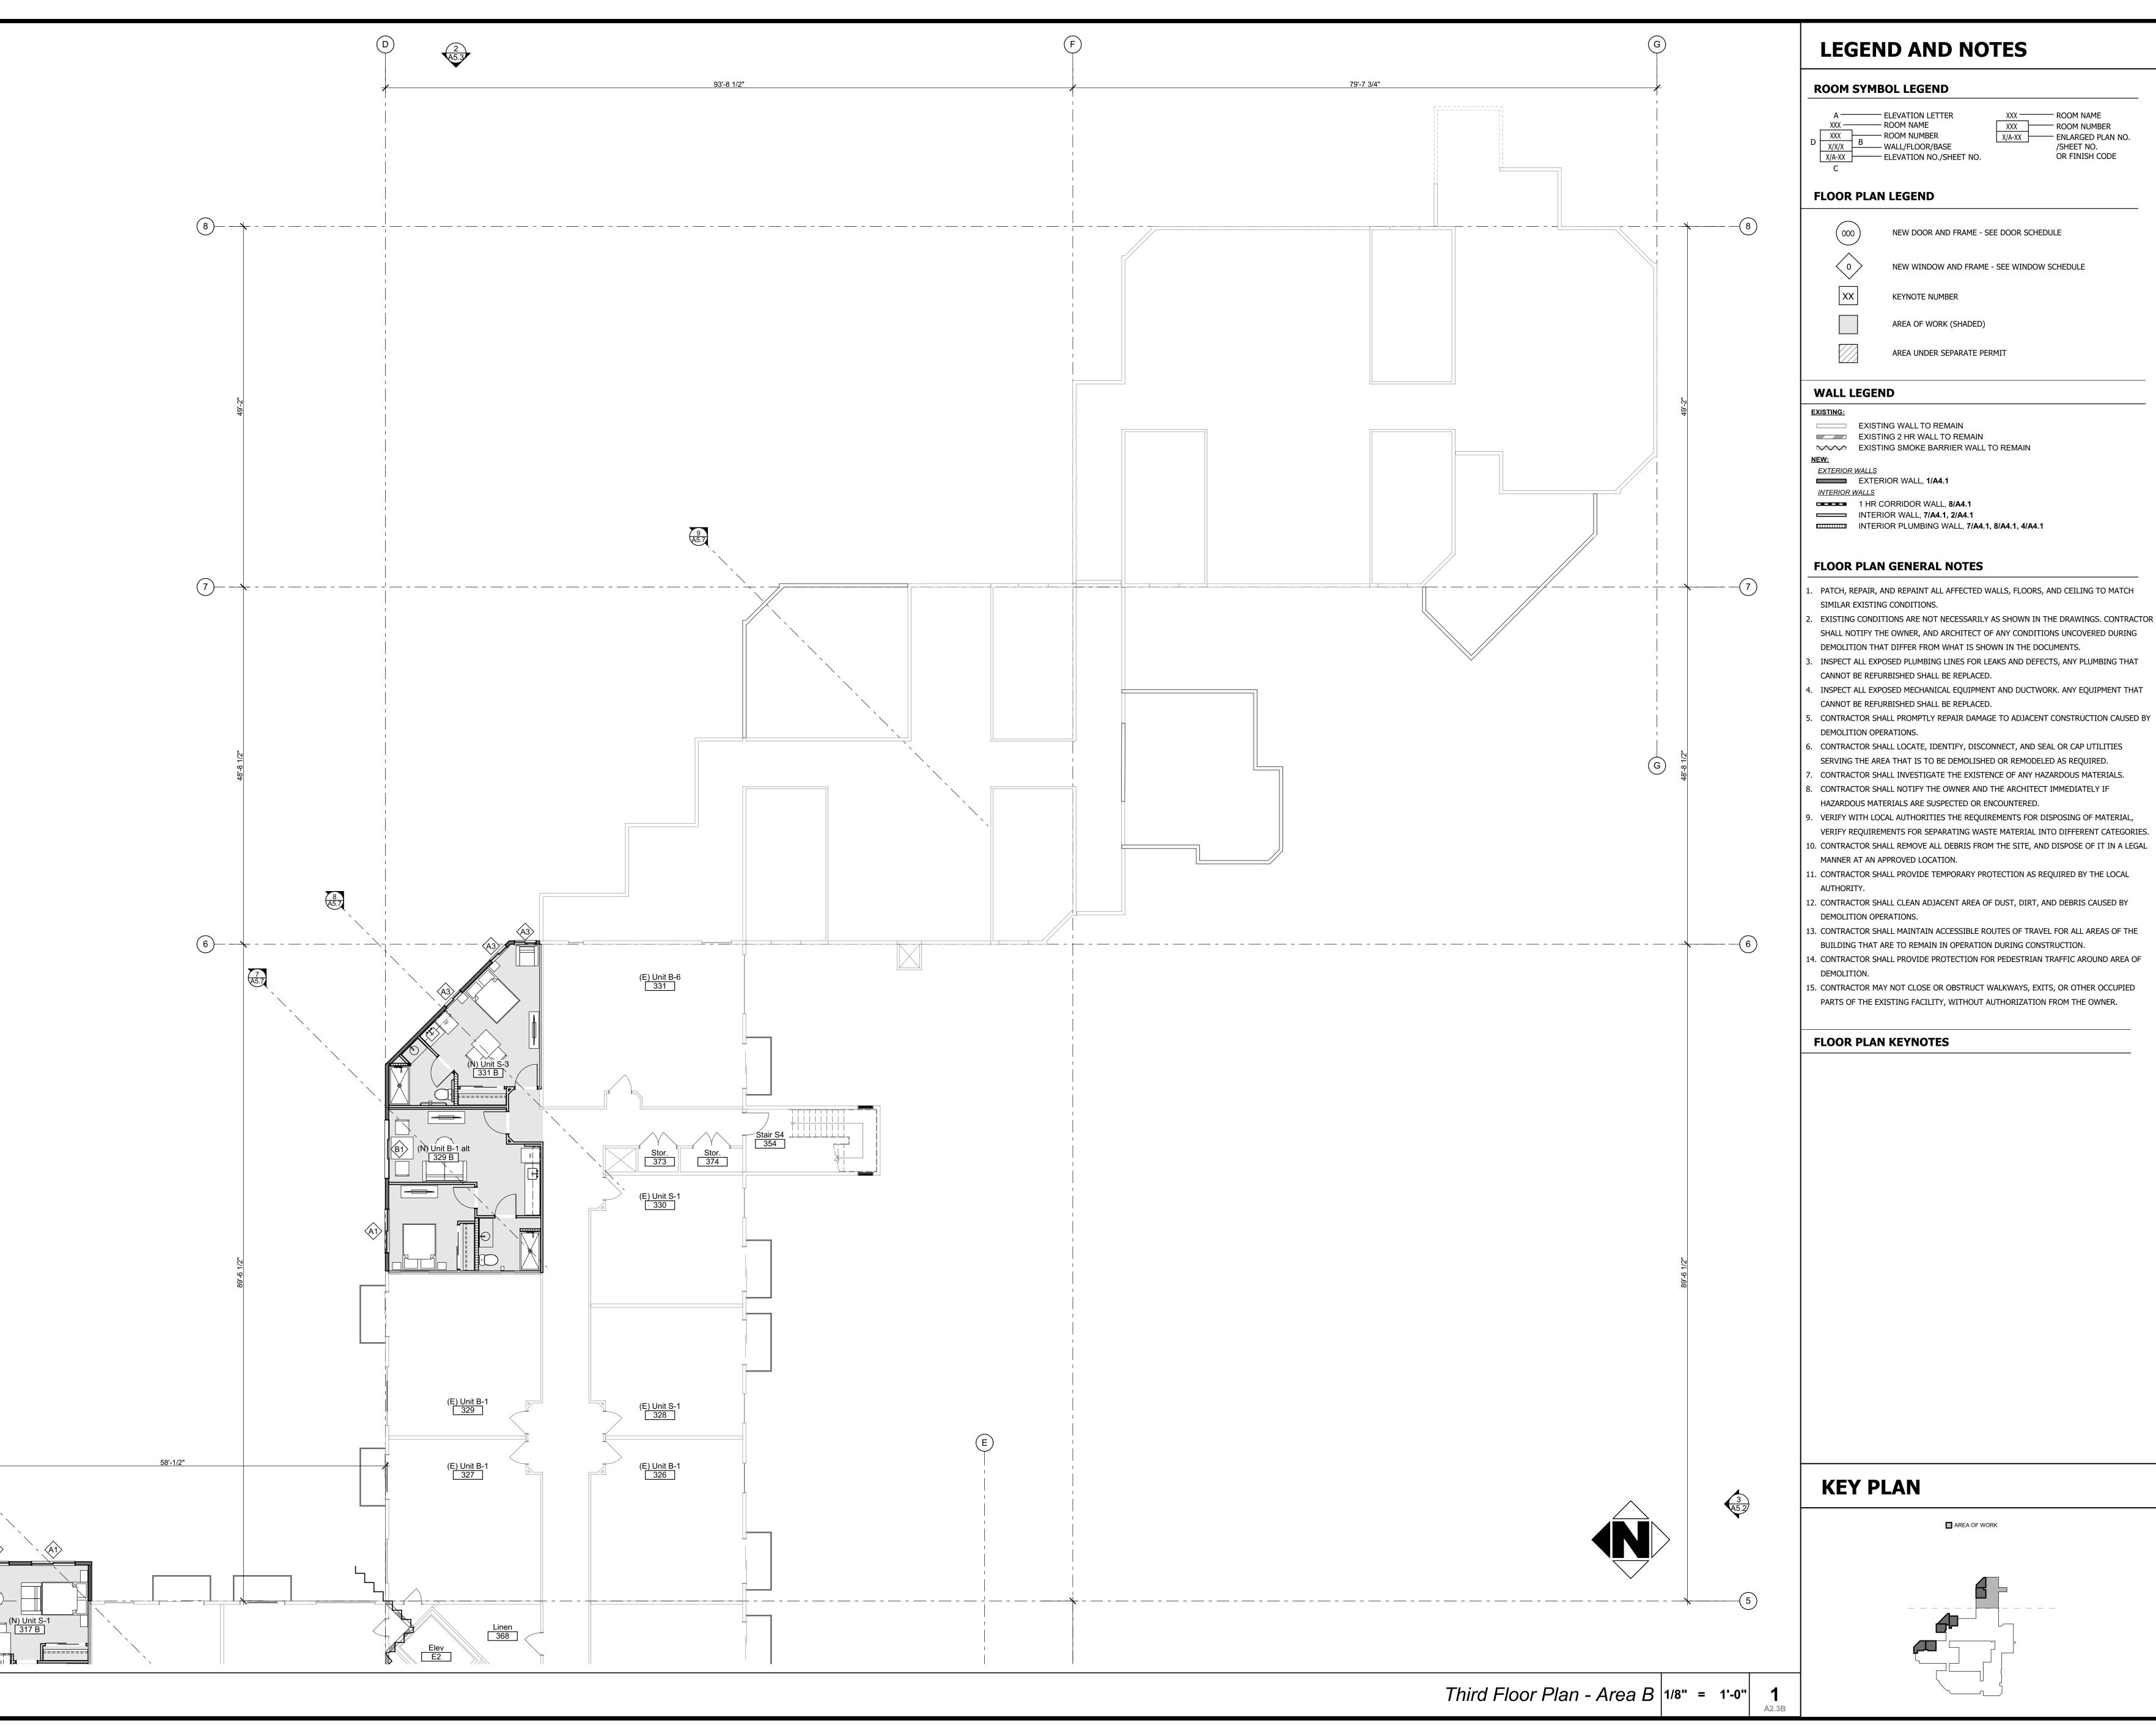

ROOM SYMBOL LEGEND

A ELEVATION LETTER XXX — ROOM NAME D XXX B ROOM NUMBER

B WALL/FLOOR/BASE X/A-XX ELEVATION NO./SHEET NO.

XXX ---- ROOM NAME XXX ROOM NUMBER

X/A-XX ENLARGED PLAN NO. /SHEET NO. OR FINISH CODE

FLOOR PLAN LEGEND

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

KEYNOTE NUMBER

AREA UNDER SEPARATE PERMIT

AREA OF WORK (SHADED)

WALL LEGEND

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN EXISTING SMOKE BARRIER WALL TO REMAIN

EXTERIOR WALLS EXTERIOR WALL, 1/A4.1 **INTERIOR WALLS**

——— INTERIOR WALL, **7/A4.1, 2/A4.1**

INTERIOR PLUMBING WALL, **7/A4.1**, **8/A4.1**, **4/A4.1**

FLOOR PLAN GENERAL NOTES

- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS.
 - SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- INSPECT ALL EXPOSED PLUMBING LINES FOR LEAKS AND DEFECTS, ANY PLUMBING THAT CANNOT BE REFURBISHED SHALL BE REPLACED. . INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT
- CANNOT BE REFURBISHED SHALL BE REPLACED.
- 5. CONTRACTOR SHALL PROMPTLY REPAIR DAMAGE TO ADJACENT CONSTRUCTION CAUSED BY
- . CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES
- SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED. CONTRACTOR SHALL INVESTIGATE THE EXISTENCE OF ANY HAZARDOUS MATERIALS.
- CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT IMMEDIATELY IF
- HAZARDOUS MATERIALS ARE SUSPECTED OR ENCOUNTERED. . VERIFY WITH LOCAL AUTHORITIES THE REQUIREMENTS FOR DISPOSING OF MATERIAL,
- VERIFY REQUIREMENTS FOR SEPARATING WASTE MATERIAL INTO DIFFERENT CATEGORIES. 10. CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE, AND DISPOSE OF IT IN A LEGAL
- MANNER AT AN APPROVED LOCATION. 11. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 12. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY
- DEMOLITION OPERATIONS. 13. CONTRACTOR SHALL MAINTAIN ACCESSIBLE ROUTES OF TRAVEL FOR ALL AREAS OF THE
- BUILDING THAT ARE TO REMAIN IN OPERATION DURING CONSTRUCTION. 14. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 15. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED
- PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.

AREA OF WORK

FLOOR PLAN KEYNOTES

IRWIN PARTNERS

ARCHITECT

ARCHITECTURE PLANNING


CONSULTING 245 Fischer Avenue


Suite B-2 Costa Mesa

California 92626 T: 714 557 2448

www.ipaoc.com



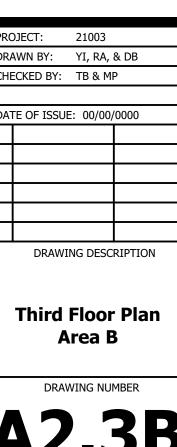

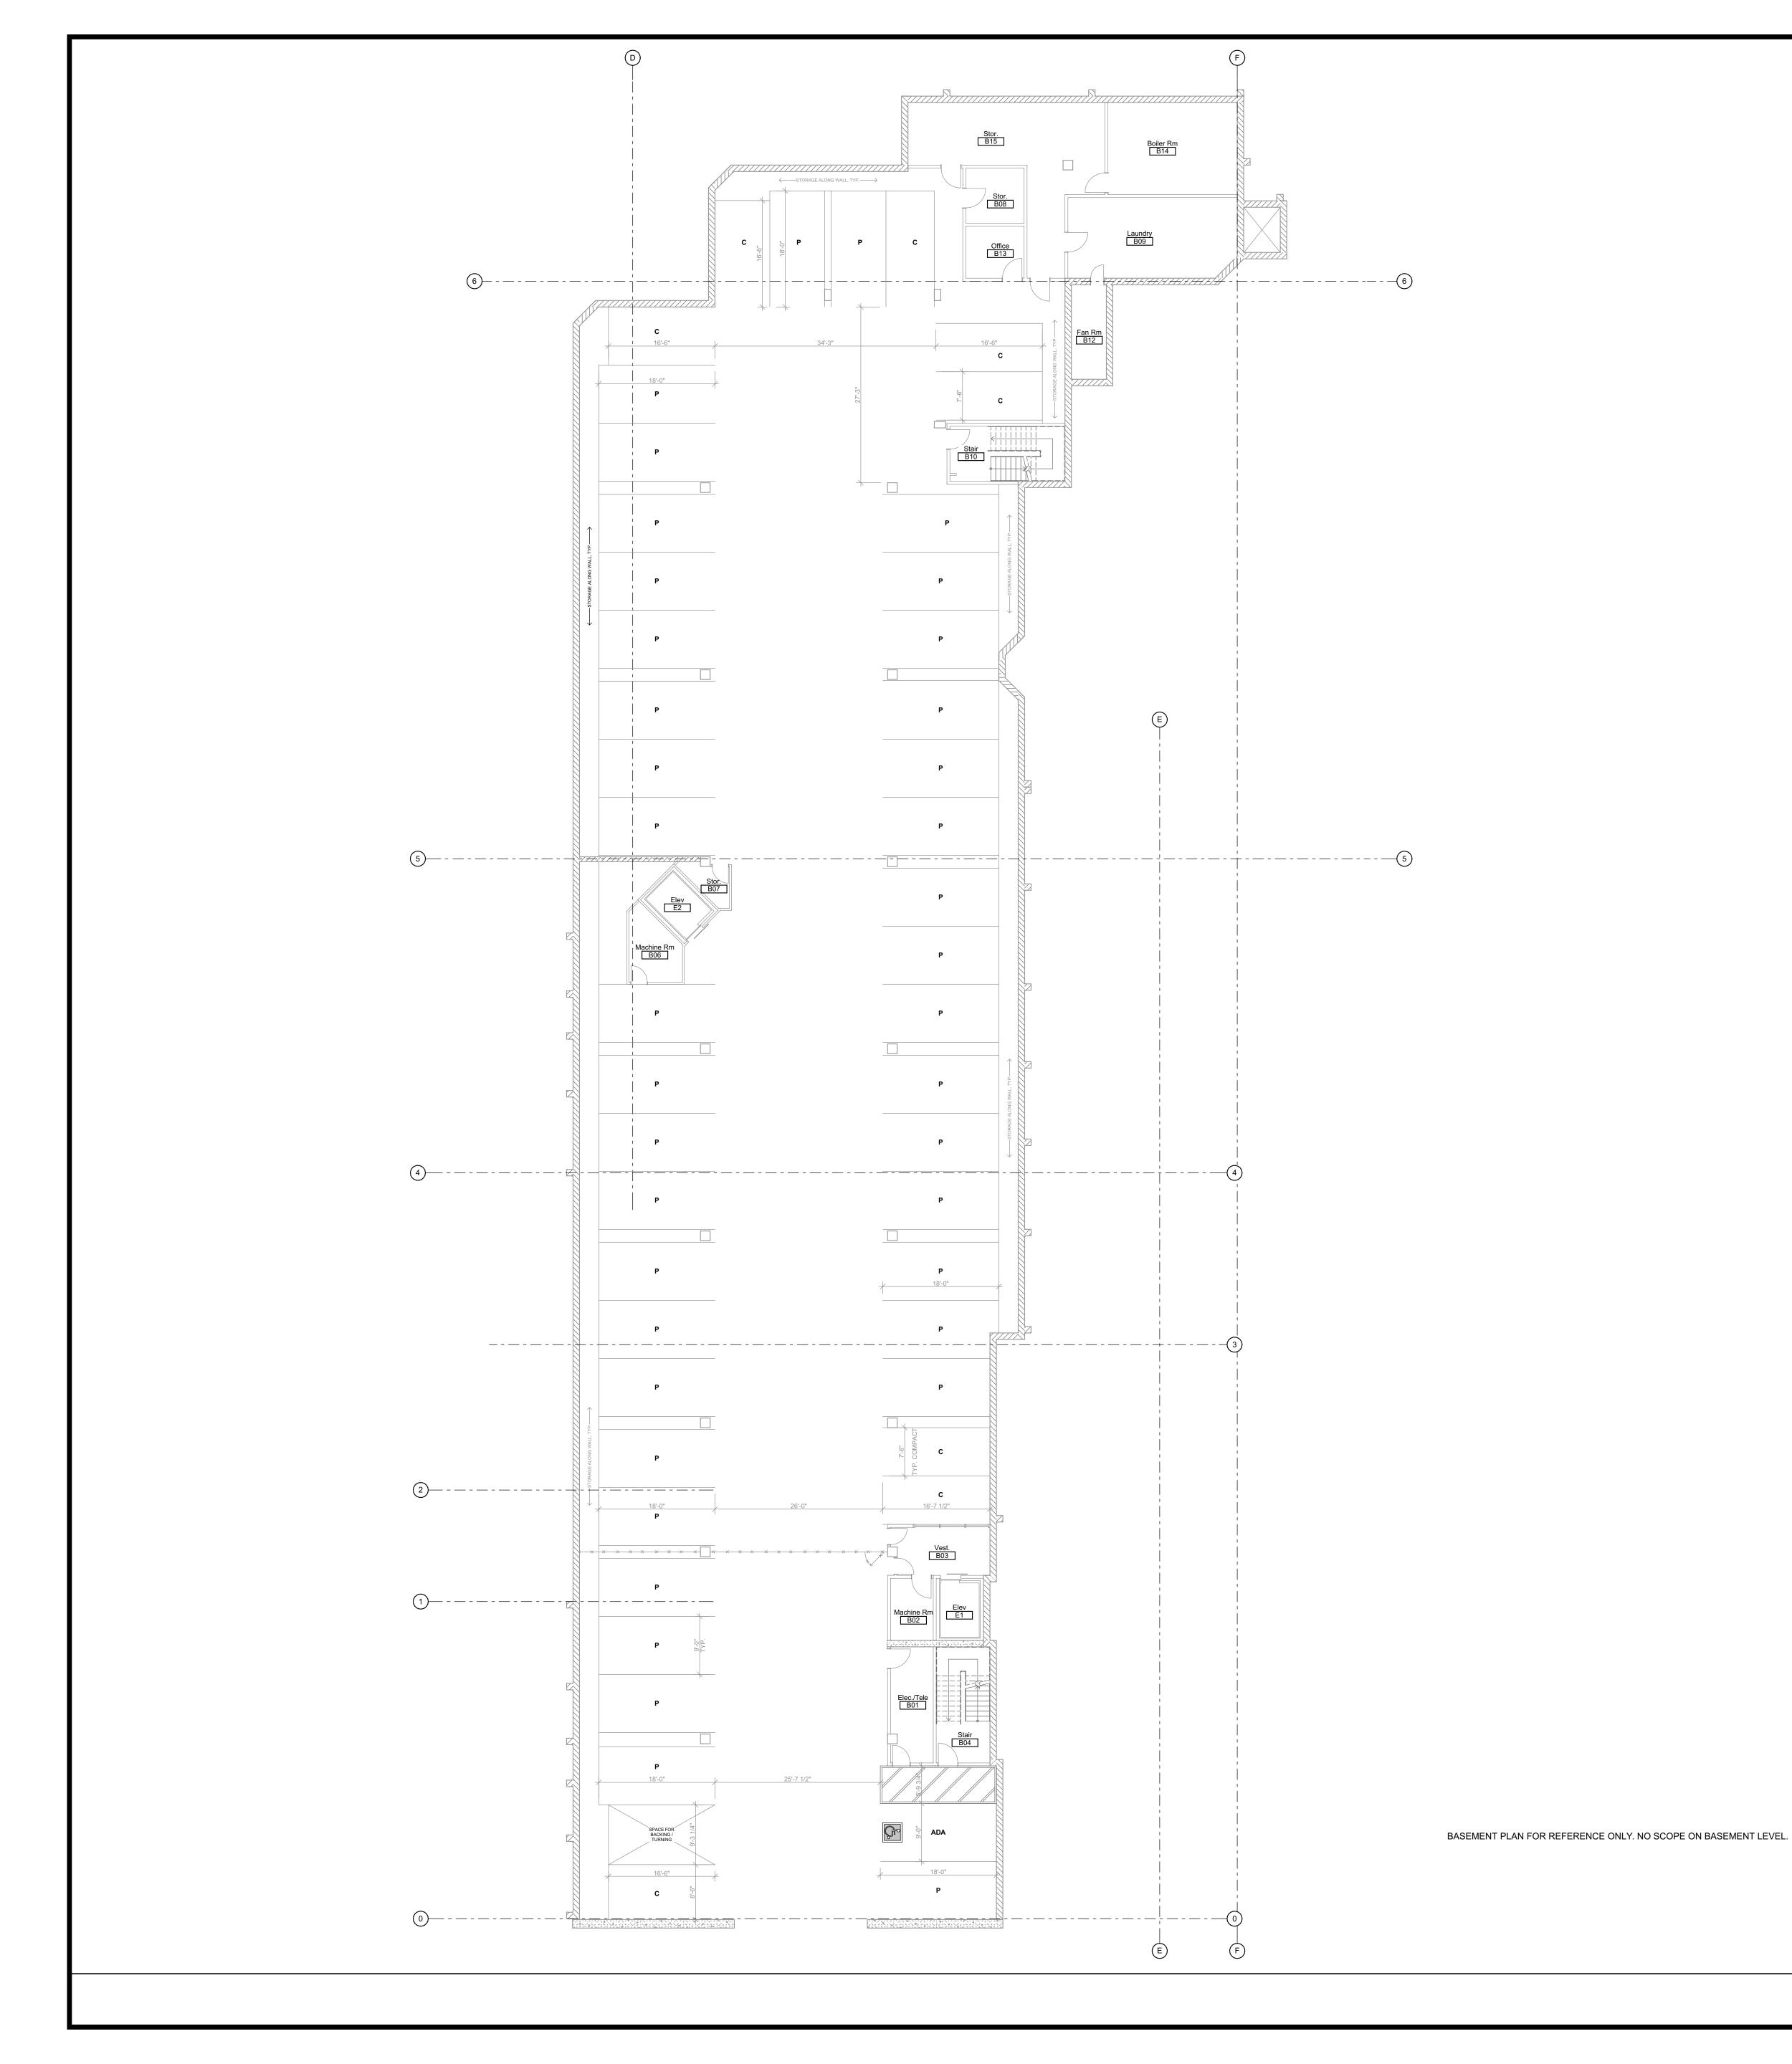



ROOM SYMBOL LEGEND

A ELEVATION LETTER XXX — ROOM NAME D XXX B ROOM NUMBER

B WALL/FLOOR/BASE X/A-XX ELEVATION NO./SHEET NO.

XXX ---- ROOM NAME XXX ROOM NUMBER

X/A-XX ENLARGED PLAN NO. /SHEET NO. OR FINISH CODE

FLOOR PLAN LEGEND

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

KEYNOTE NUMBER

AREA UNDER SEPARATE PERMIT

AREA OF WORK (SHADED)

WALL LEGEND

EXISTING:

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN EXISTING SMOKE BARRIER WALL TO REMAIN

EXTERIOR WALLS EXTERIOR WALL, 1/A4.1 **INTERIOR WALLS** 1 HR CORRIDOR WALL, 8/A4.1

——— INTERIOR WALL, **7/A4.1, 2/A4.1** INTERIOR PLUMBING WALL, **7/A4.1, 8/A4.1, 4/A4.1**

FLOOR PLAN GENERAL NOTES

- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS. EXISTING CONDITIONS ARE NOT NECESSARILY AS SHOWN IN THE DRAWINGS. CONTRACTOR
- SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- INSPECT ALL EXPOSED PLUMBING LINES FOR LEAKS AND DEFECTS, ANY PLUMBING THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- . INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- 5. CONTRACTOR SHALL PROMPTLY REPAIR DAMAGE TO ADJACENT CONSTRUCTION CAUSED BY DEMOLITION OPERATIONS.
- . CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES
- SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED. CONTRACTOR SHALL INVESTIGATE THE EXISTENCE OF ANY HAZARDOUS MATERIALS.
- CONTRACTOR SHALL NOTIFY THE OWNER AND THE ARCHITECT IMMEDIATELY IF
- HAZARDOUS MATERIALS ARE SUSPECTED OR ENCOUNTERED. . VERIFY WITH LOCAL AUTHORITIES THE REQUIREMENTS FOR DISPOSING OF MATERIAL,
- VERIFY REQUIREMENTS FOR SEPARATING WASTE MATERIAL INTO DIFFERENT CATEGORIES. 10. CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE, AND DISPOSE OF IT IN A LEGAL MANNER AT AN APPROVED LOCATION.
- 11. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 12. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY DEMOLITION OPERATIONS.
- 13. CONTRACTOR SHALL MAINTAIN ACCESSIBLE ROUTES OF TRAVEL FOR ALL AREAS OF THE BUILDING THAT ARE TO REMAIN IN OPERATION DURING CONSTRUCTION.
- 14. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 15. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.

FLOOR PLAN KEYNOTES

IRWIN PARTNERS

ARCHITECTURE

PLANNING

CONSULTING

245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com


ARCHITECT

KEY PLAN

DRAWING DESCRIPTION

Basement Floor Plan

Basement Plan |3/32" = 1'-0"

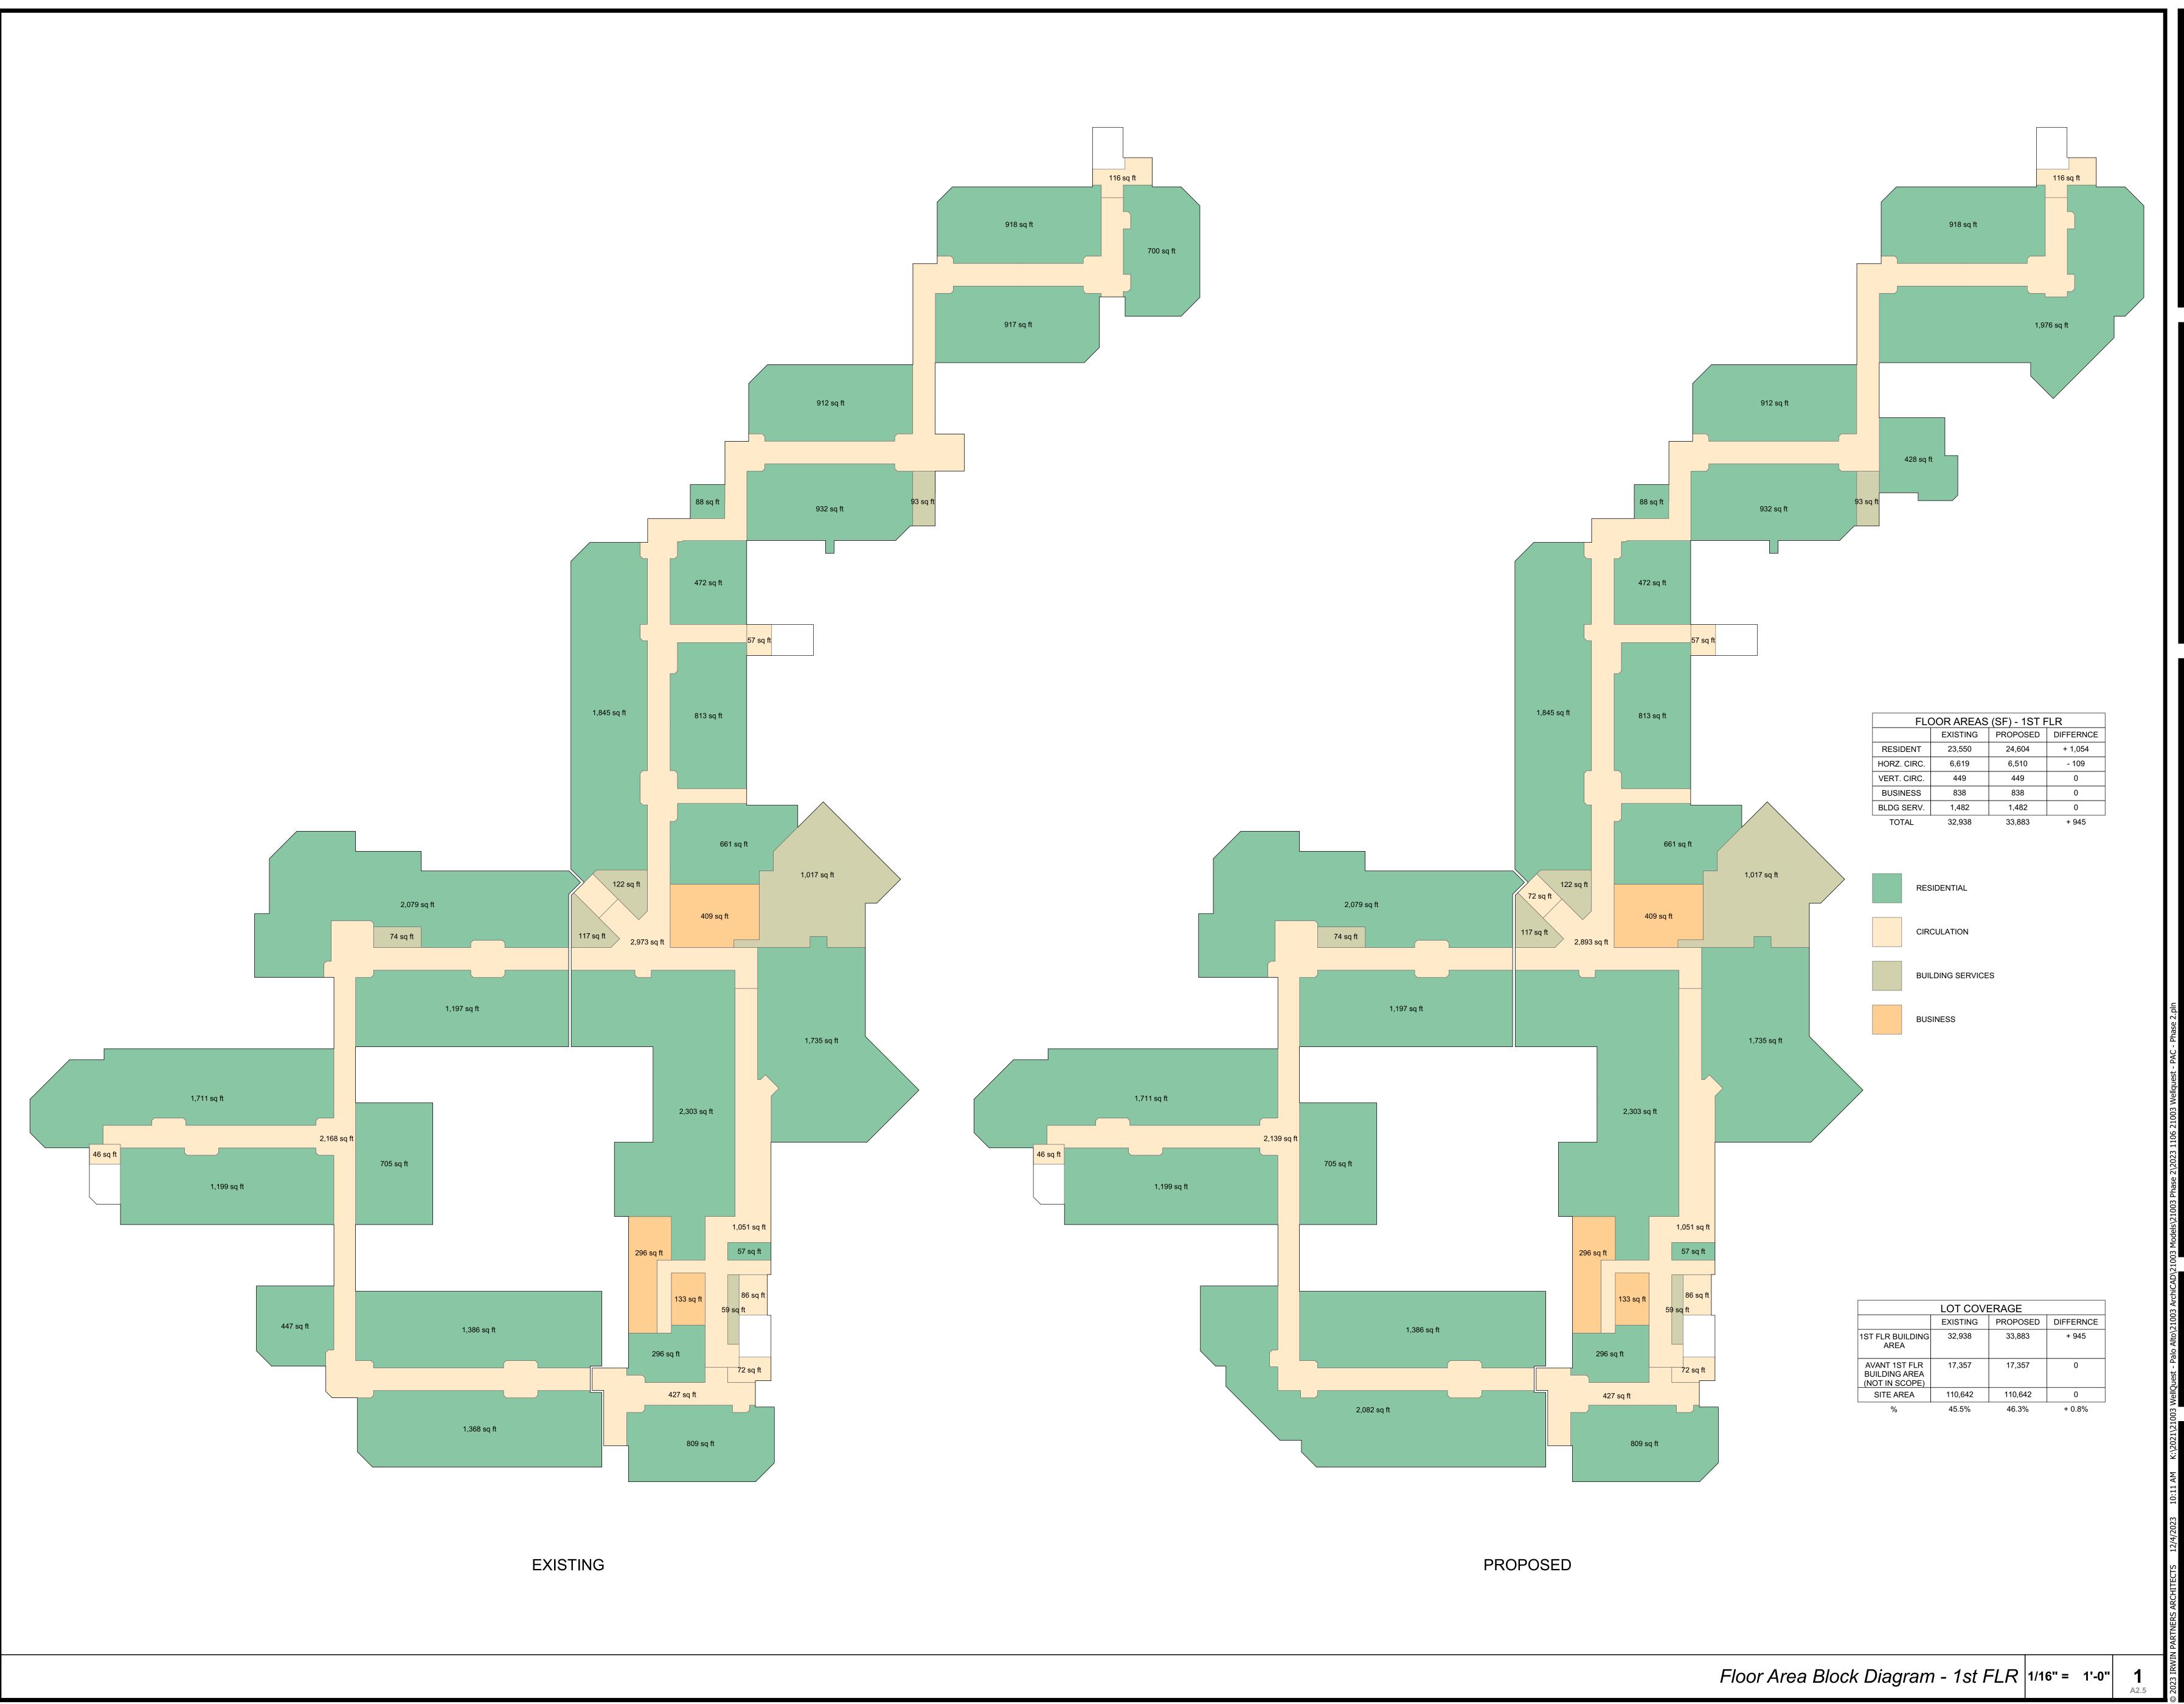

IRWIN PARTNERS

IRWIN PARTNERS
ARCHITECTURE

PLANNING
CONSULTING
245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com

Wellquest Living



PROJECT: 21003


DRAWN BY: YI, RA, & DB

CHECKED BY: TB & MP

DATE OF ISSUE: 00/00/0000

DRAWING DESCRIPTION

Floor Area Block
Diagrams - 1st FLR

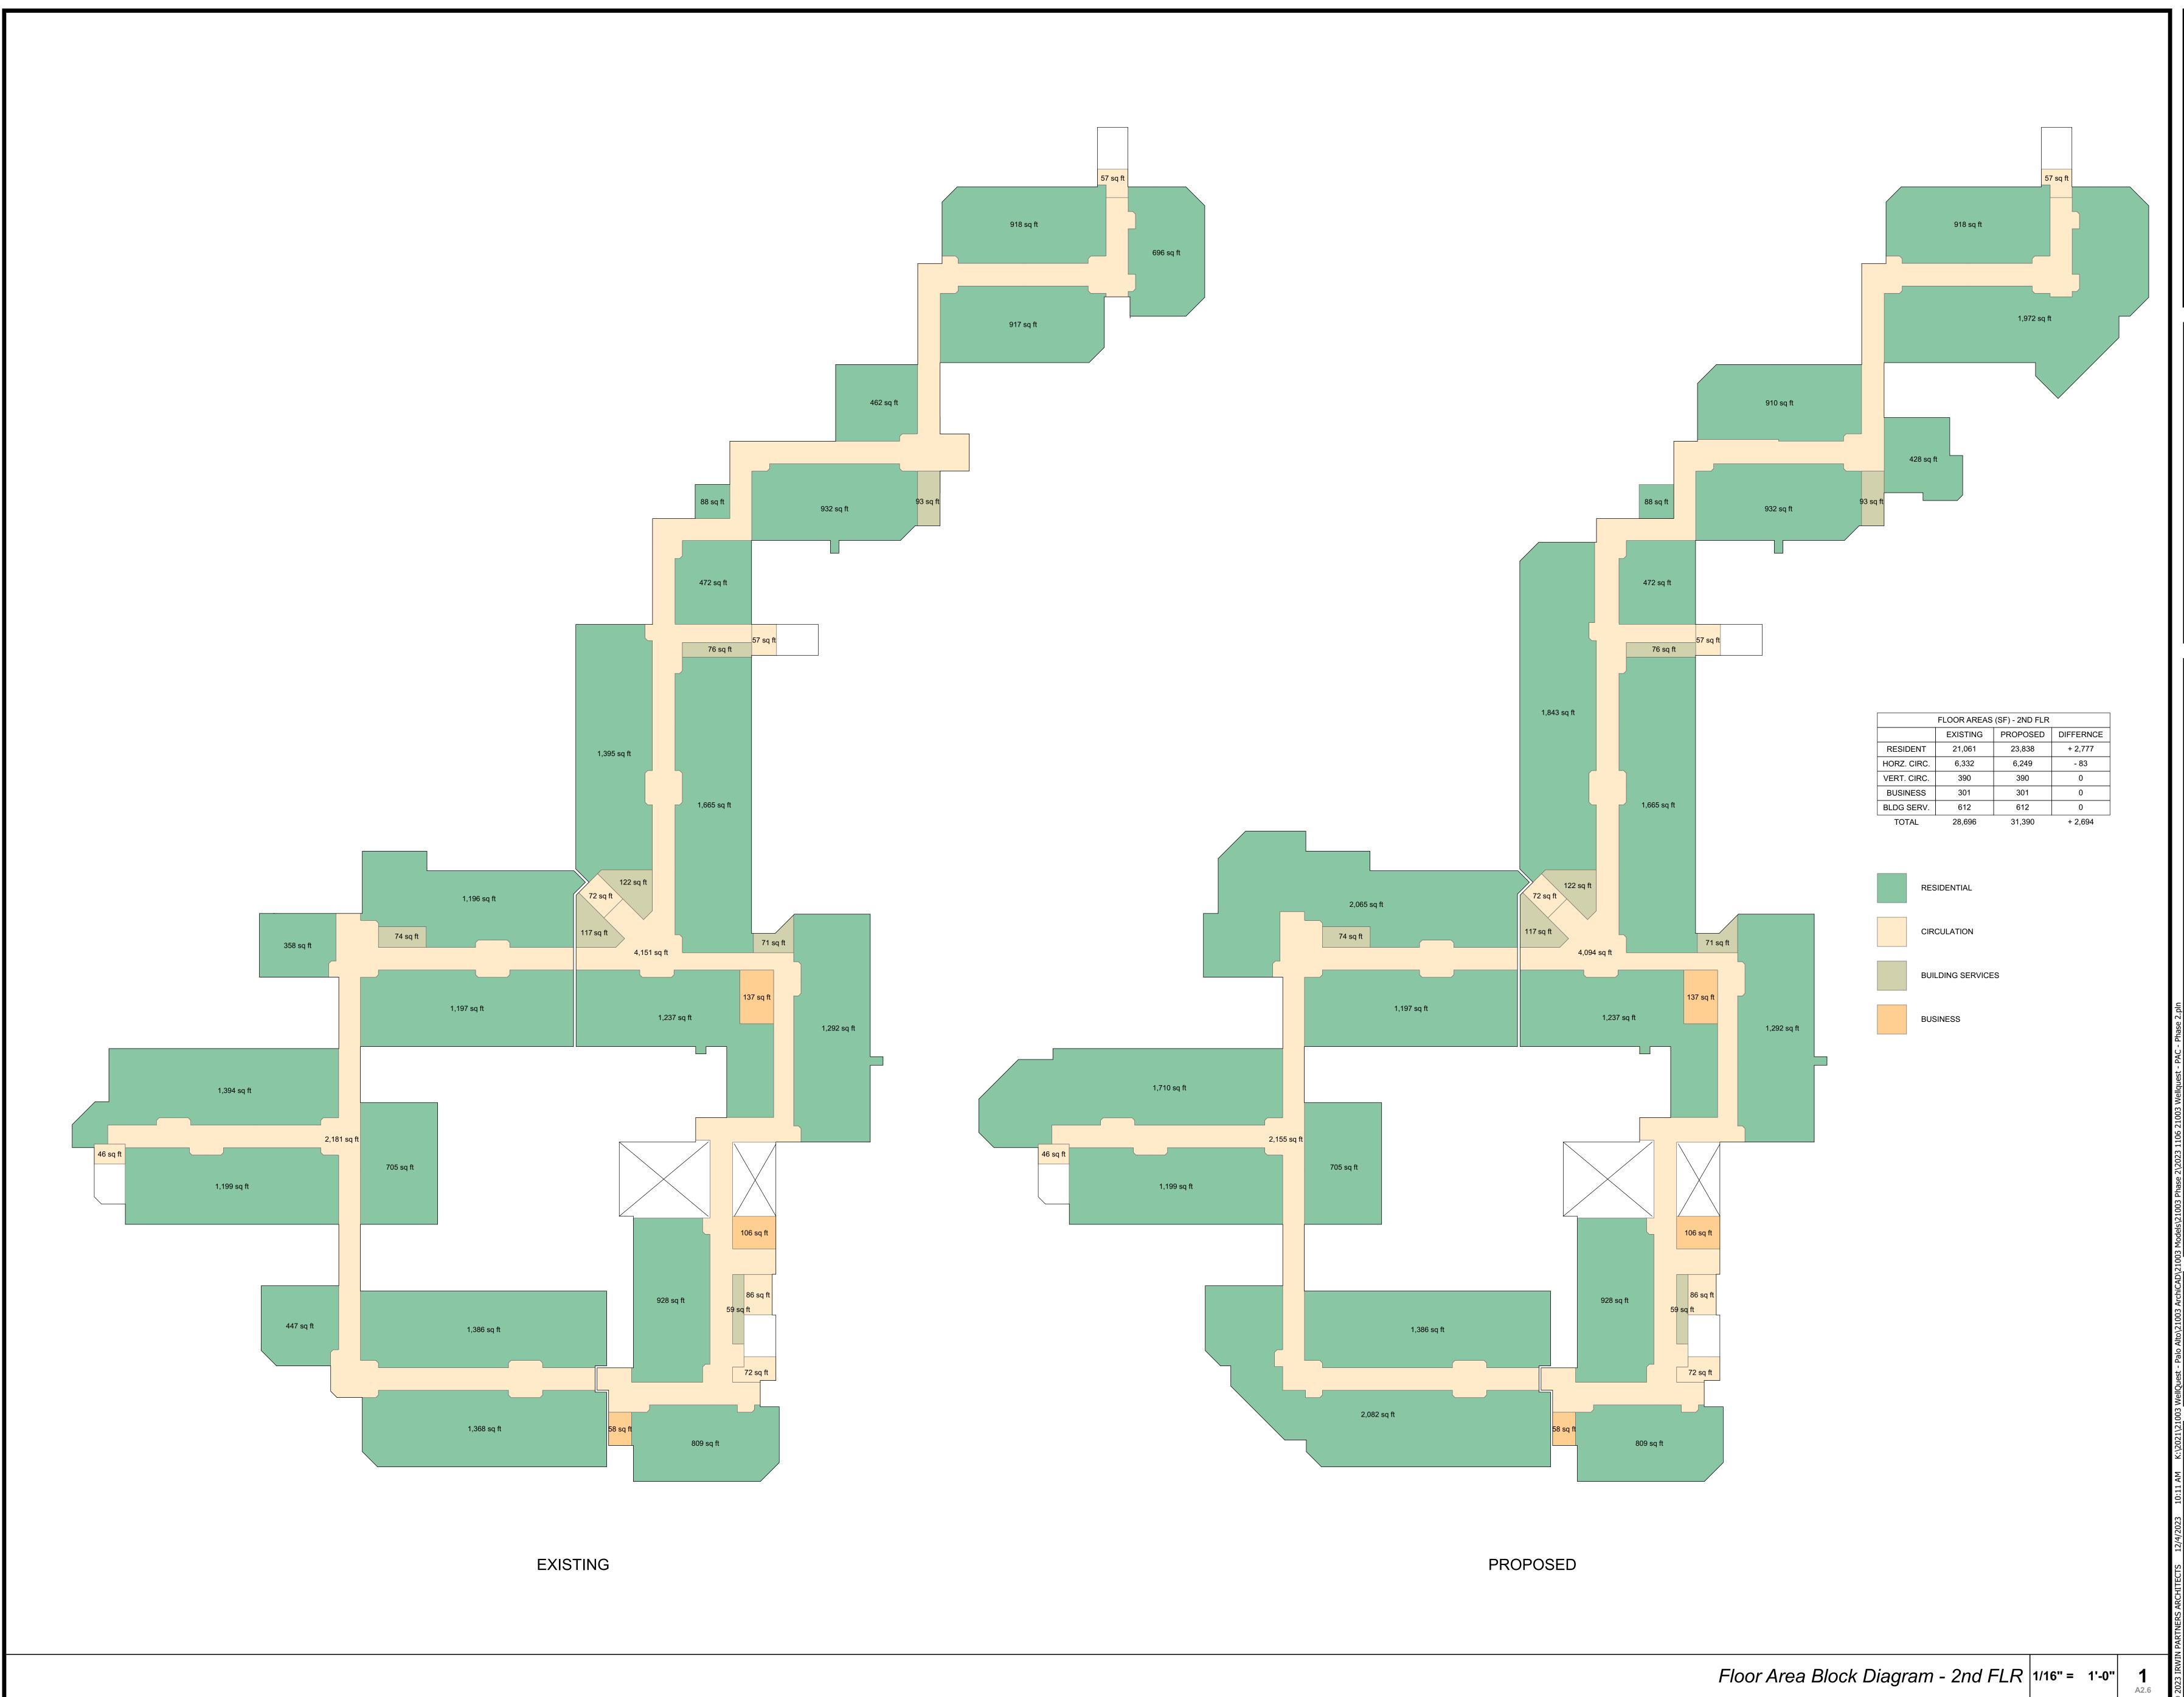



IRWIN PARTNERS
ARCHITECTS

ARCHITECTURE

PLANNING
CONSULTING
245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com

ALO ALTO COMMONS

Wellquest Living



PROJECT: 21003


DRAWN BY: YI, RA, & DB

CHECKED BY: TB & MP

DATE OF ISSUE: 00/00/0000

DRAWING DESCRIPTION

Floor Area Block
Diagrams - 2nd FLR

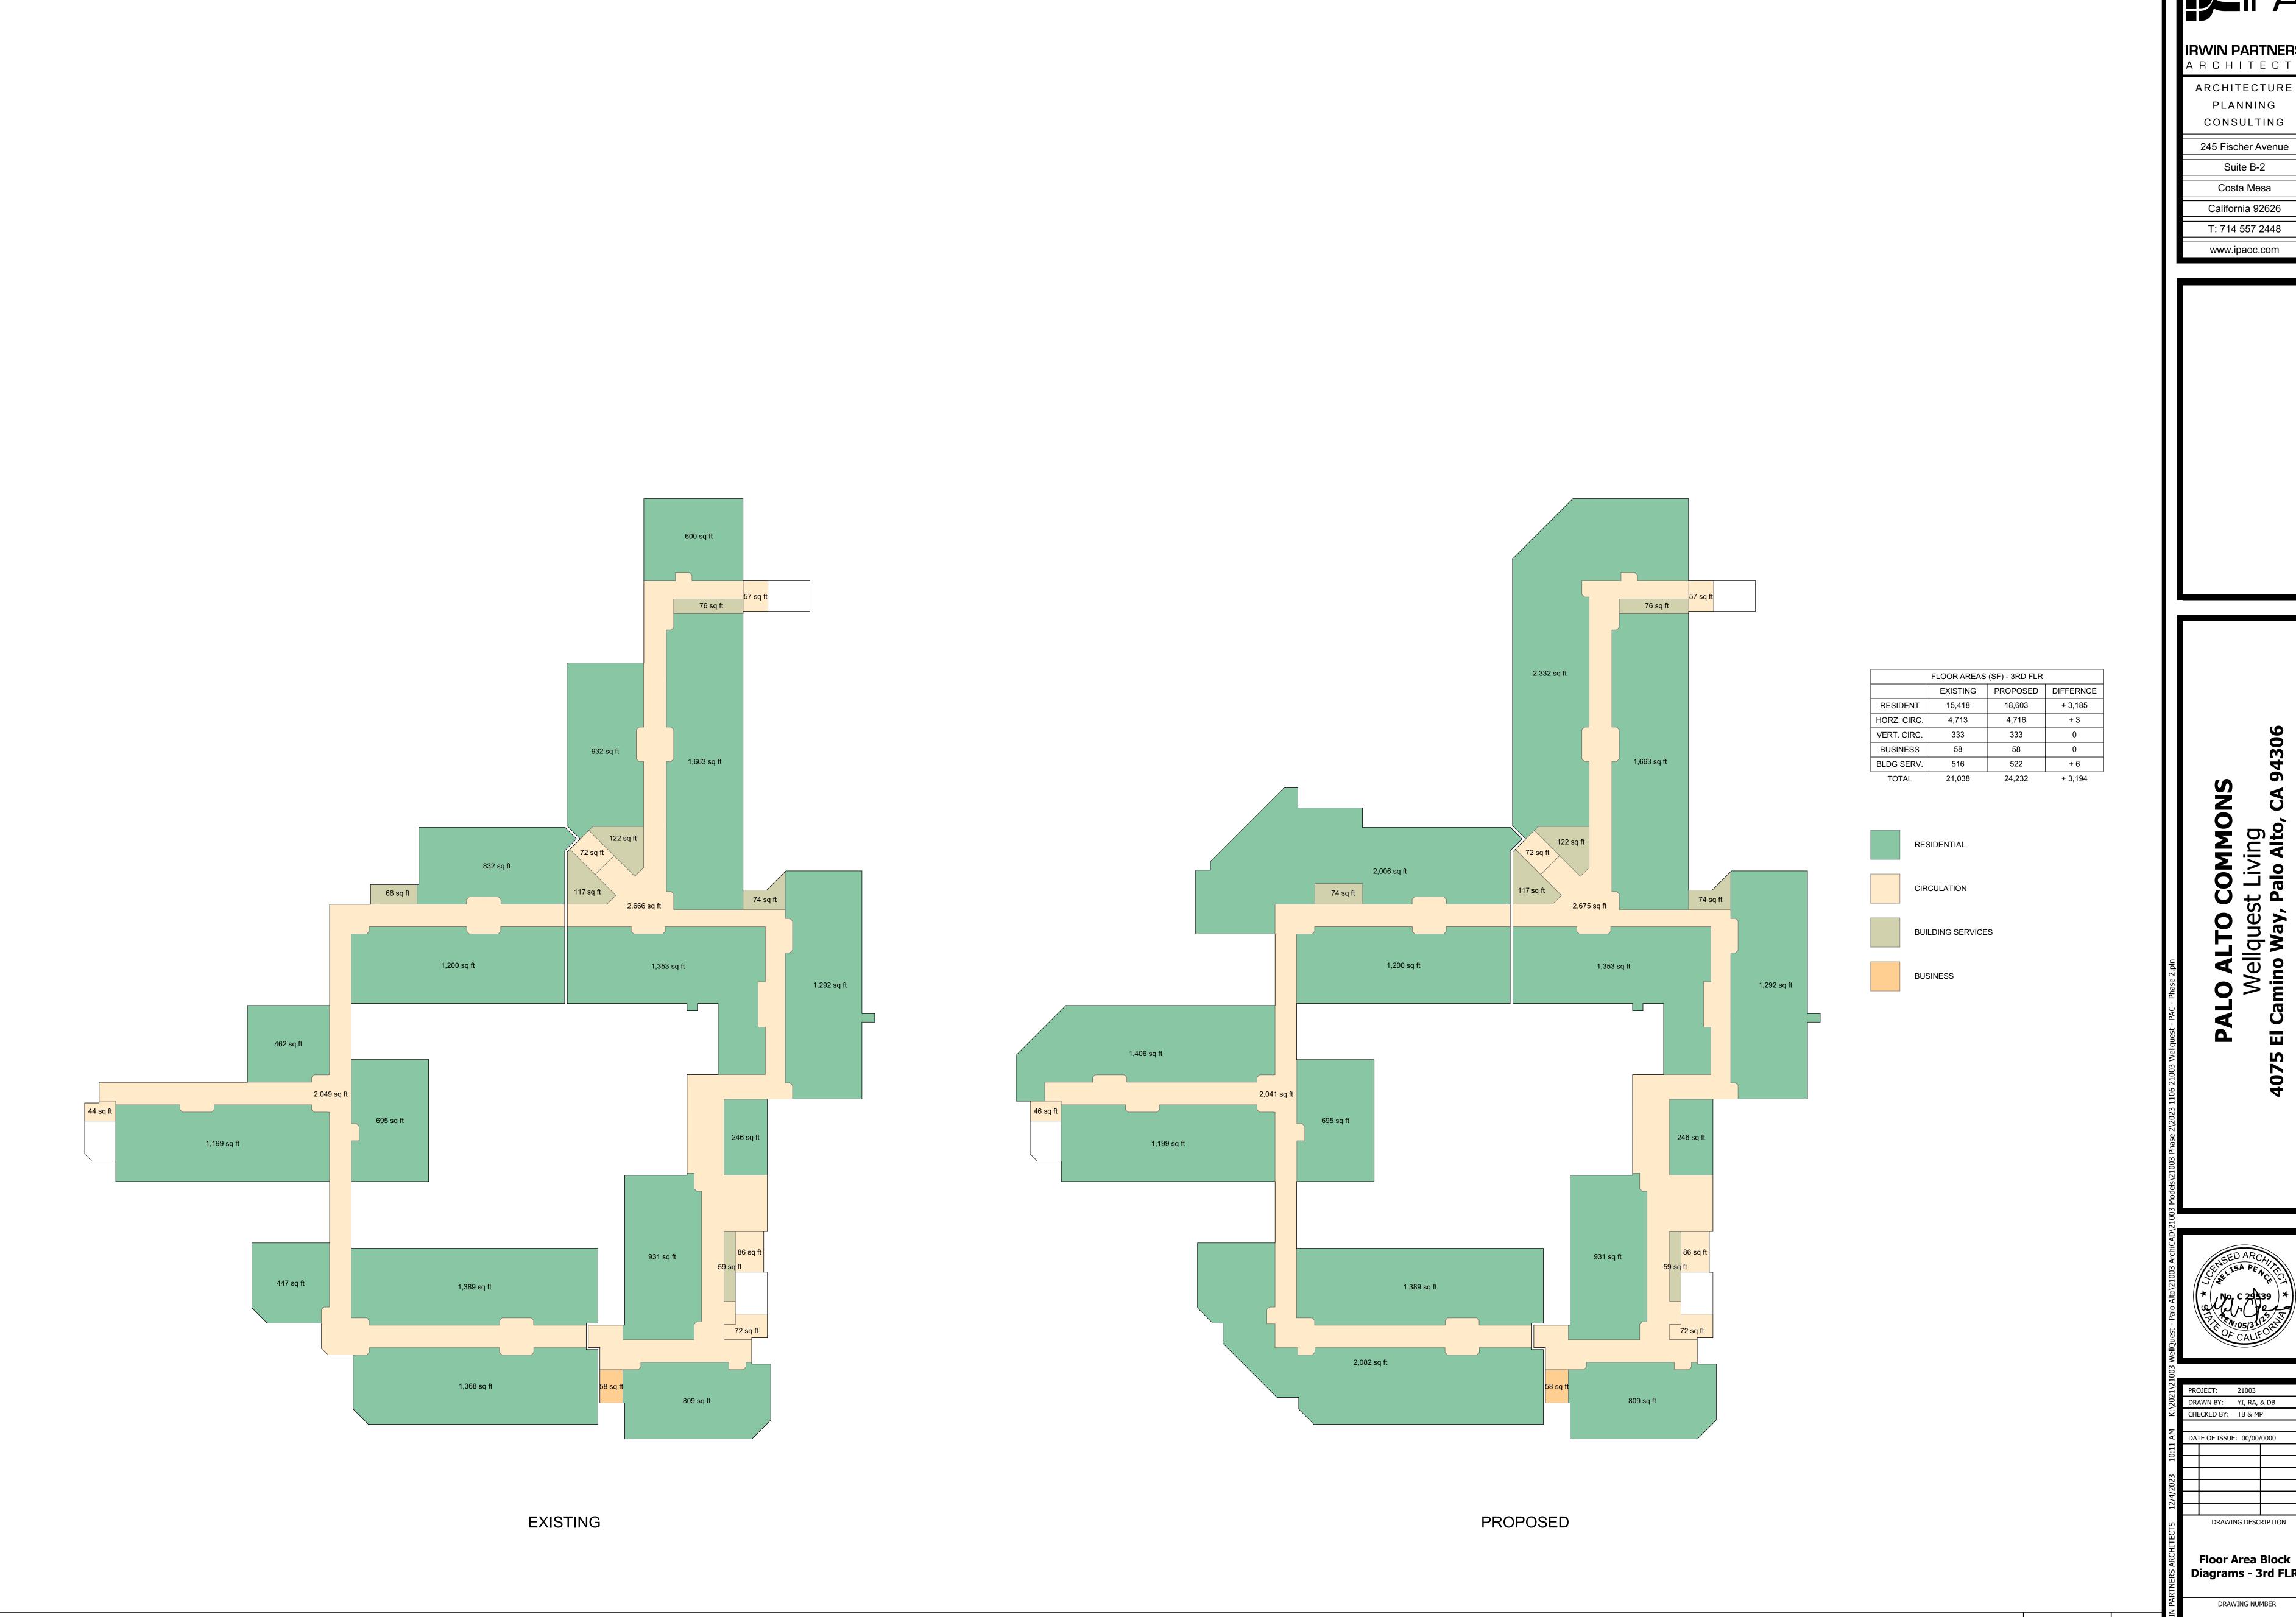

IRWIN PARTNERS ARCHITECT

> PLANNING CONSULTING 245 Fischer Avenue


Suite B-2 Costa Mesa

California 92626 T: 714 557 2448

www.ipaoc.com

DRAWN BY: YI, RA, & DB
CHECKED BY: TB & MP DATE OF ISSUE: 00/00/0000 DRAWING DESCRIPTION

Floor Area Block Diagrams - 3rd FLR

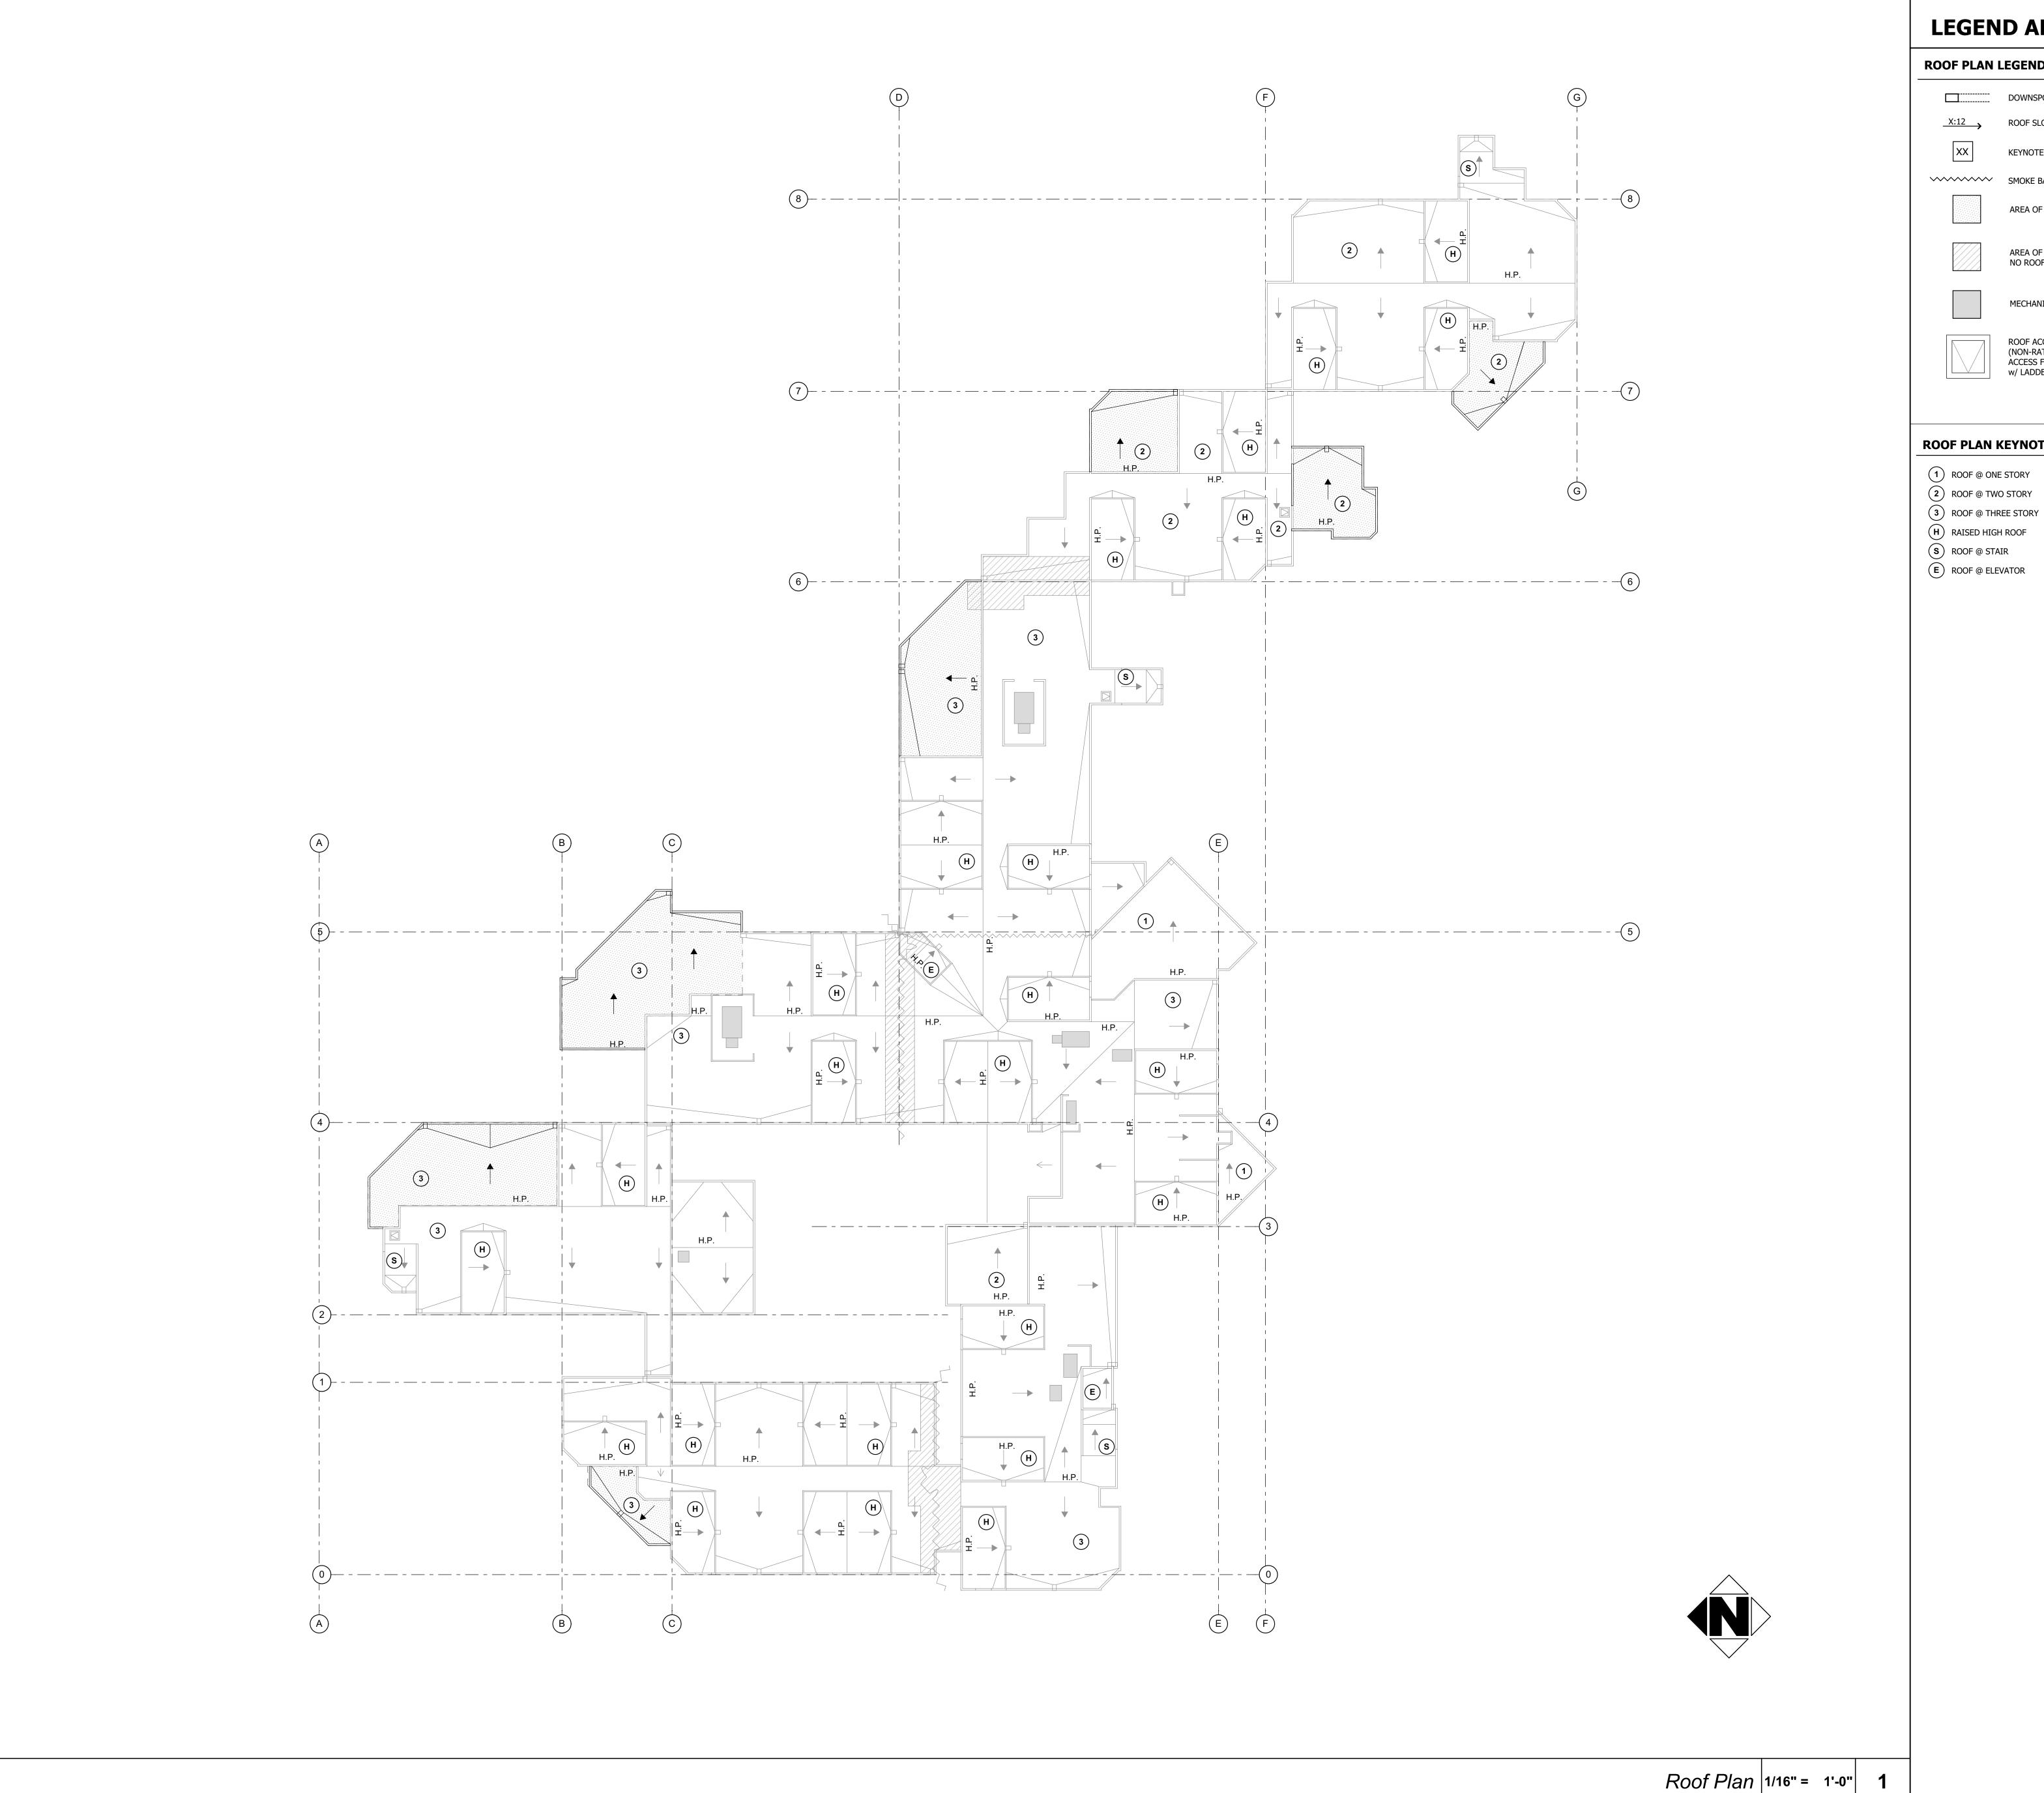

ROOF PLAN LEGEND

DOWNSPOUT (E)

X:12 ROOF SLOPE DOWN, 1/4:12 TYP., U.N.O.

KEYNOTE NUMBER

>>>>>>> SMOKE BARRIER WALL BELOW

AREA OF PROPOSED WORK

AREA OF 5' (EA SIDE) OF AREA SEPERATION WALL NO ROOF PENETRATIONS WITHIN THIS AREA ARE ALLOWED

MECHANICAL EQUIPMENT @ ROOF

ROOF ACCESS HATCH (NON-RATED) ACCESS FOR HVAC EQUIPMENT - 30" x 30" w/ LADDER

ROOF PLAN KEYNOTES


- 1) ROOF @ ONE STORY
- 2 ROOF @ TWO STORY

- E ROOF @ ELEVATOR

IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING 245 Fischer Avenue Suite B-2 Costa Mesa California 92626 T: 714 557 2448 www.ipaoc.com



K:\2021\21003 WellQu				
1003				
21/2	PRC	DJECT:	21003	
/202	DRA	AWN BY:	YI, RA,	& DB
<u></u>	CHE	CKED BY:	TB & M	IP
_				
I A	DAT	TE OF ISSU	JE: 00/00	/0000
0:11				
1				
23				
/202				
2/4/				
$\overline{}$				
N PARTNERS ARCHITECTS 12/4/2023 10:11 AM		DRAW	ING DESC	CRIPTION
RTNERS		Ro	oof Pl	an
N PA		DRA	AWING NU	IMBER

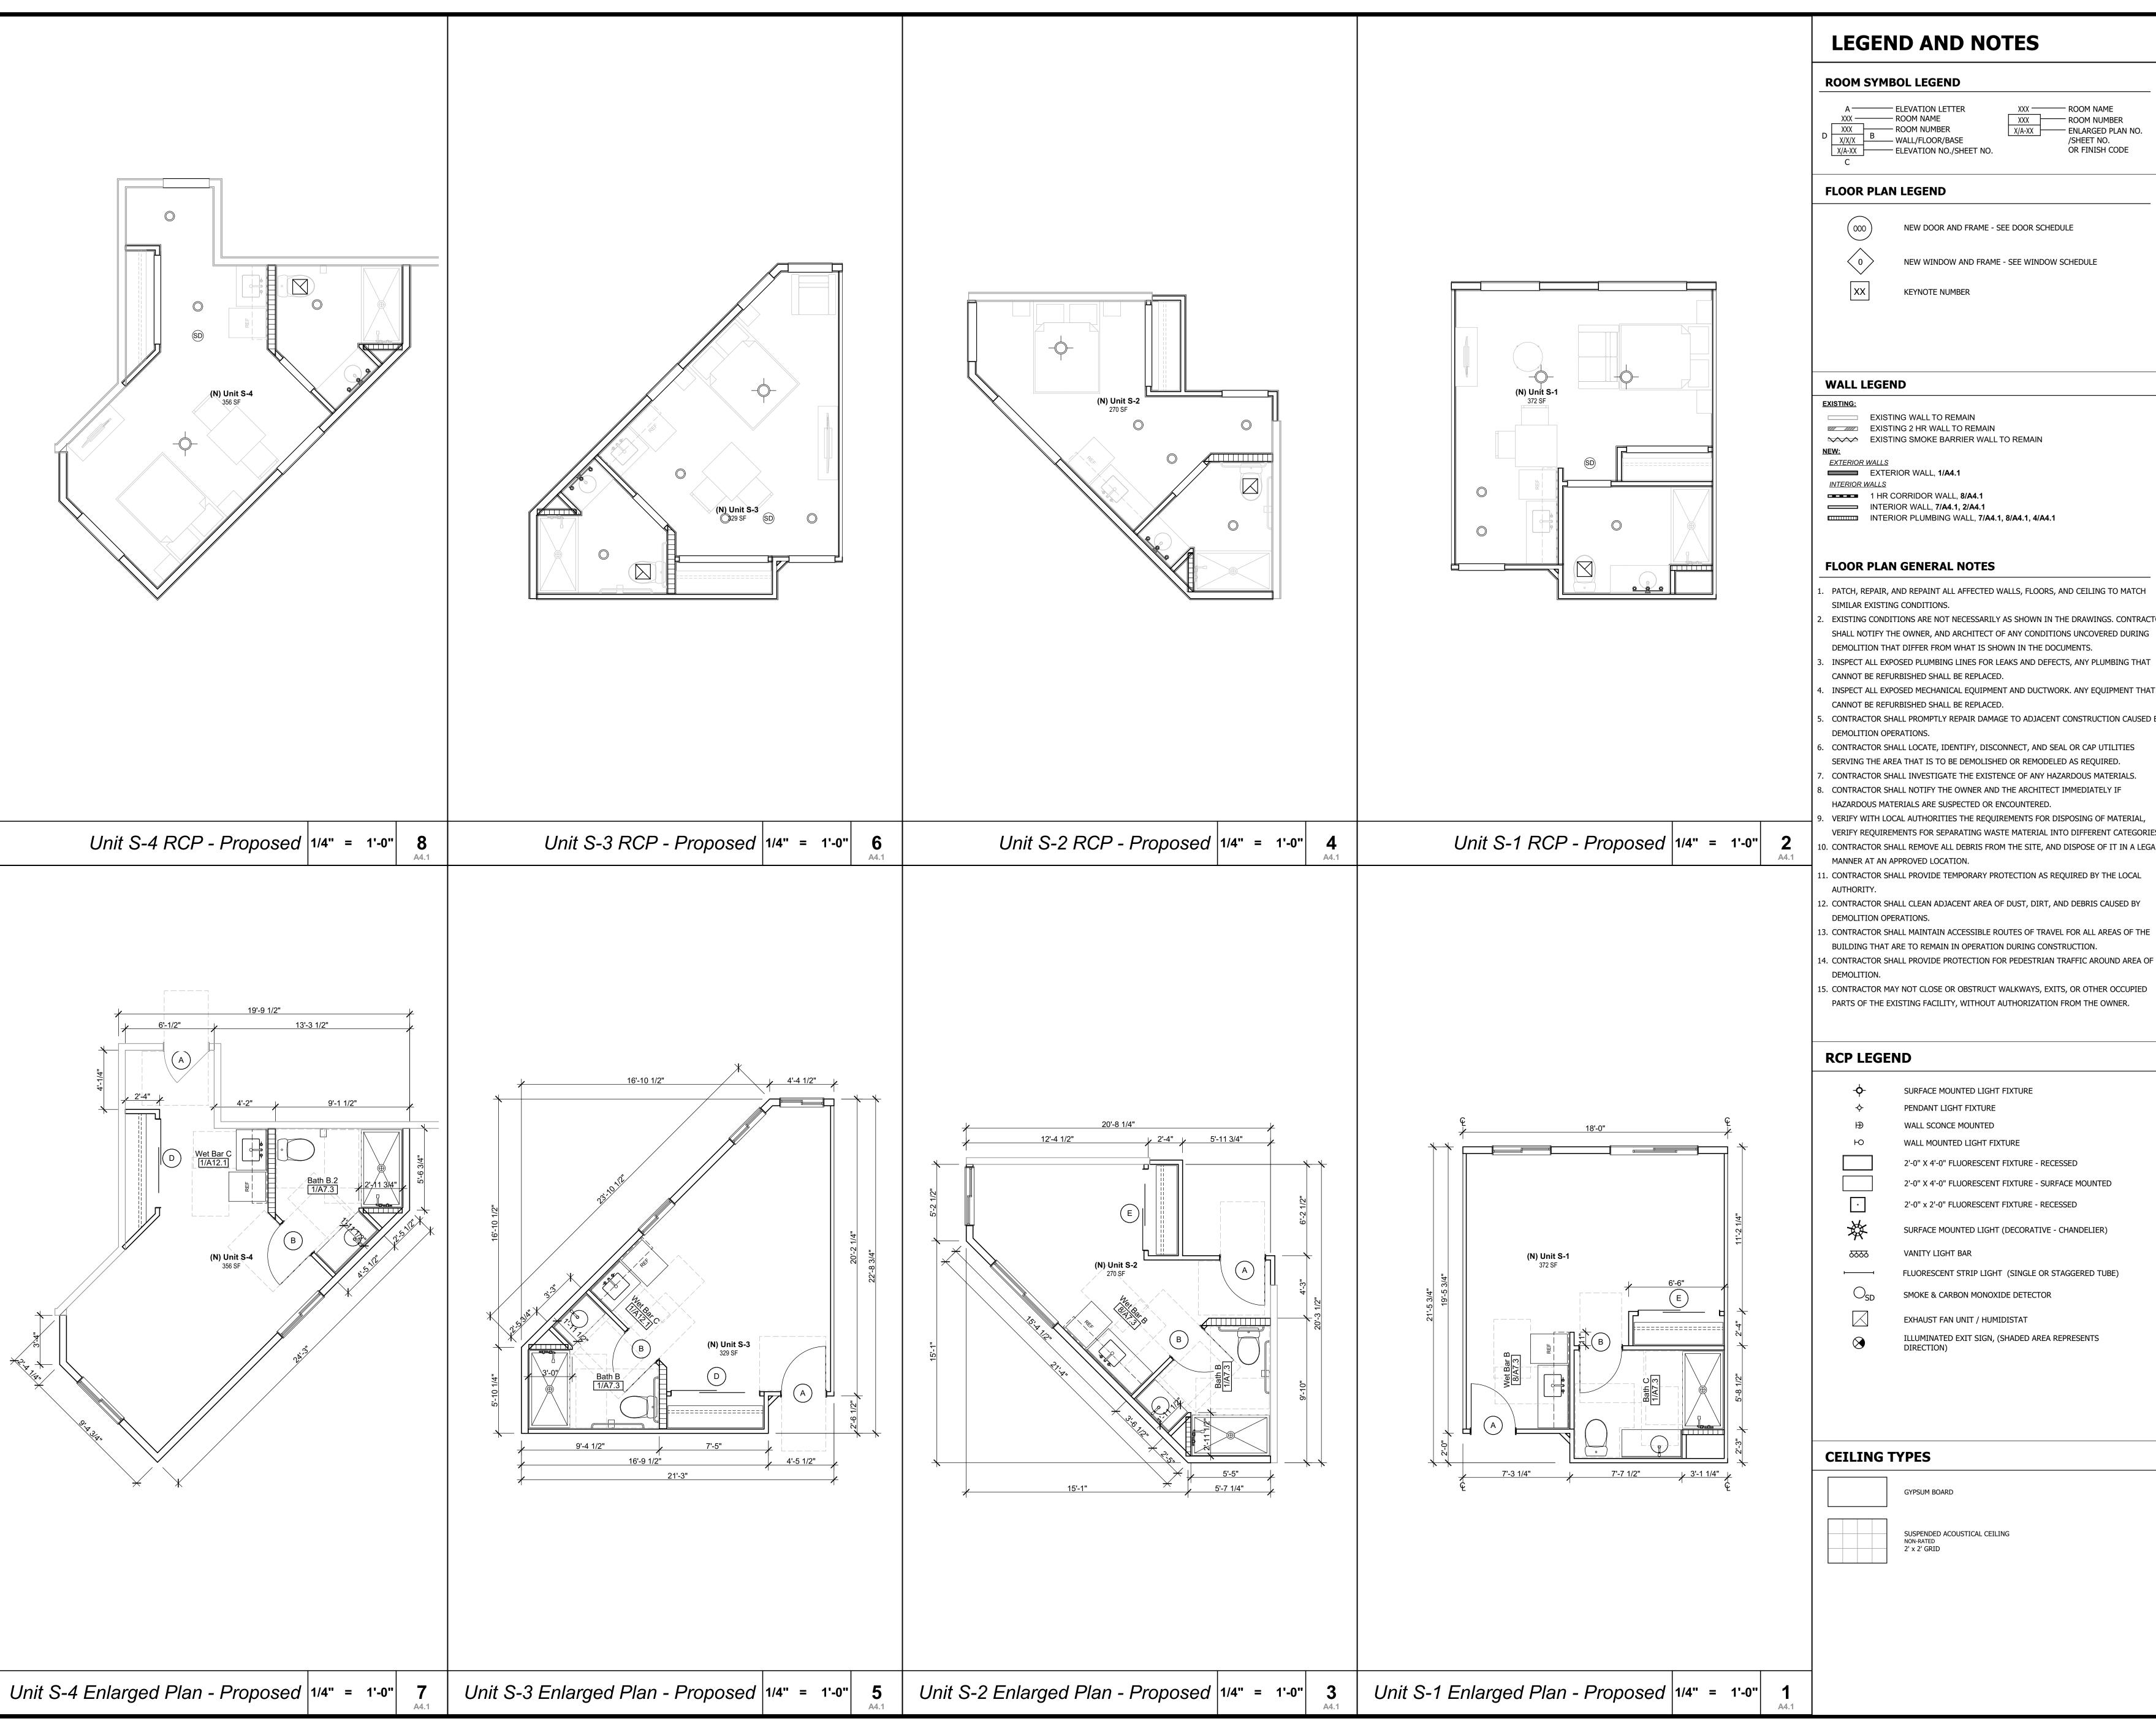

ROOM SYMBOL LEGEND

A — ELEVATION LETTER XXX — ROOM NAME XXX ROOM NUMBER B WALL/FLOOR/BASE X/A-XX ELEVATION NO./SHEET NO.

XXX ---- ROOM NAME XXX ROOM NUMBER X/A-XX ENLARGED PLAN NO. /SHEET NO. OR FINISH CODE

IRWIN PARTNERS

ARCHITECTURE

PLANNING

CONSULTING

245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com

ARCHITECT

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

EXISTING WALL TO REMAIN EXISTING 2 HR WALL TO REMAIN

EXISTING SMOKE BARRIER WALL TO REMAIN

EXTERIOR WALL, 1/A4.1

□□□□ INTERIOR WALL, **7/A4.1**, **2/A4.1** INTERIOR PLUMBING WALL, **7/A4.1, 8/A4.1, 4/A4.1**

FLOOR PLAN GENERAL NOTES

- . PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH SIMILAR EXISTING CONDITIONS.
- EXISTING CONDITIONS ARE NOT NECESSARILY AS SHOWN IN THE DRAWINGS. CONTRACTOR SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- INSPECT ALL EXPOSED PLUMBING LINES FOR LEAKS AND DEFECTS, ANY PLUMBING THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- DEMOLITION OPERATIONS. CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES
- SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED.

- 10. CONTRACTOR SHALL REMOVE ALL DEBRIS FROM THE SITE, AND DISPOSE OF IT IN A LEGAL
- 1. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 2. CONTRACTOR SHALL CLEAN ADJACENT AREA OF DUST, DIRT, AND DEBRIS CAUSED BY
- 4. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 5. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.

SURFACE MOUNTED LIGHT FIXTURE PENDANT LIGHT FIXTURE

WALL SCONCE MOUNTED WALL MOUNTED LIGHT FIXTURE

> 2'-0" X 4'-0" FLUORESCENT FIXTURE - RECESSED 2'-0" X 4'-0" FLUORESCENT FIXTURE - SURFACE MOUNTED

2'-0" x 2'-0" FLUORESCENT FIXTURE - RECESSED

SURFACE MOUNTED LIGHT (DECORATIVE - CHANDELIER) VANITY LIGHT BAR

SMOKE & CARBON MONOXIDE DETECTOR EXHAUST FAN UNIT / HUMIDISTAT


ILLUMINATED EXIT SIGN, (SHADED AREA REPRESENTS DIRECTION)

CEILING TYPES

GYPSUM BOARD SUSPENDED ACOUSTICAL CEILING NON-RATED 2' x 2' GRID PROJECT: 21003 DRAWN BY: YI, RA, & DB

Enlarged Unit Plans

DRAWING DESCRIPTION

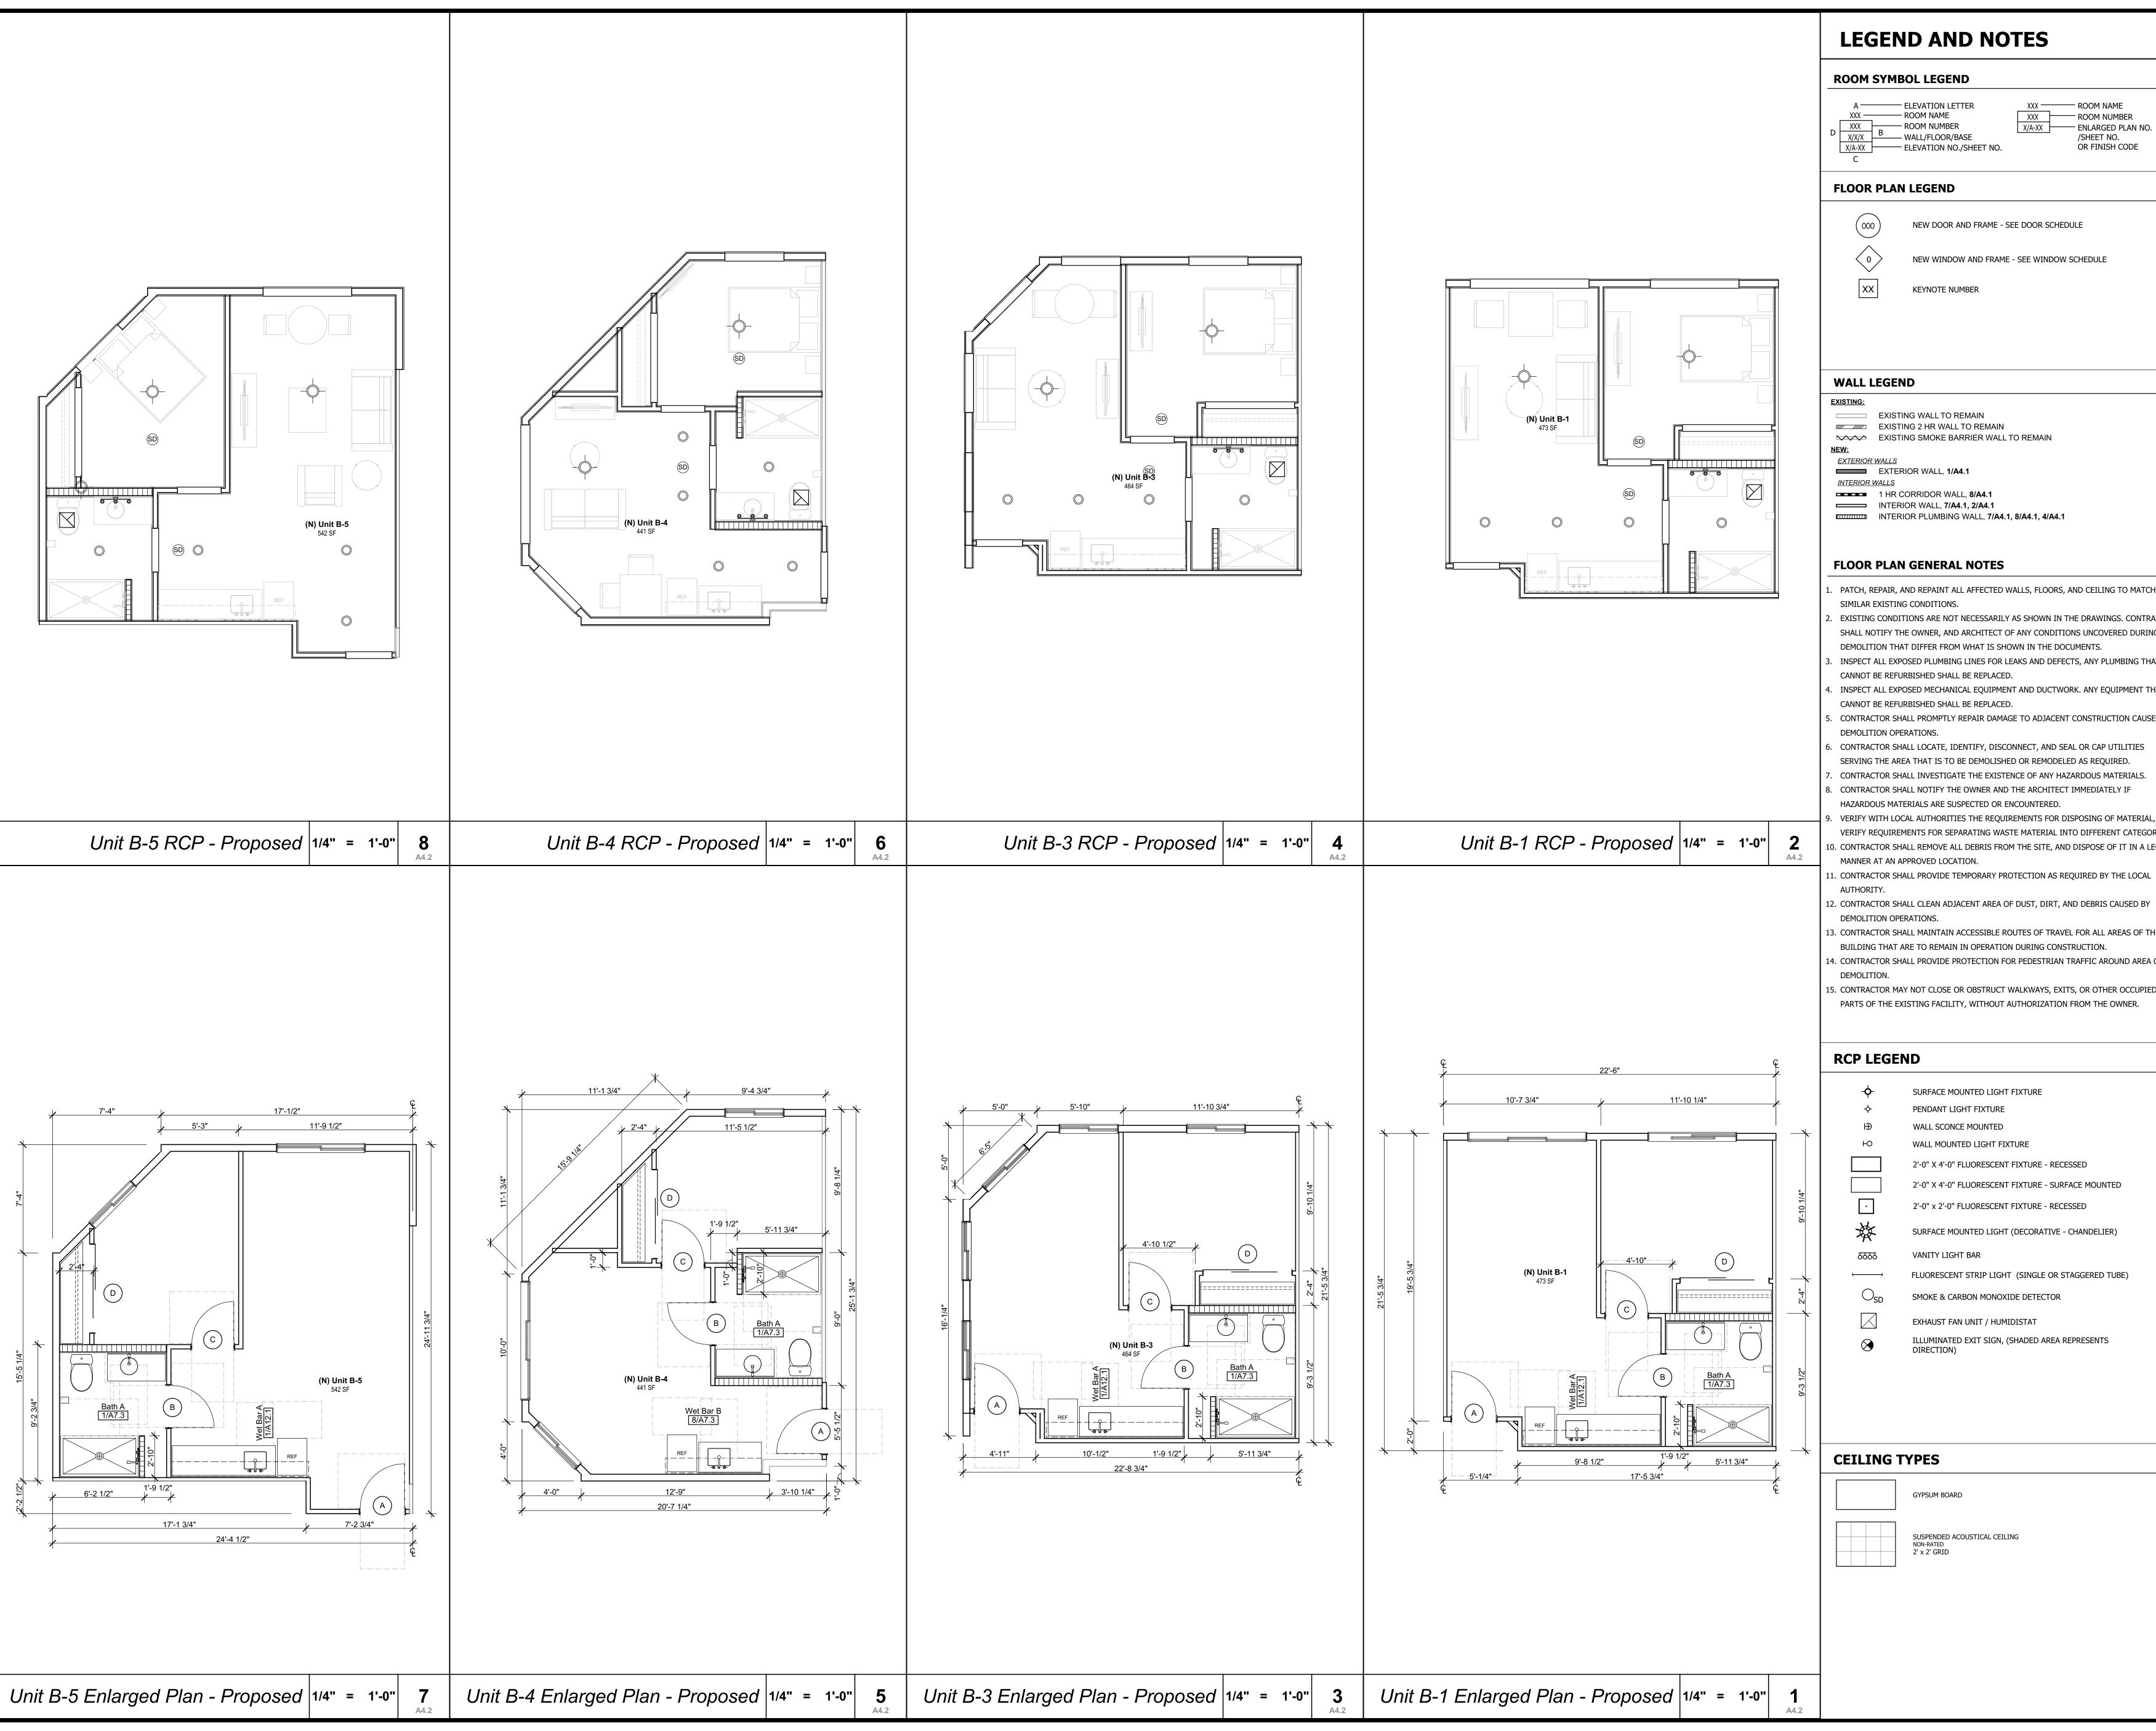

XXX ---- ROOM NAME XXX ROOM NUMBER X/A-XX ENLARGED PLAN NO. /SHEET NO. OR FINISH CODE

IRWIN PARTNERS

ARCHITECTURE

PLANNING

CONSULTING

245 Fischer Avenue

Suite B-2

Costa Mesa

California 92626

T: 714 557 2448

www.ipaoc.com

ARCHITECT

NEW DOOR AND FRAME - SEE DOOR SCHEDULE

NEW WINDOW AND FRAME - SEE WINDOW SCHEDULE

□□□□ INTERIOR WALL, **7/A4.1**, **2/A4.1**

INTERIOR PLUMBING WALL, **7/A4.1**, **8/A4.1**, **4/A4.1**

- PATCH, REPAIR, AND REPAINT ALL AFFECTED WALLS, FLOORS, AND CEILING TO MATCH
- EXISTING CONDITIONS ARE NOT NECESSARILY AS SHOWN IN THE DRAWINGS. CONTRACTOR SHALL NOTIFY THE OWNER, AND ARCHITECT OF ANY CONDITIONS UNCOVERED DURING DEMOLITION THAT DIFFER FROM WHAT IS SHOWN IN THE DOCUMENTS.
- INSPECT ALL EXPOSED PLUMBING LINES FOR LEAKS AND DEFECTS, ANY PLUMBING THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- INSPECT ALL EXPOSED MECHANICAL EQUIPMENT AND DUCTWORK. ANY EQUIPMENT THAT CANNOT BE REFURBISHED SHALL BE REPLACED.
- CONTRACTOR SHALL LOCATE, IDENTIFY, DISCONNECT, AND SEAL OR CAP UTILITIES SERVING THE AREA THAT IS TO BE DEMOLISHED OR REMODELED AS REQUIRED.

- 1. CONTRACTOR SHALL PROVIDE TEMPORARY PROTECTION AS REQUIRED BY THE LOCAL
- 3. CONTRACTOR SHALL MAINTAIN ACCESSIBLE ROUTES OF TRAVEL FOR ALL AREAS OF THE
- 4. CONTRACTOR SHALL PROVIDE PROTECTION FOR PEDESTRIAN TRAFFIC AROUND AREA OF
- 5. CONTRACTOR MAY NOT CLOSE OR OBSTRUCT WALKWAYS, EXITS, OR OTHER OCCUPIED PARTS OF THE EXISTING FACILITY, WITHOUT AUTHORIZATION FROM THE OWNER.

SURFACE MOUNTED LIGHT FIXTURE PENDANT LIGHT FIXTURE WALL SCONCE MOUNTED

WALL MOUNTED LIGHT FIXTURE

2'-0" X 4'-0" FLUORESCENT FIXTURE - RECESSED 2'-0" X 4'-0" FLUORESCENT FIXTURE - SURFACE MOUNTED

2'-0" x 2'-0" FLUORESCENT FIXTURE - RECESSED

SURFACE MOUNTED LIGHT (DECORATIVE - CHANDELIER) VANITY LIGHT BAR

SMOKE & CARBON MONOXIDE DETECTOR EXHAUST FAN UNIT / HUMIDISTAT


SUSPENDED ACOUSTICAL CEILING NON-RATED 2' x 2' GRID

DRAWING DESCRIPTION

DRAWN BY: YI, RA, & DB

Enlarged Unit Plans DRAWING NUMBER

A4.2

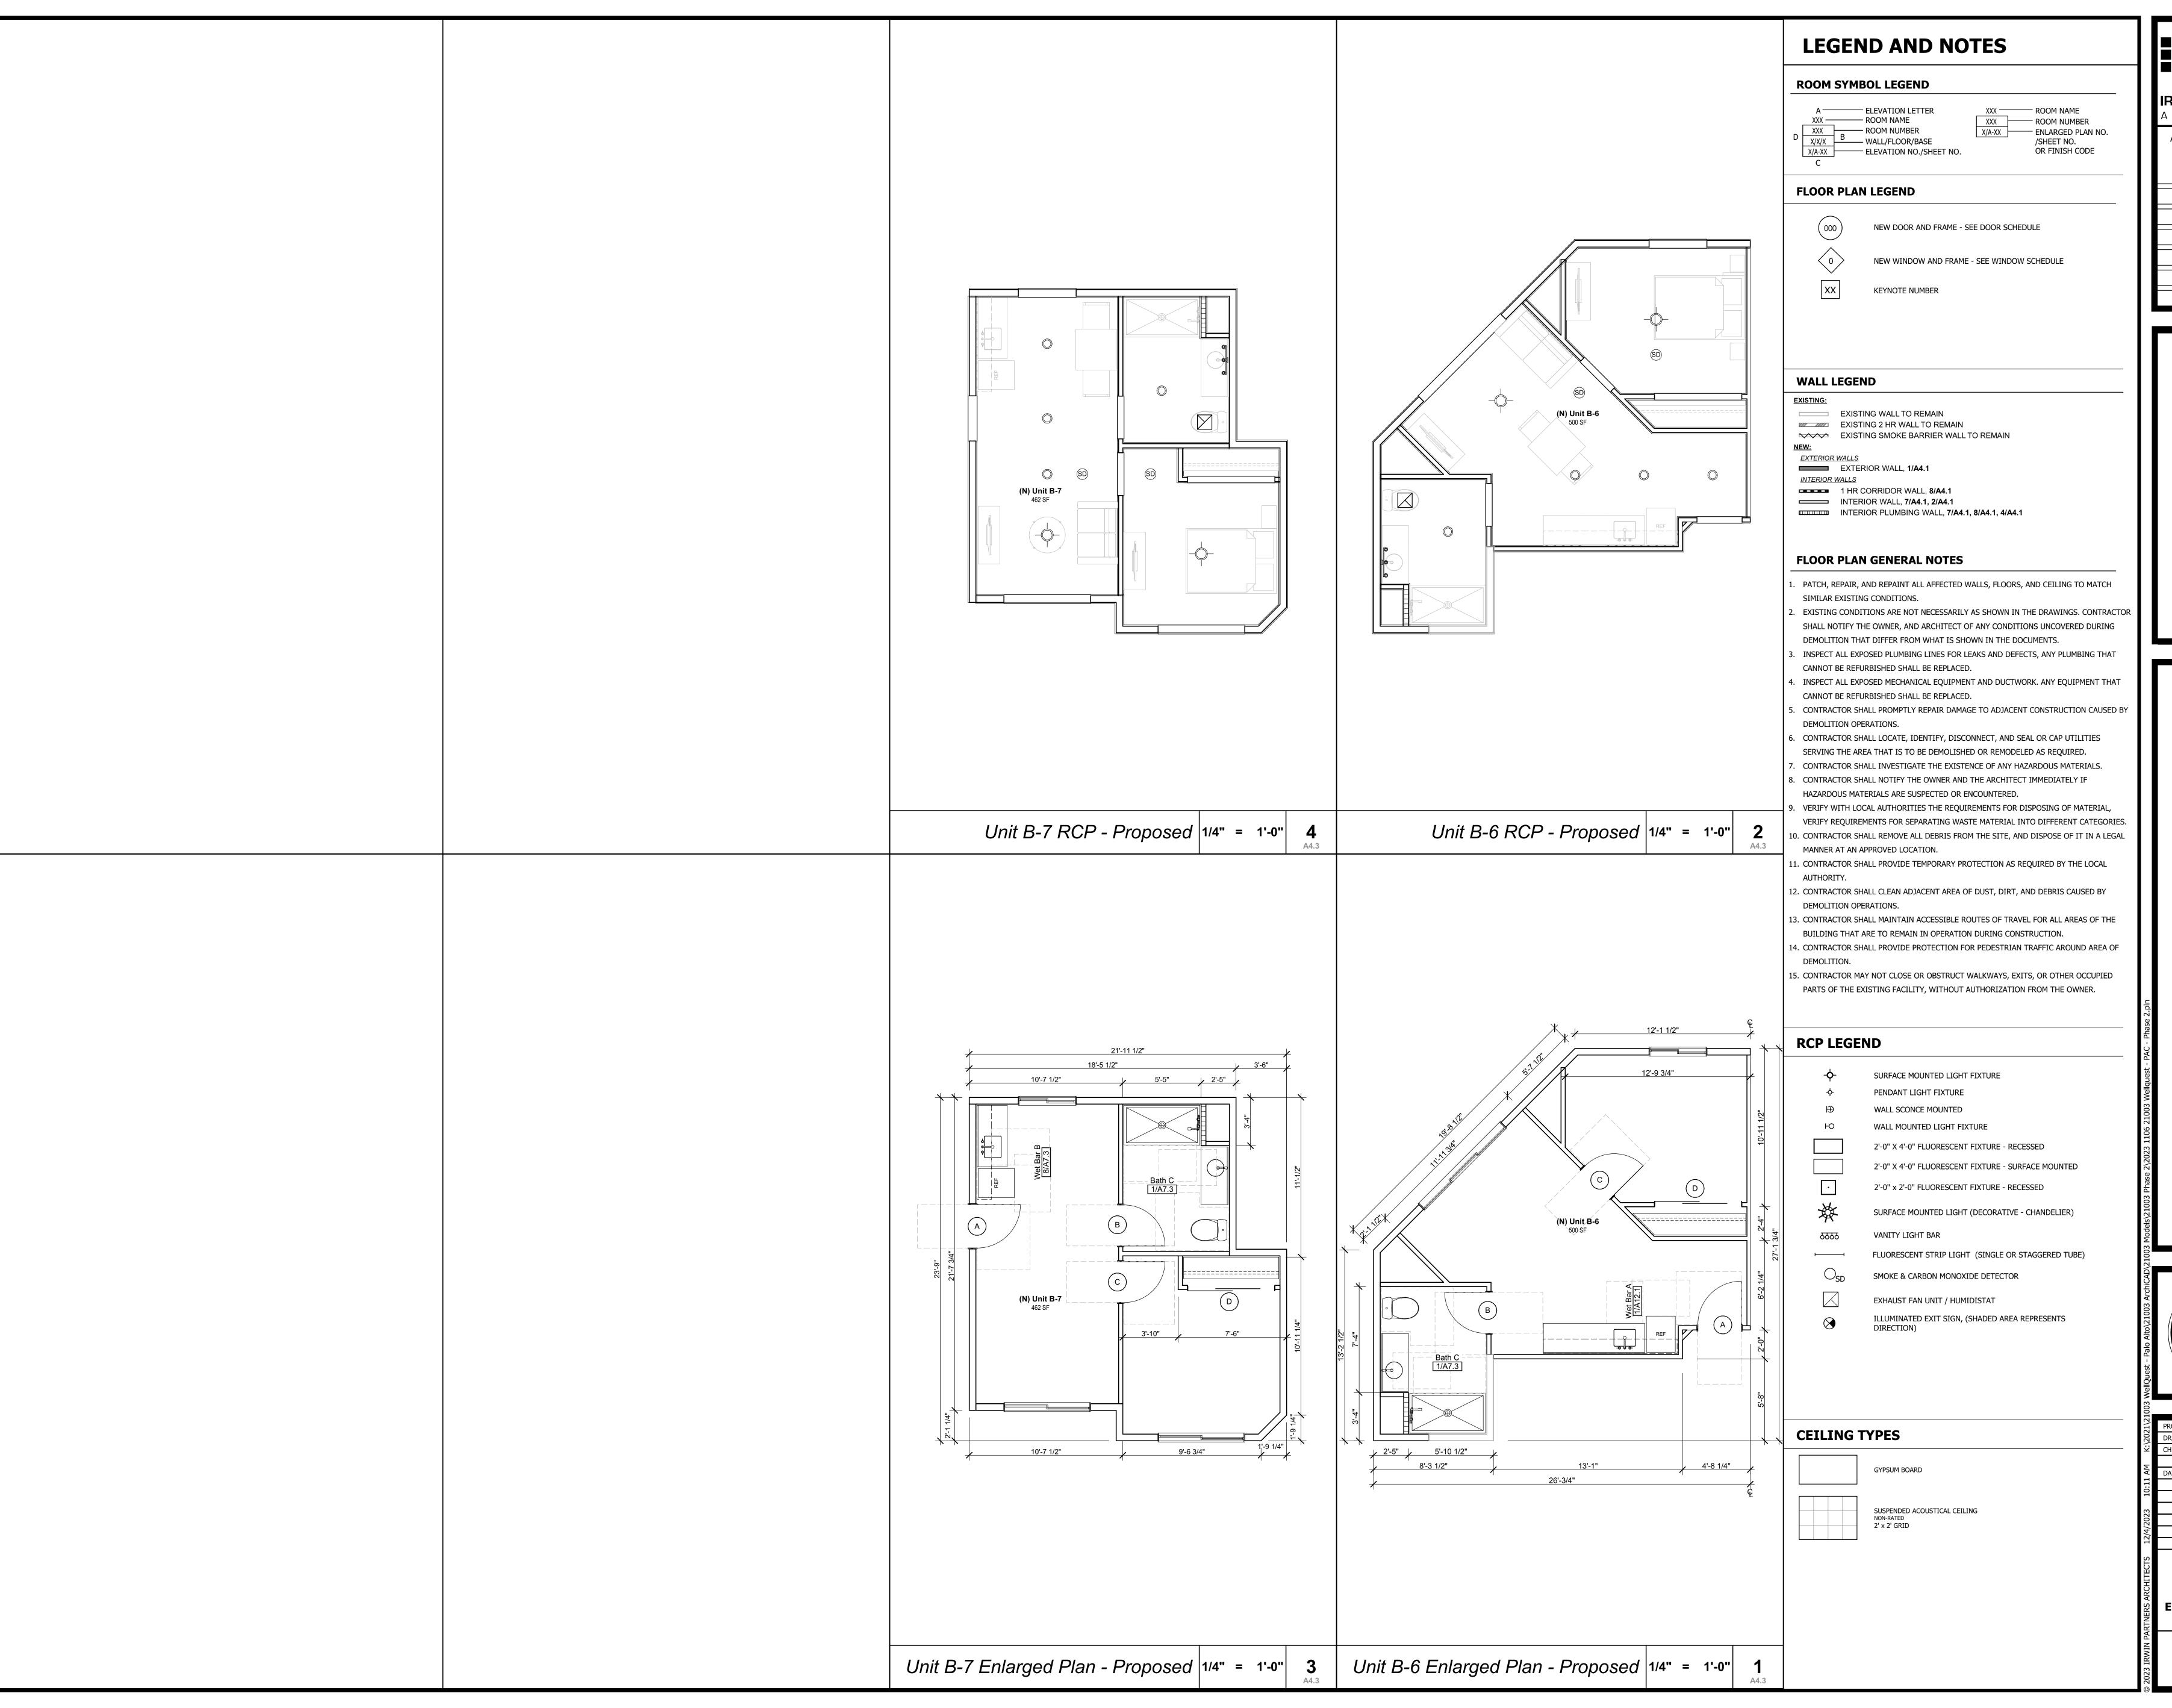

IRWIN PARTNERS

ARCHITECT ARCHITECTURE PLANNING

> CONSULTING 245 Fischer Avenue Suite B-2

> Costa Mesa California 92626

T: 714 557 2448

www.ipaoc.com



PROJECT: 21003

Enlarged Unit Plans



IRWIN PARTNERS
A R C H I T E C T S

ARCHITECTURE
PLANNING
CONSULTING

245 Fischer Avenue

Suite B-2


Costa Mesa


California 92626

T: 714 557 2448

www.ipaoc.com

Wellquest Living
El Camino Way, Palo Alto, CA 94306




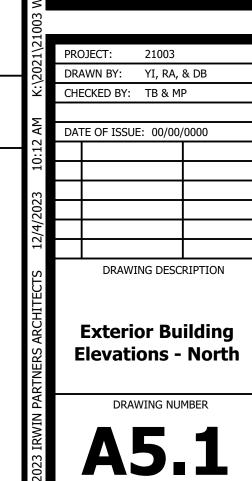

North Elevation - Proposed | 1/8" = 1'-0" | 1



EXTERIOR FINISHES EXERIOR FINISHES

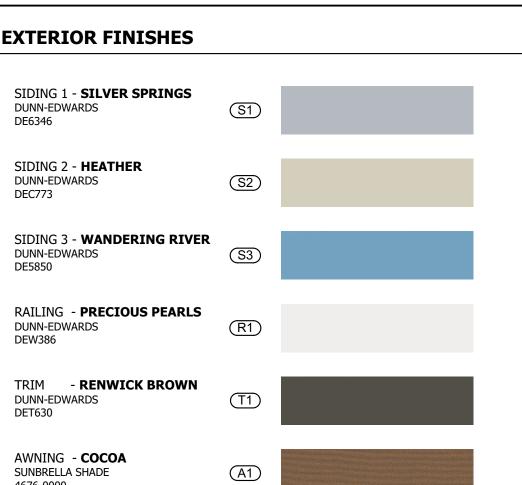

IRWIN PARTNERS
A R C H I T E C T S

ARCHITECTURE
PLANNING
CONSULTING

245 Fischer Avenue

Suite B-2

Costa Mesa


California 92626

T: 714 557 2448

www.ipaoc.com

Wellquest Living
Camino Way, Palo Alto, CA 94306



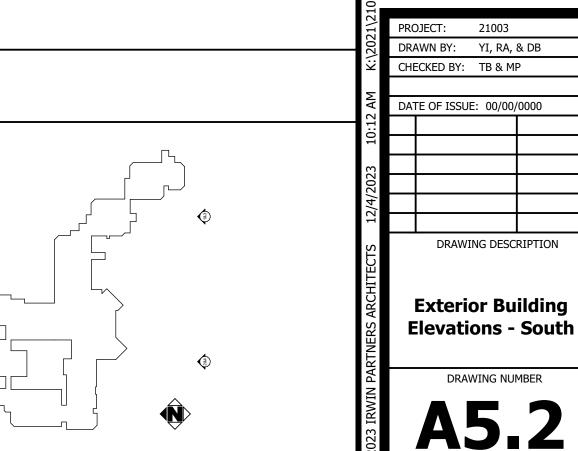




EXTERIOR FINISHES SIDING 1 - **SILVER SPRINGS** DUNN-EDWARDS **S1** (S2) SIDING 3 - WANDERING RIVER **S**3 TRIM - **RENWICK BROWN** (A1)

IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING 245 Fischer Avenue Suite B-2 Costa Mesa California 92626 T: 714 557 2448 www.ipaoc.com



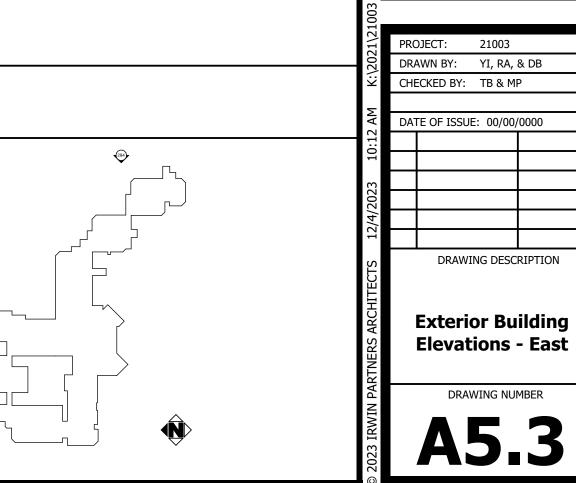




IRWIN PARTNERS ARCHITECT **S1** ARCHITECTURE PLANNING (S2) CONSULTING 245 Fischer Avenue **S3** Suite B-2 Costa Mesa California 92626

(A1)

T: 714 557 2448

www.ipaoc.com



DATE OF ISSUE: 00/00/0000 DRAWING DESCRIPTION **Exterior Building Elevations - West** DRAWING NUMBER



EXTERIOR FINISHES SIDING 1 - **SILVER SPRINGS** DUNN-EDWARDS DE6346 **S1** (S2) SIDING 3 - **WANDERING RIVER** DUNN-EDWARDS DE5850 **S3** TRIM - **RENWICK BROWN**DUNN-EDWARDS
DET630 <u>A1</u> **IRWIN PARTNERS** ARCHITECT ARCHITECTURE PLANNING CONSULTING 245 Fischer Avenue Suite B-2 Costa Mesa California 92626 T: 714 557 2448 www.ipaoc.com



Exterior Building Elevations - N/E Courtyard

East Courtyard Elevation - Proposed | 1/8" = 1'-0" | 1




EXTERIOR FINISHES SIDING 1 - **SILVER SPRINGS** DUNN-EDWARDS DE6346 **S1** SIDING 2 - **HEATHER** (S2) SIDING 3 - **WANDERING RIVER** DUNN-EDWARDS DE5850 **S3** TRIM - **RENWICK BROWN**DUNN-EDWARDS
DET630 (A1)

IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING 245 Fischer Avenue Suite B-2 Costa Mesa California 92626 T: 714 557 2448 www.ipaoc.com



Exterior Building Elevations - S/W Courtyard

West Courtyard Elevation - Proposed | 1/8" = 1'-0" | 1

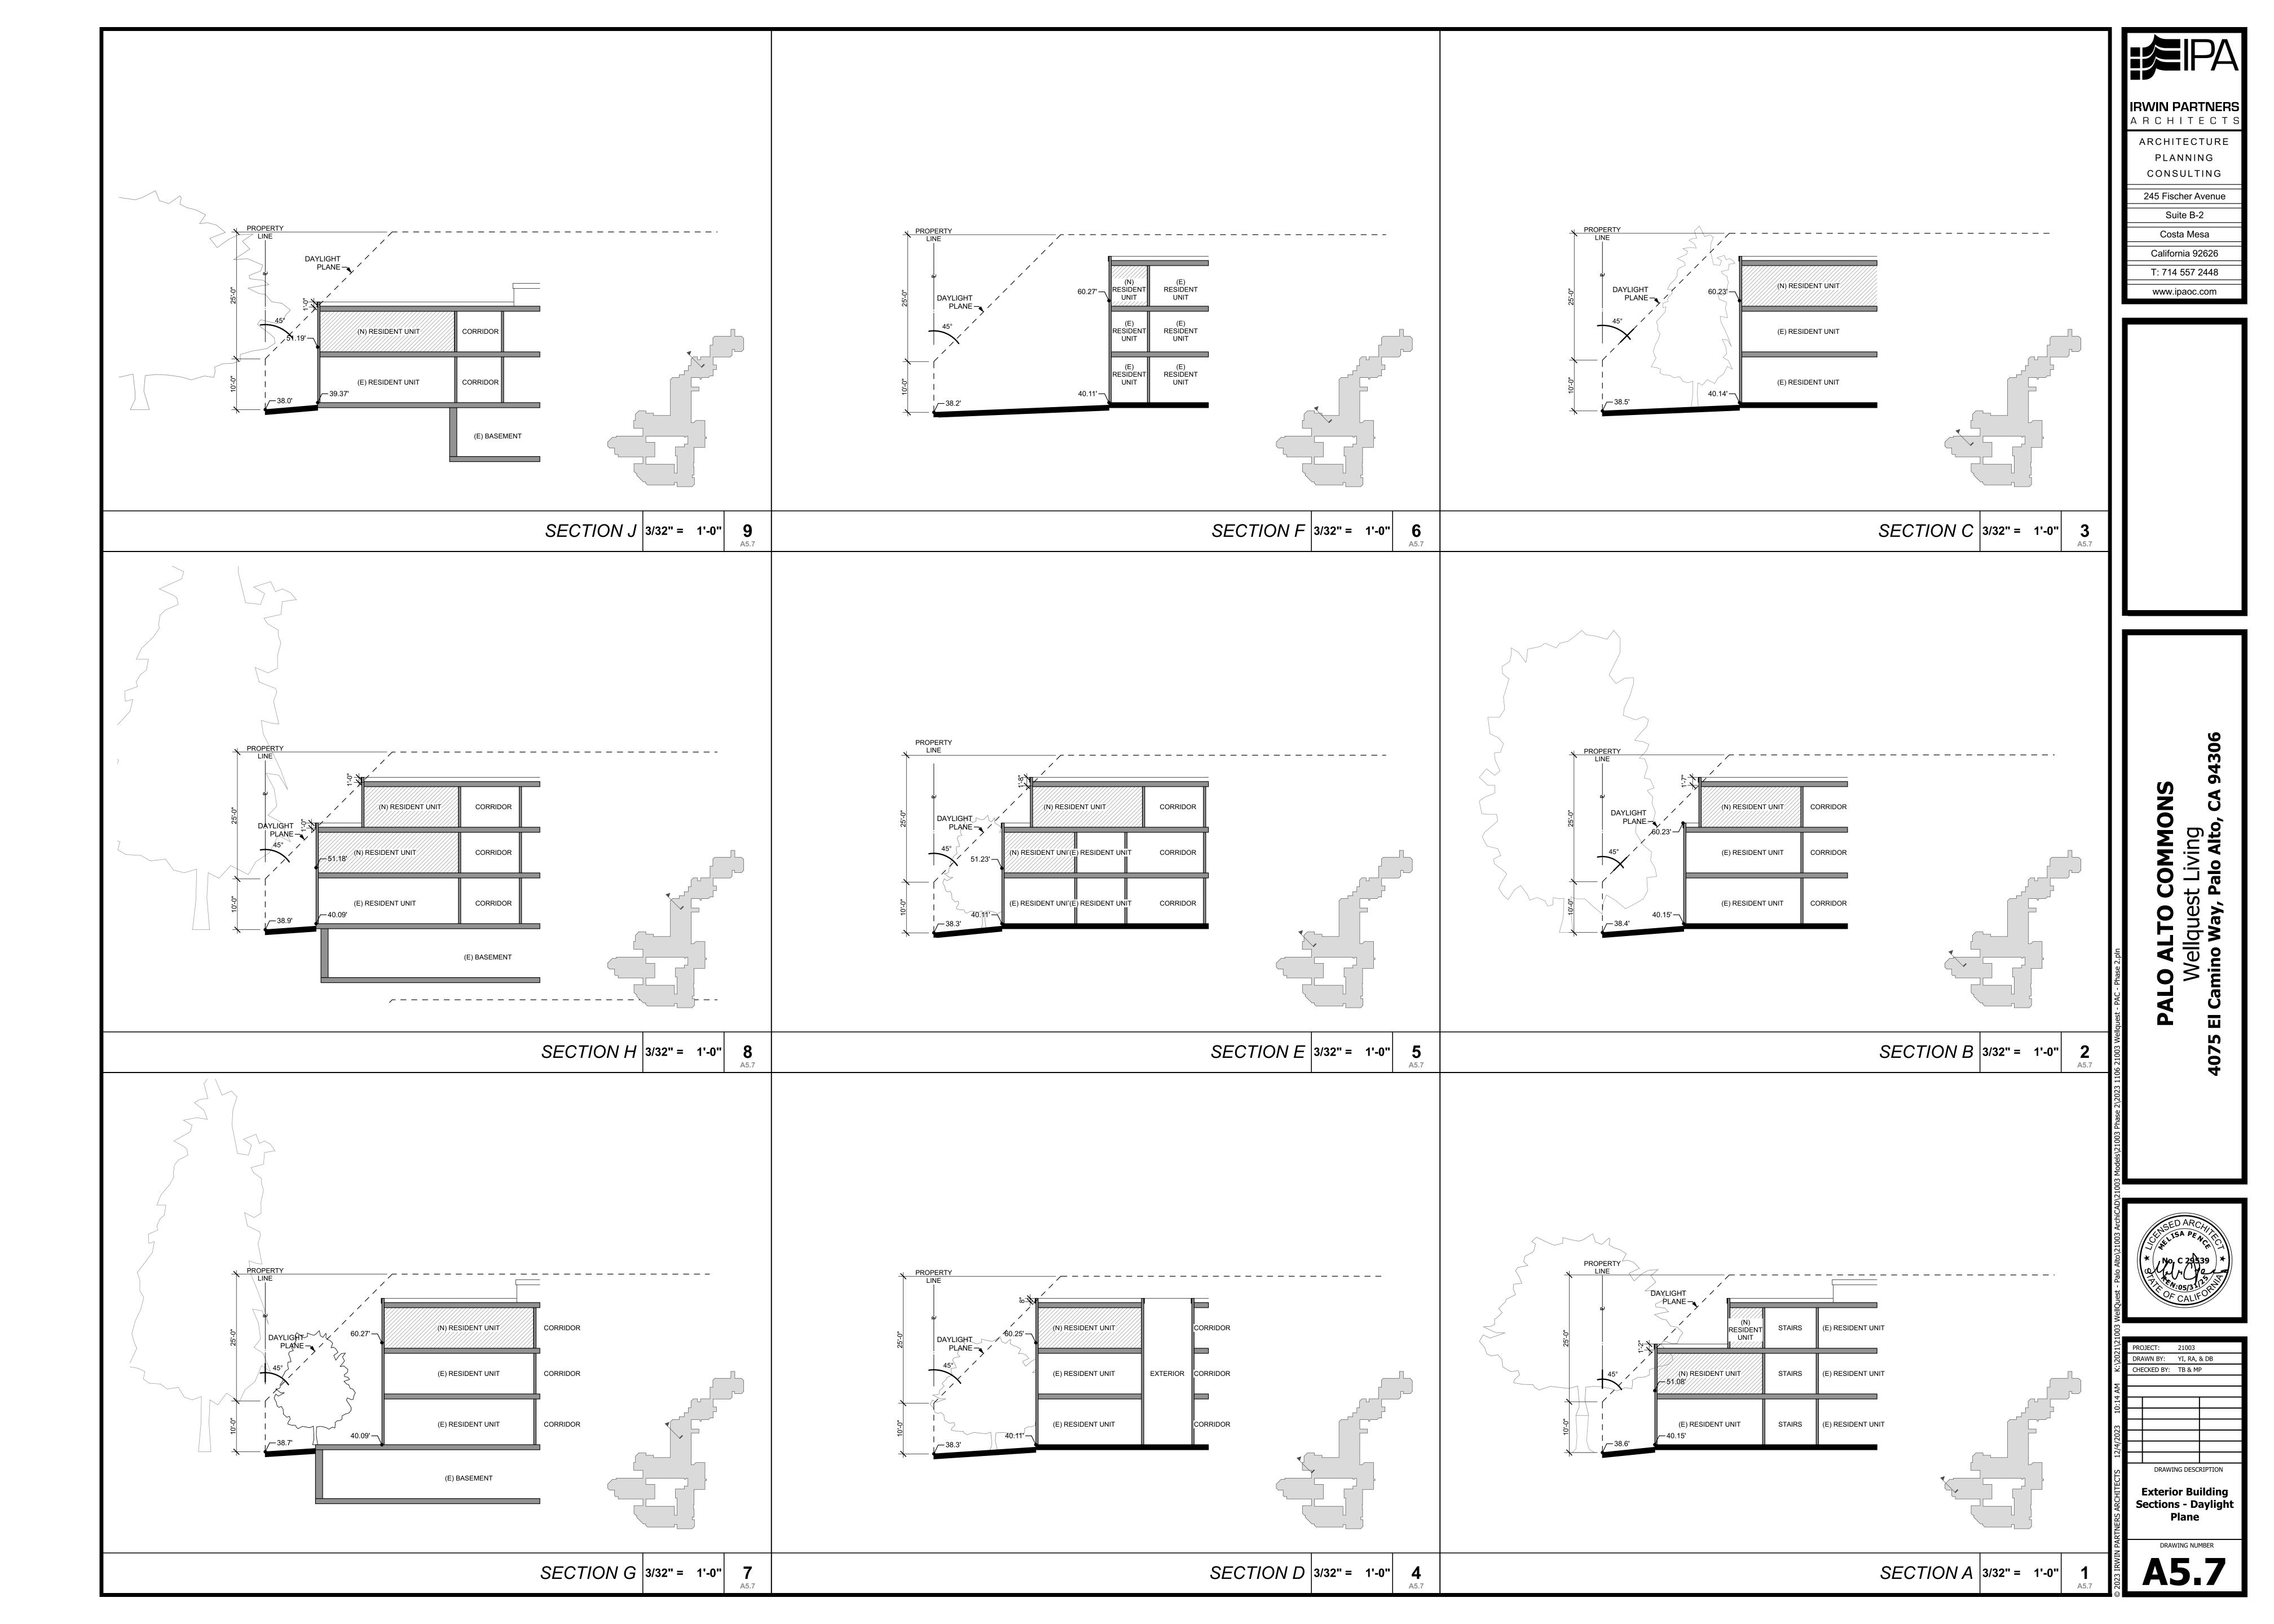

245 Fischer Avenue Suite B-2 Costa Mesa California 92626 T: 714 557 2448


www.ipaoc.com



PROPOSED OVERVIEW

EXISTING OVERVIEW




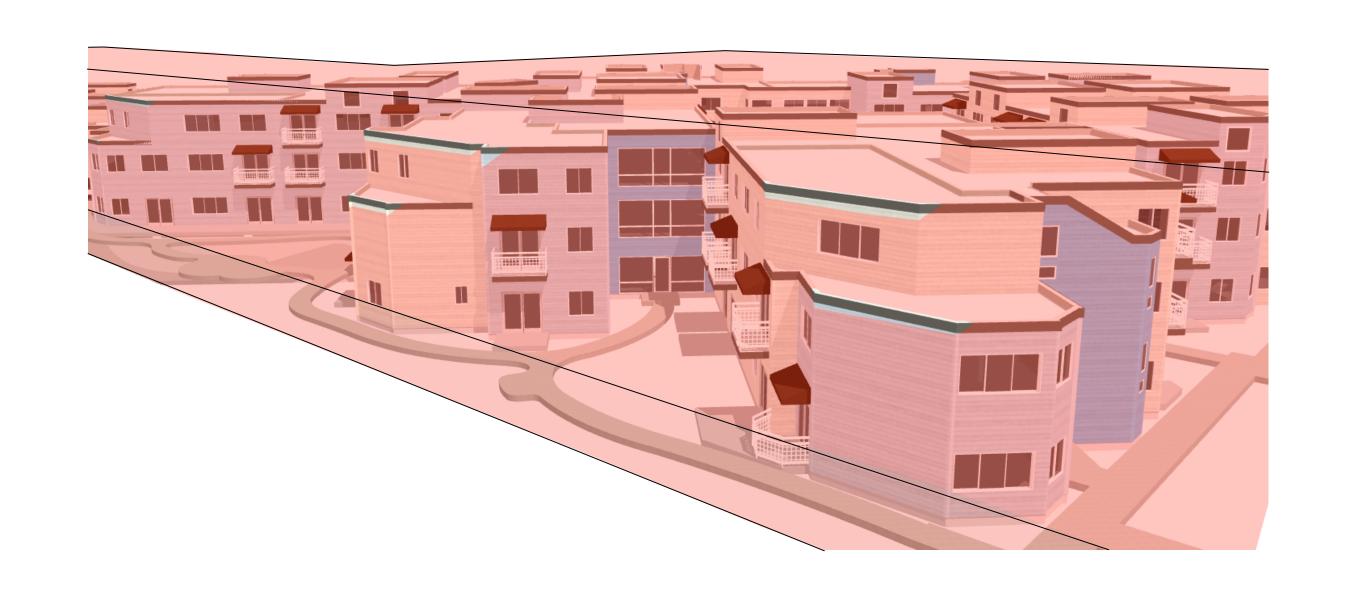

PROPOSED VEW 1

5A5.8


EXISTING VIEW 1



DATE OF ISSUE: 00/00/0000

Exterior Building Tent Diagrams -Daylight Plane

PROPOSED VIEW 2 EXISTING VIEW 2 A5.8

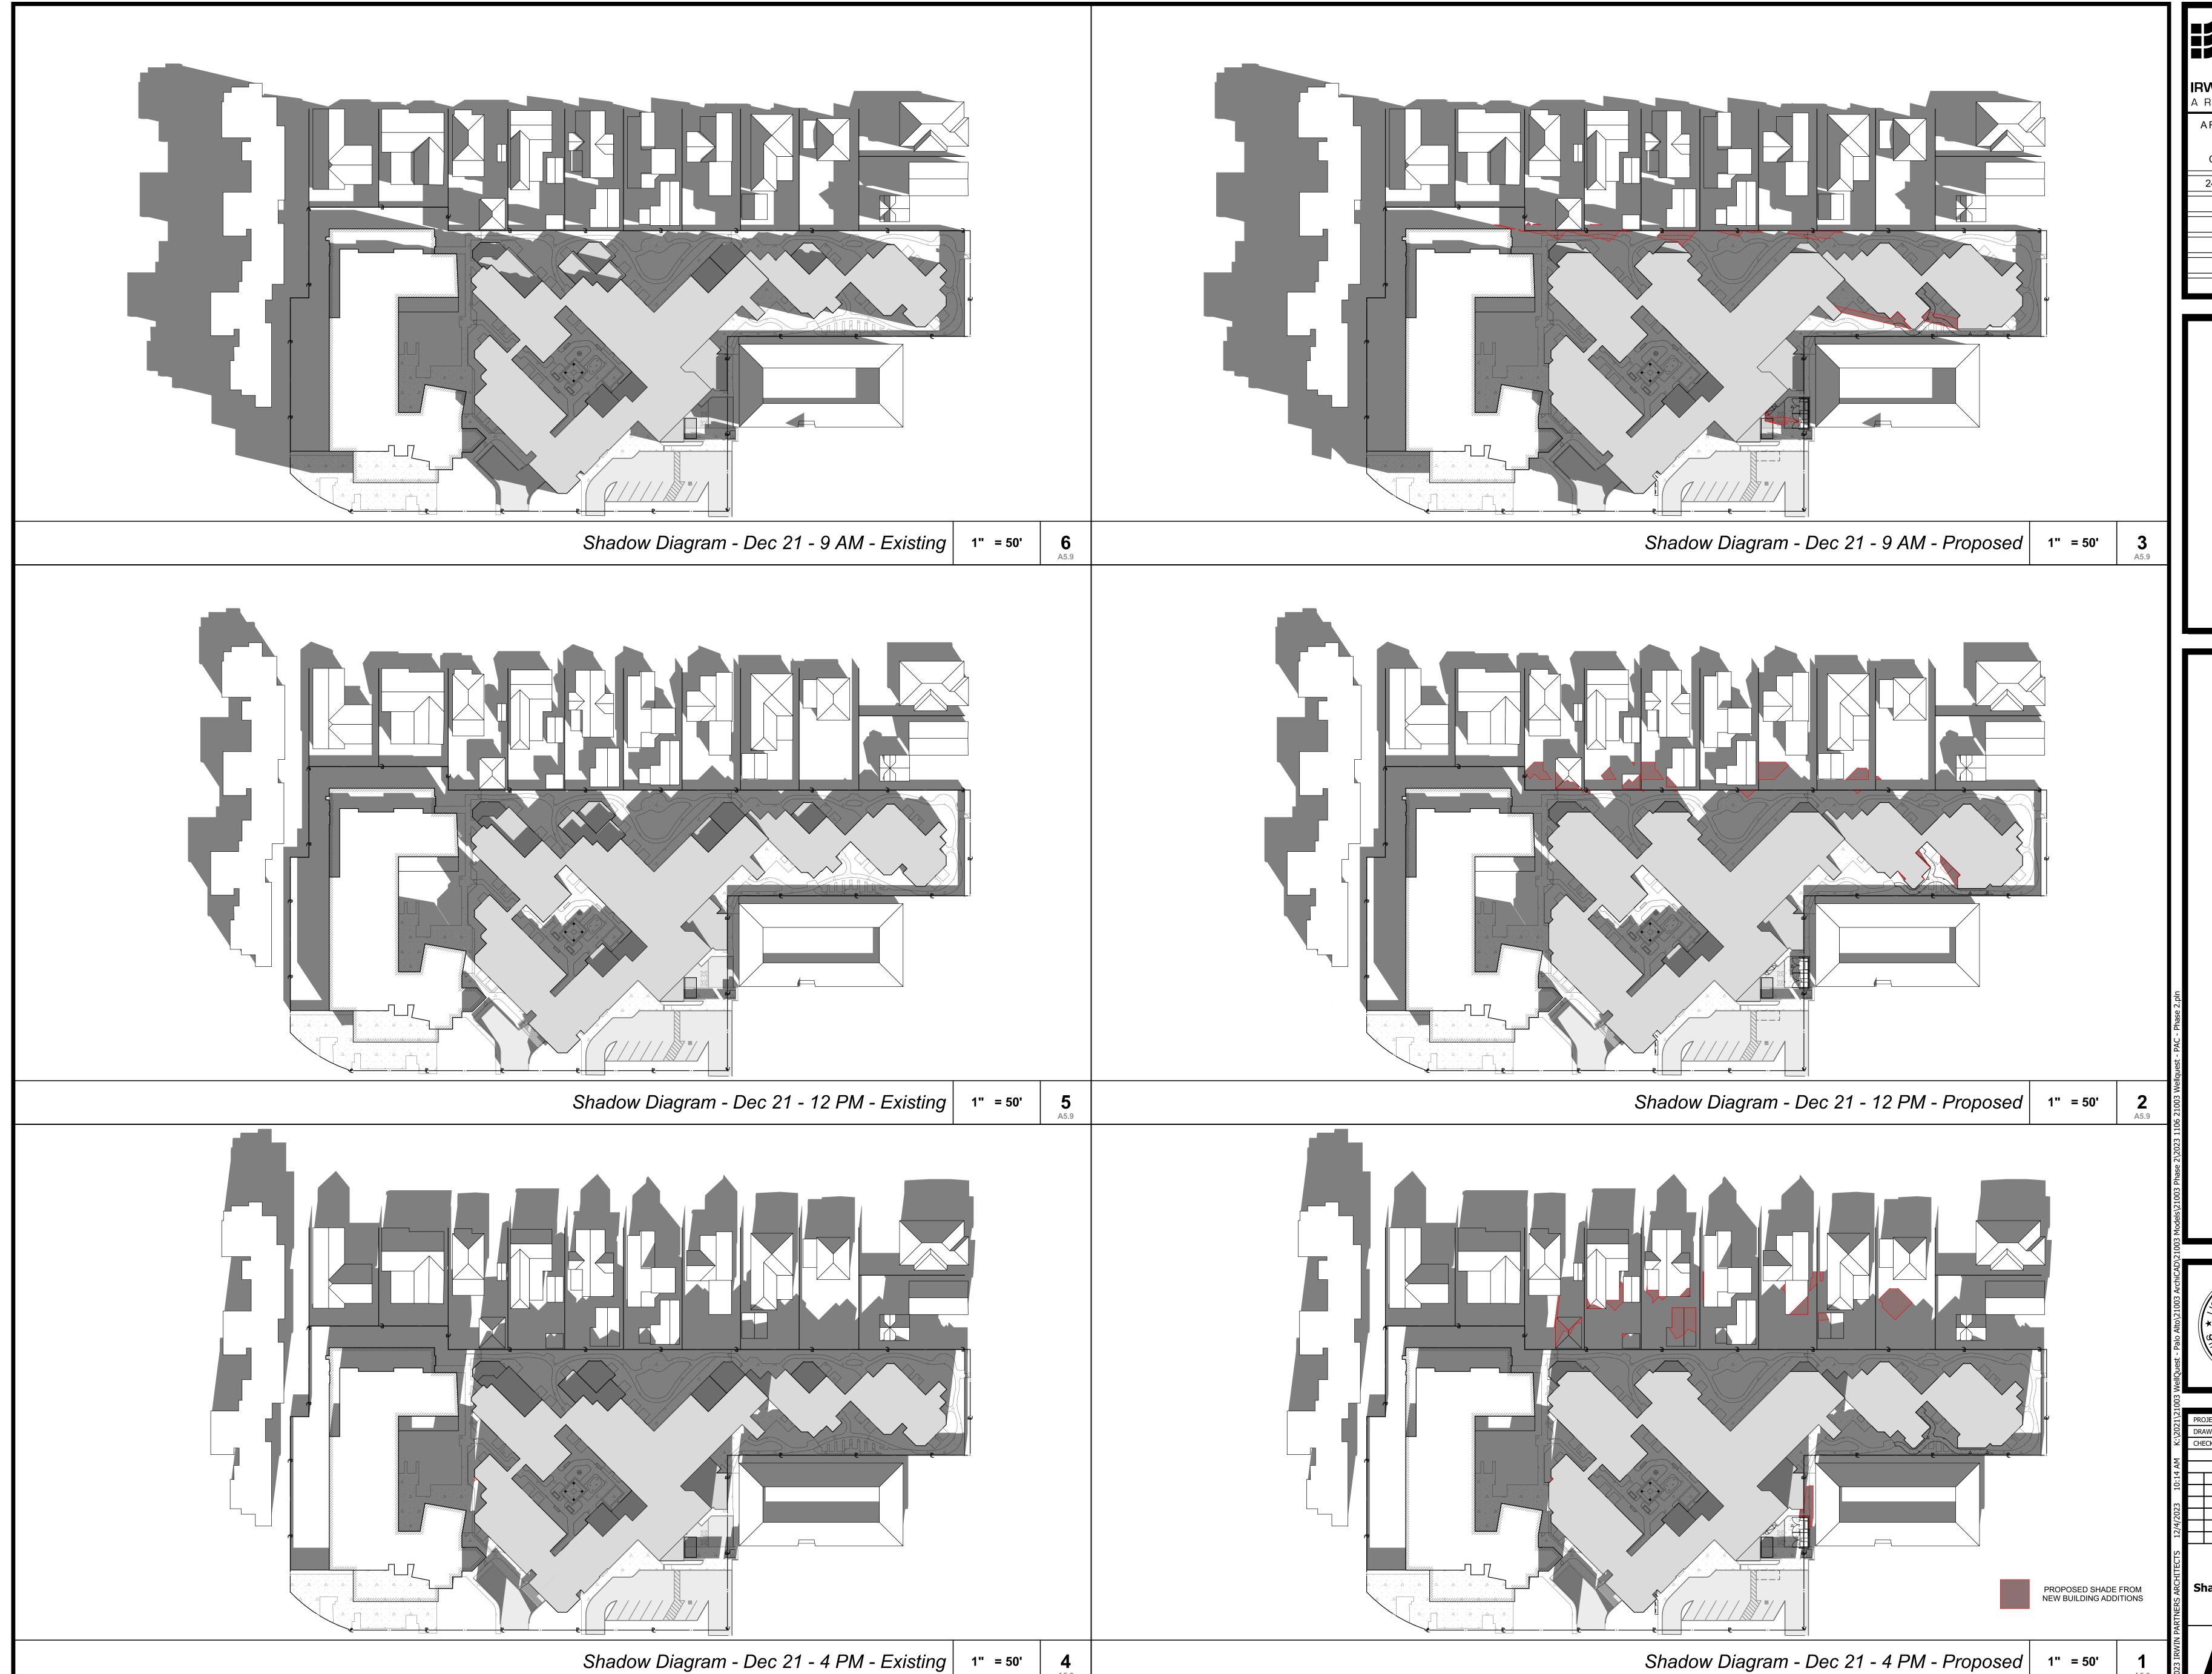

IRWIN PARTNERS ARCHITECTS

ARCHITECTURE

PLANNING CONSULTING 245 Fischer Avenue

Costa Mesa California 92626

T: 714 557 2448 www.ipaoc.com



Shadow Study - Dec



Shadow Diagram - March 21 - 6 PM - Existing


1" = 50'

IRWIN PARTNERS ARCHITECTS ARCHITECTURE

PLANNING CONSULTING

245 Fischer Avenue

Costa Mesa California 92626 T: 714 557 2448



Shadow Study March 21

Shadow Diagram - March 21 - 6 PM - Proposed 1" = 50'



IRWIN PARTNERS

IRWIN PARTNERS
ARCHITECTS

ARCHITECTURE
PLANNING
CONSULTING

245 Fischer Avenue

Costa Mesa
California 92626

T: 714 557 2448 www.ipaoc.com

Mellquest Living



PROJECT: 21003

DRAWN BY: YI, RA, & DB


CHECKED BY: TB & MP

DRAWING DESCRIPTION

Shadow Study -


June 21

DRAWING NUMBER

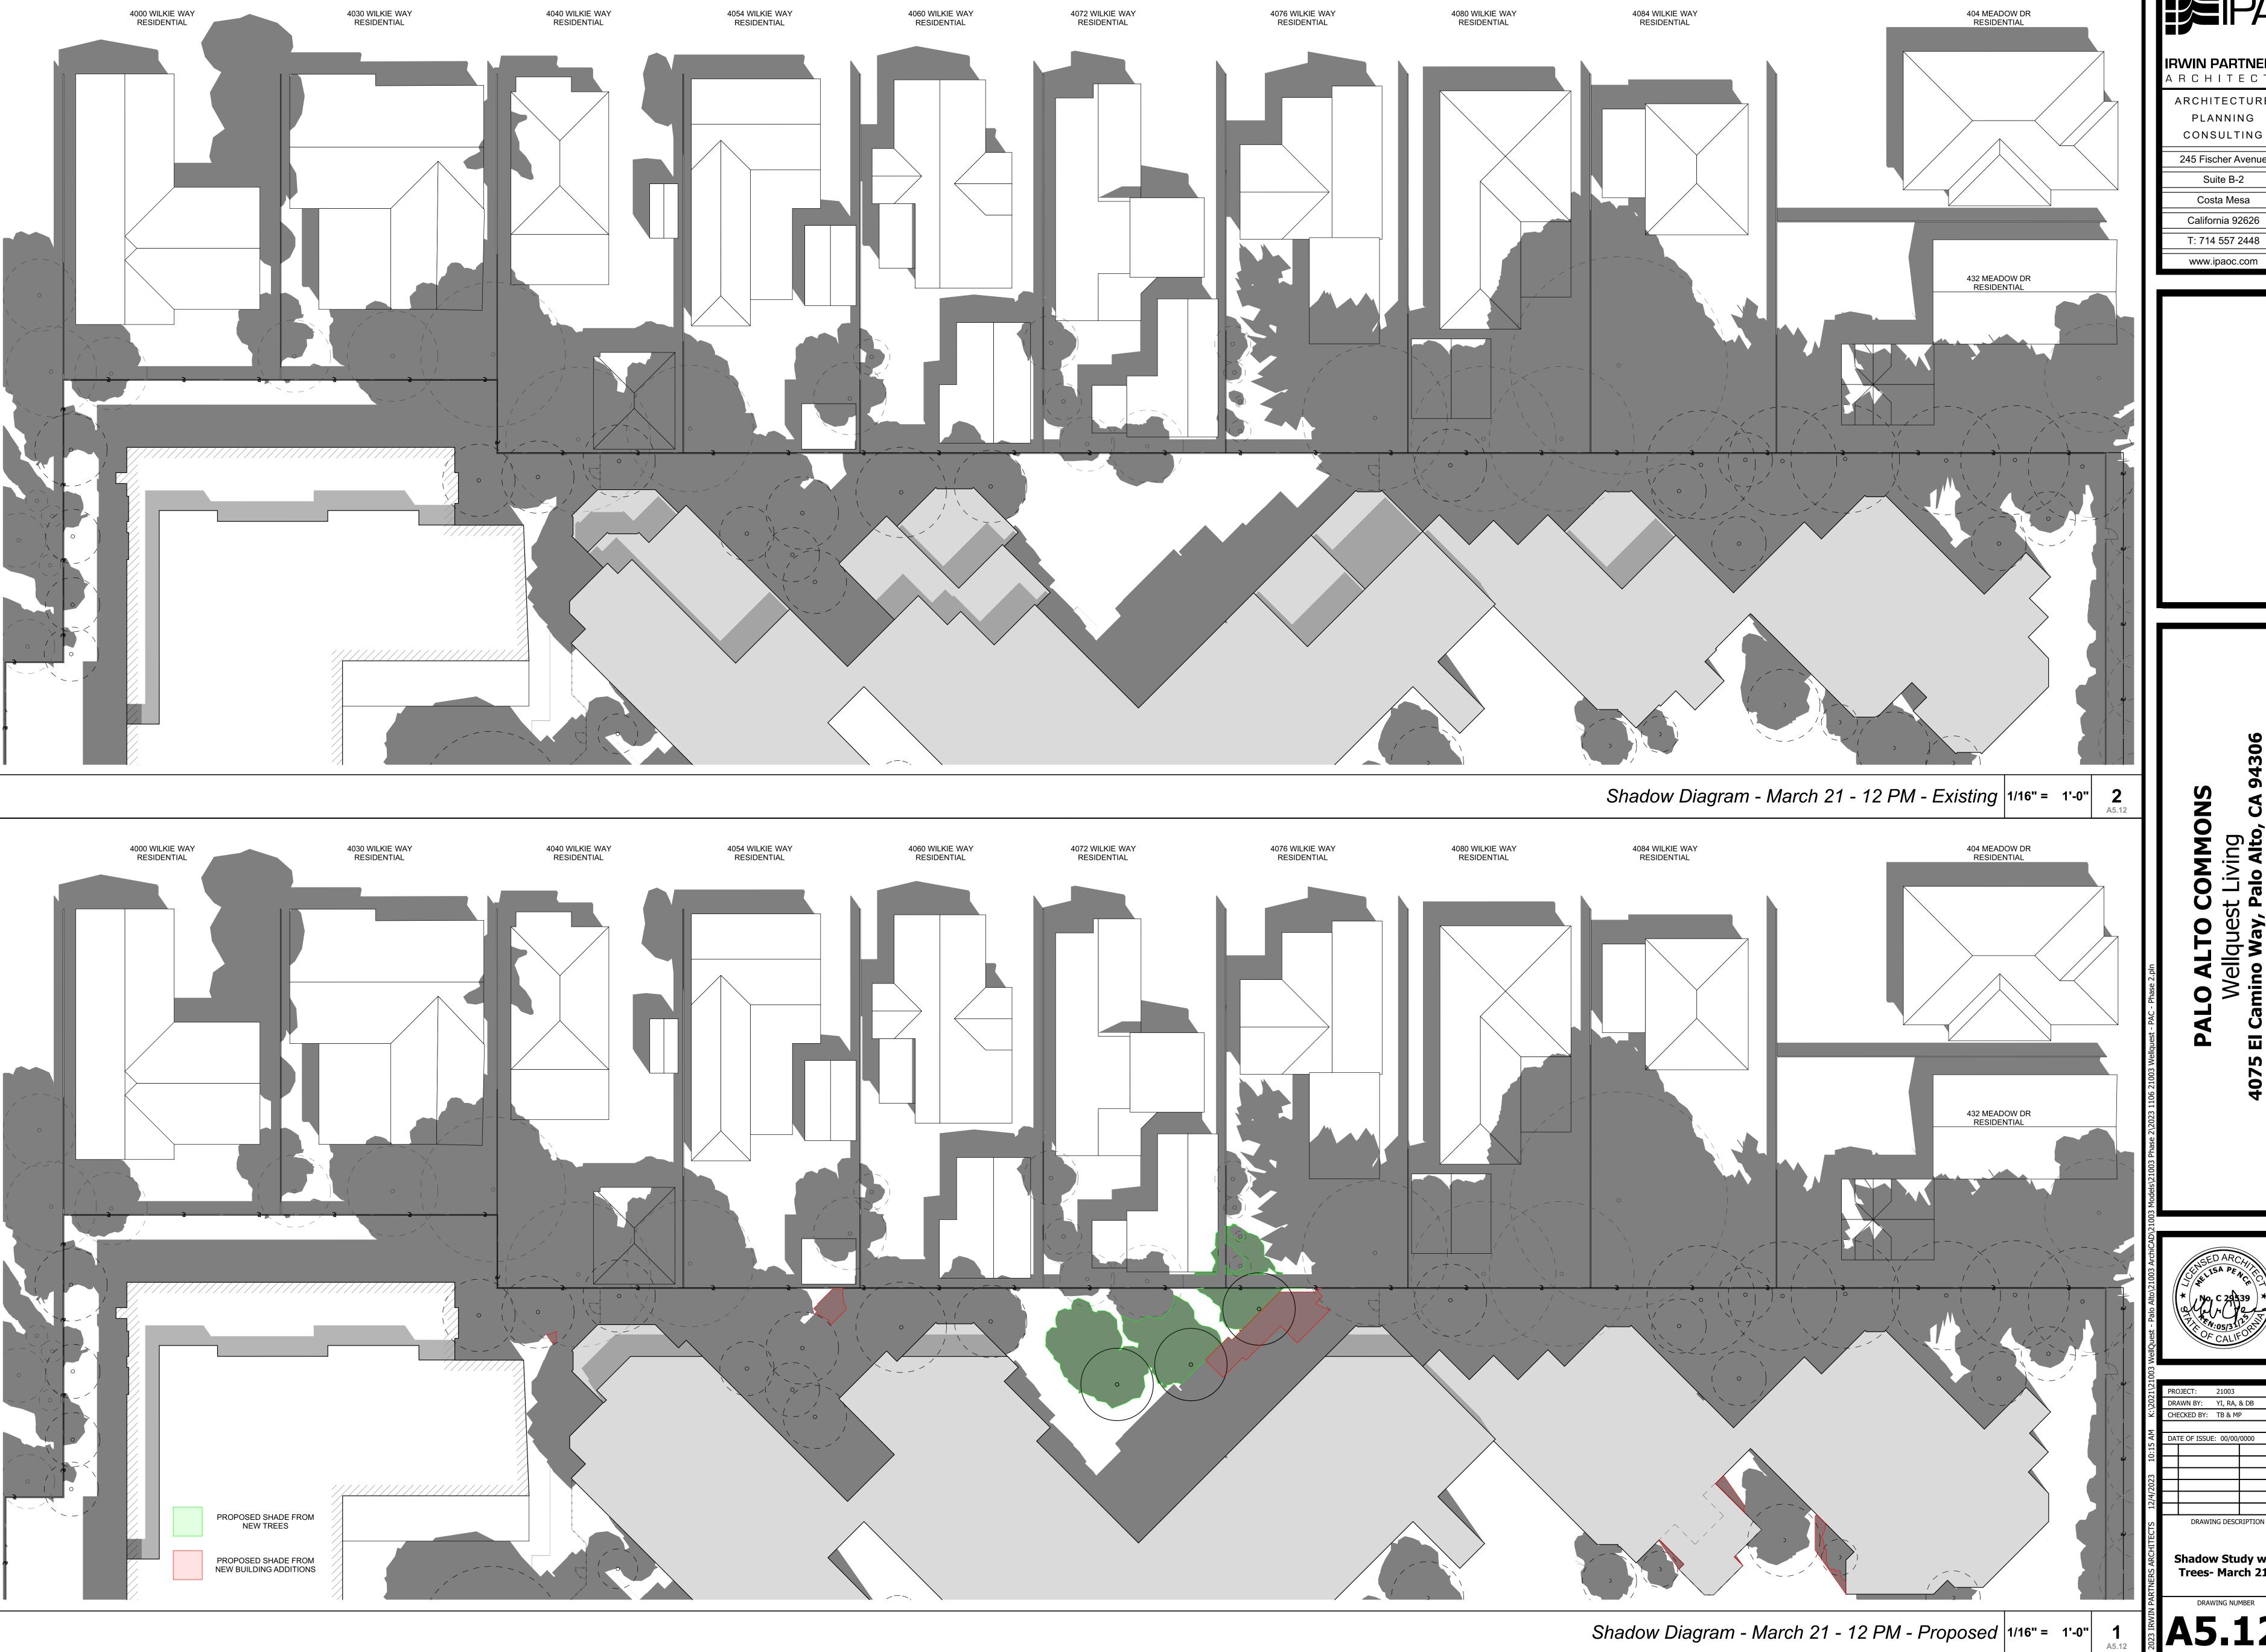

IRWIN PARTNERS ARCHITECTURE CONSULTING 245 Fischer Avenue Suite B-2 Costa Mesa California 92626


DRAWN BY: YI, RA, & DB
CHECKED BY: TB & MP DATE OF ISSUE: 00/00/0000 DRAWING DESCRIPTION Shadow Study w/ Trees- March 21

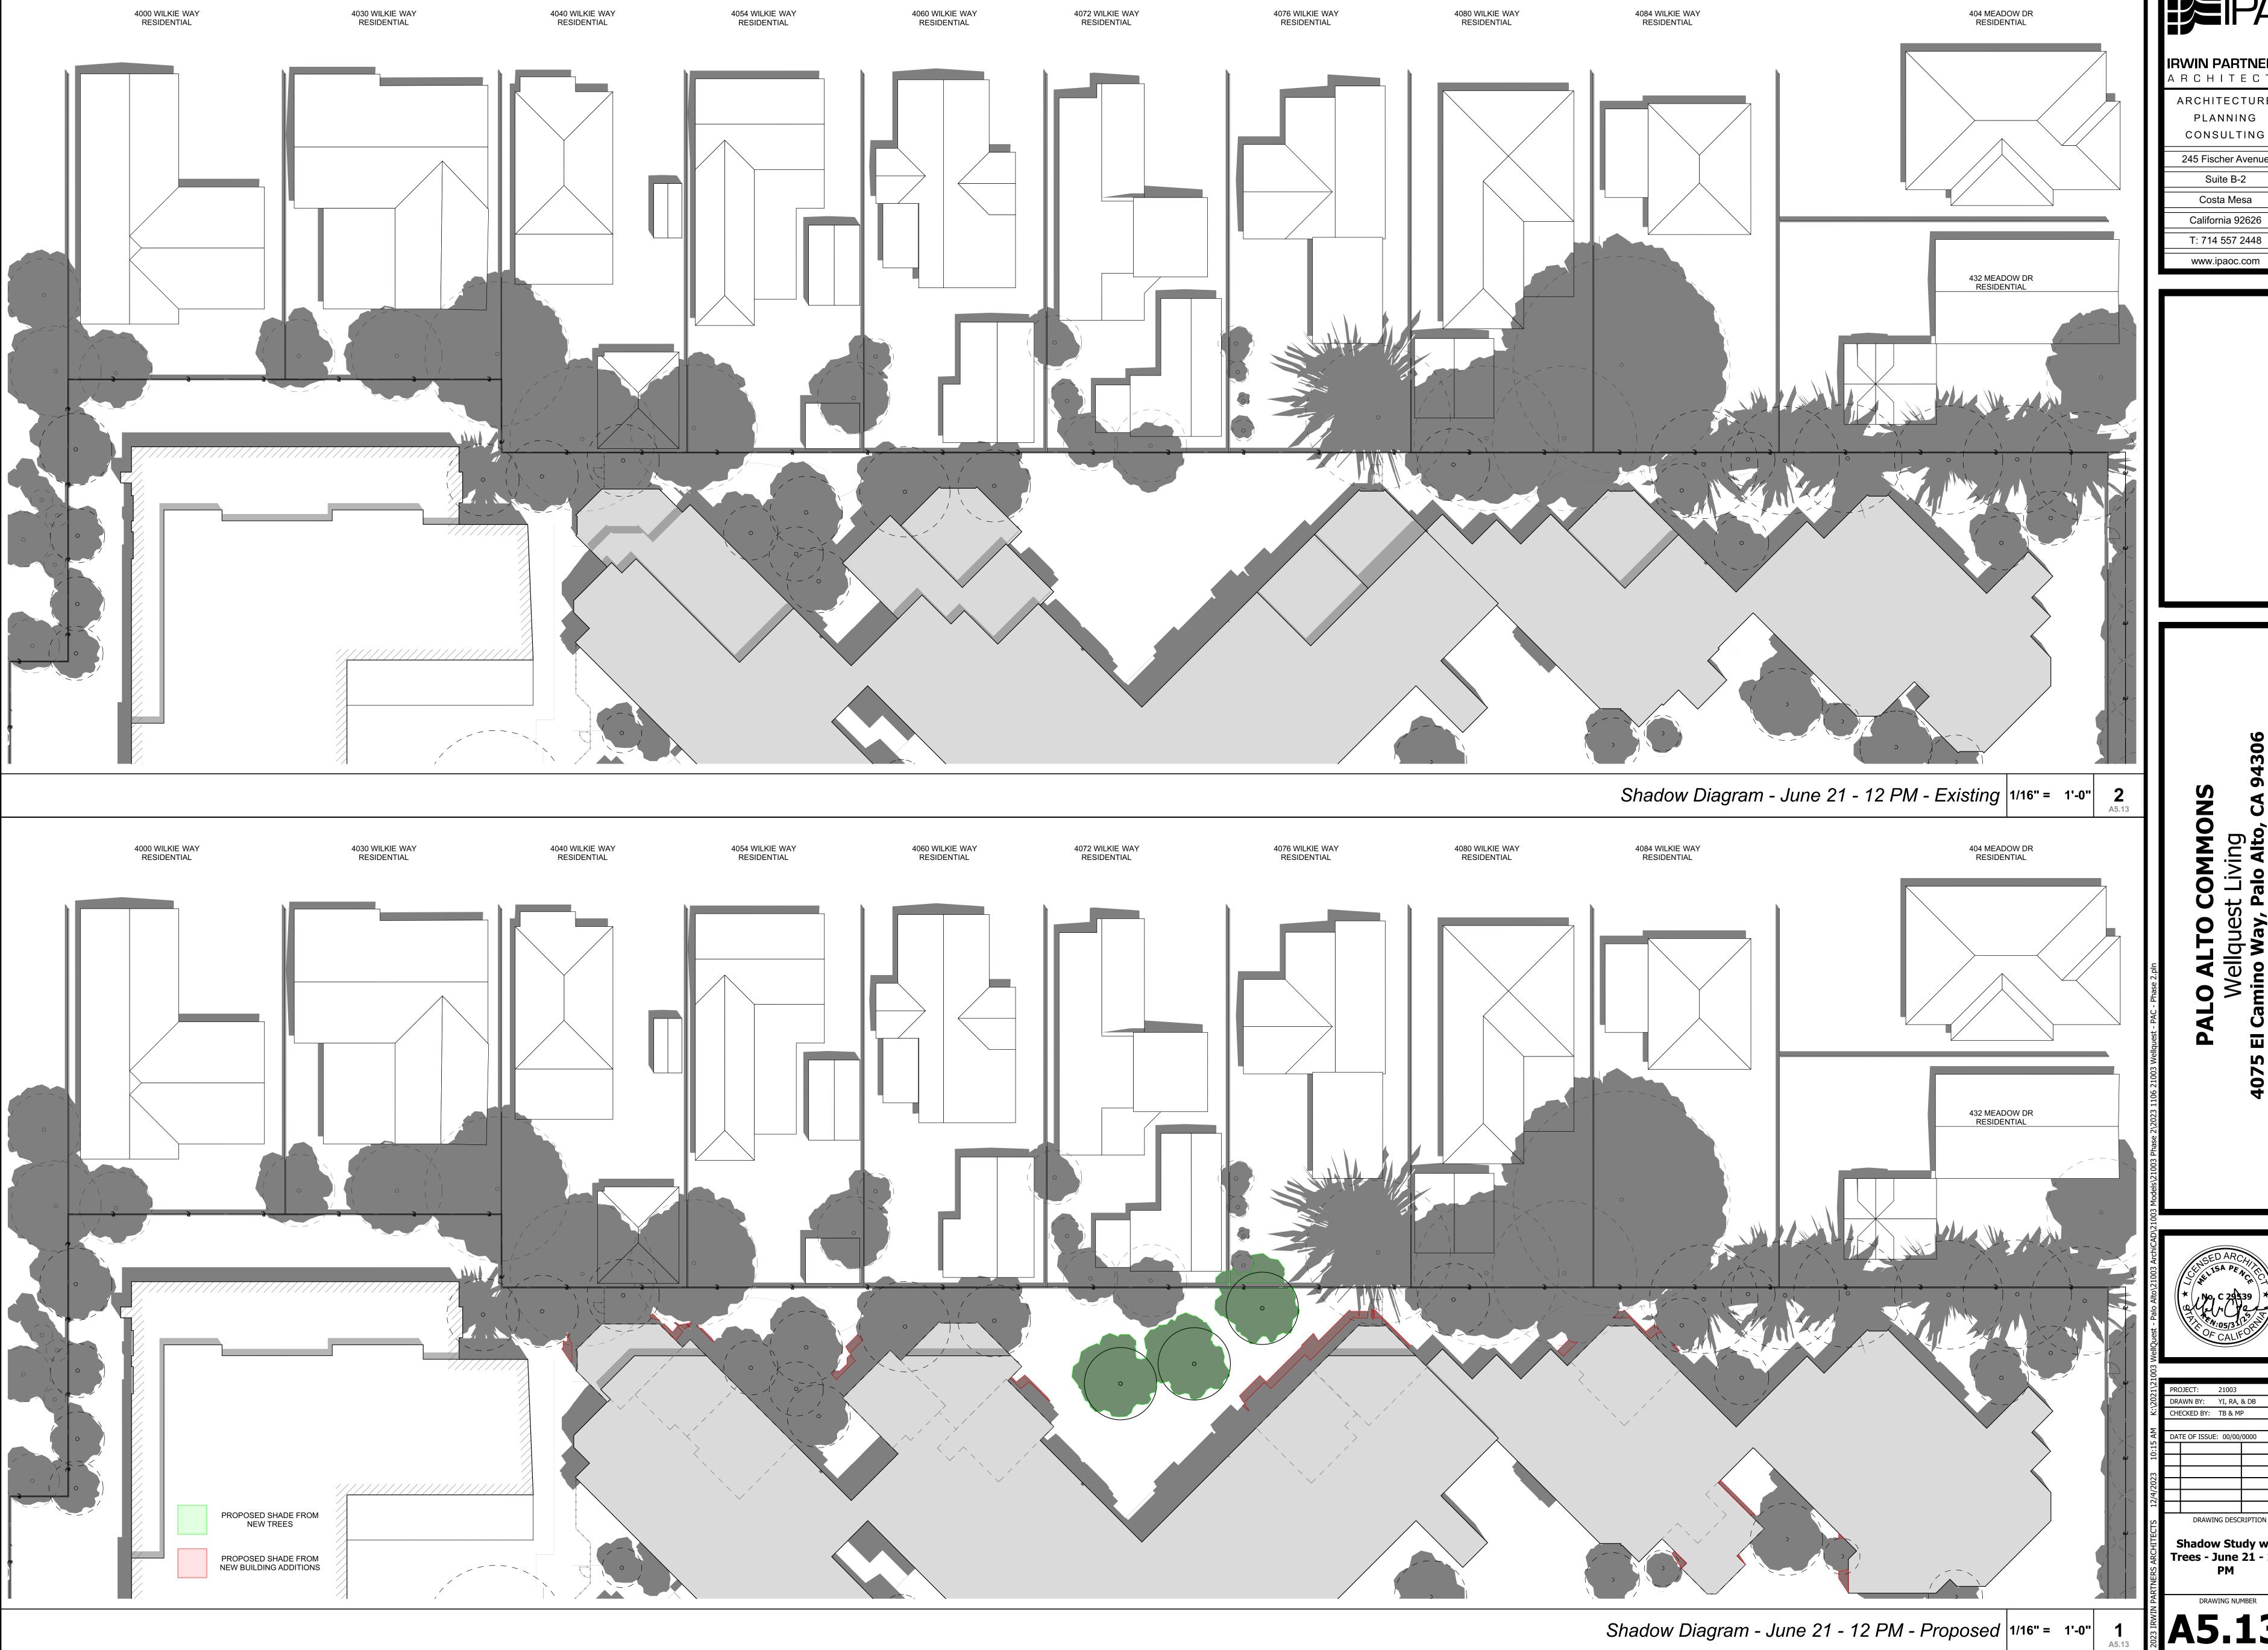

IRWIN PARTNERS ARCHITECT ARCHITECTURE PLANNING CONSULTING 245 Fischer Avenue Suite B-2 Costa Mesa California 92626 T: 714 557 2448




DRAWN BY: YI, RA, & DB
CHECKED BY: TB & MP DRAWING DESCRIPTION Shadow Study w/ Trees - June 21 - 12

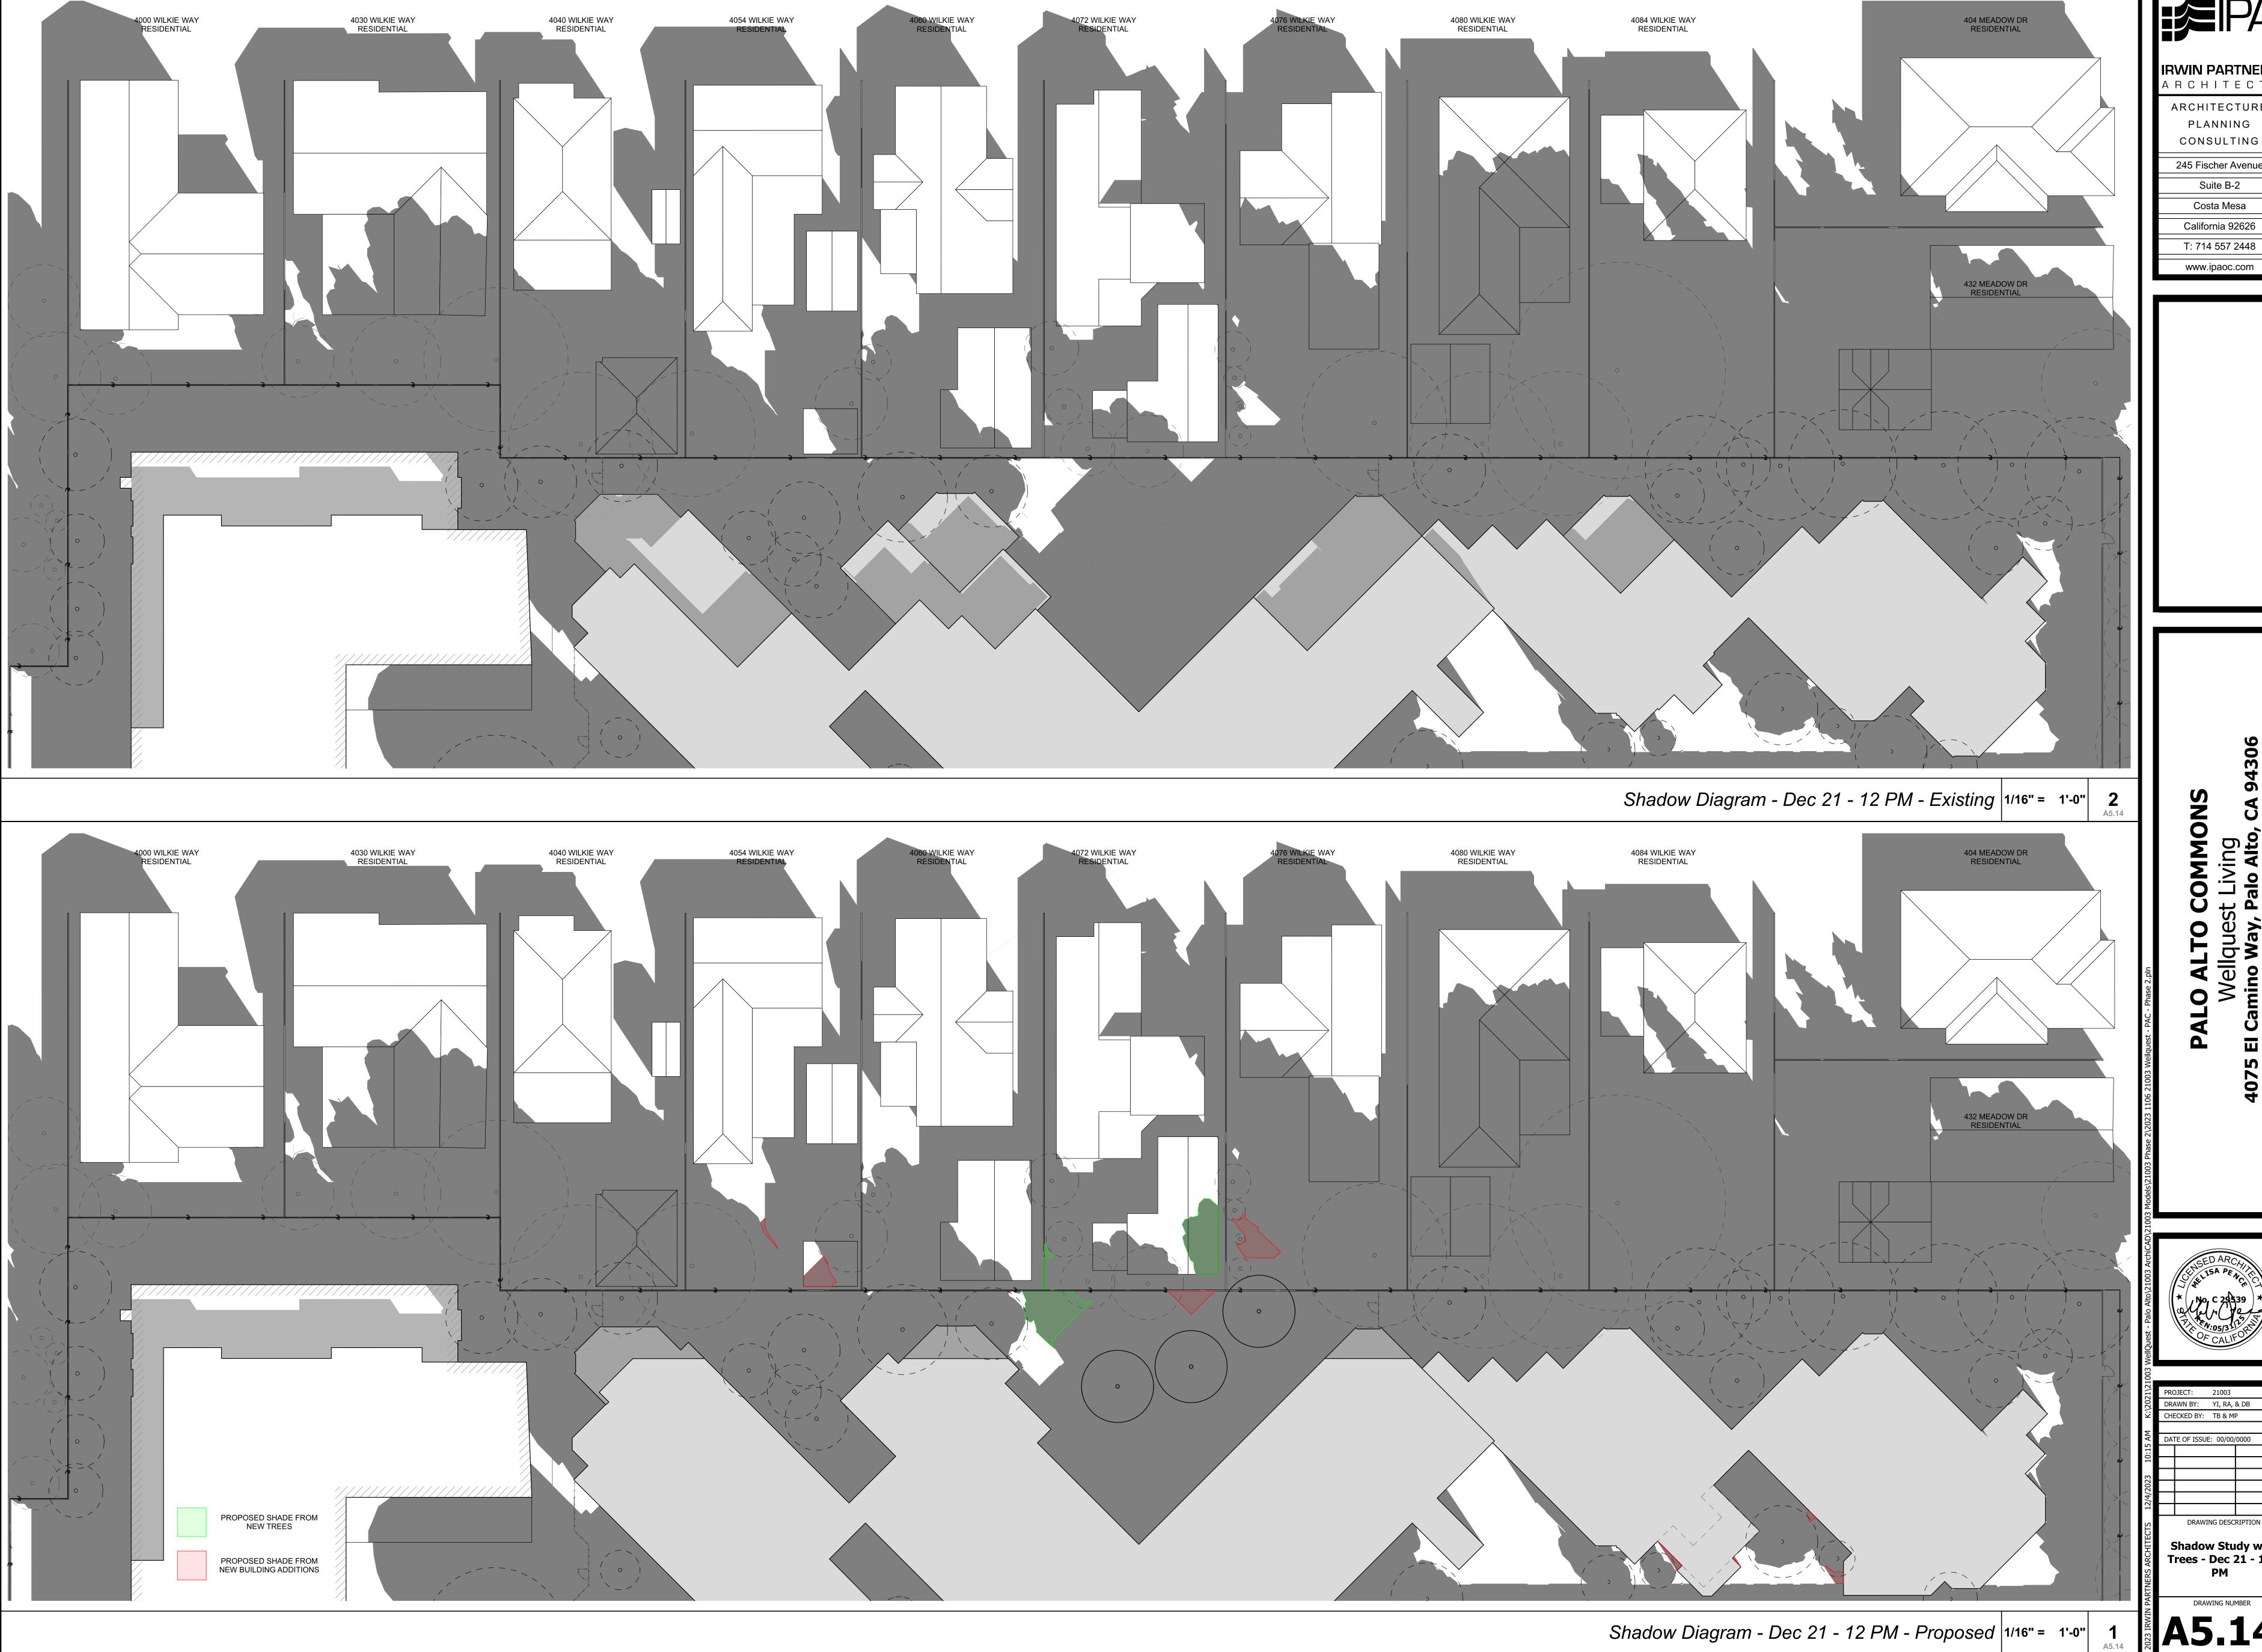





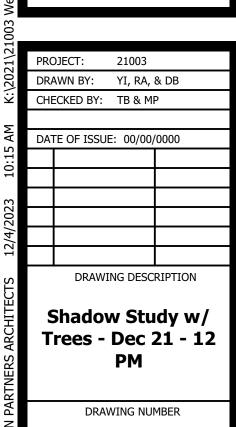





IRWIN PARTNERS ARCHITECTURE

245 Fischer Avenue Suite B-2 Costa Mesa California 92626

www.ipaoc.com



VellC				
K:\2021\21003 WellC				
1/2	PRO	DJECT:	21003	
\202	DRA	AWN BY:	YI, RA,	& DB
<u></u>	CHE	ECKED BY:	TB & M	P
-				
10:15 AM	DA	TE OF ISSUE	: 00/00/	/0000
0:1				
\vdash				
23				
/203				
12/4/2023				
_				
PARTNERS ARCHITECTS		Shadov		ıdy w/
ARG	1	Γrees -	Dec	21 - 4
ARTNERS			PM	
4		DRAV	VING NU	MBER

ABBREVIATIONS MAIN CIRCUIT BREAKER AMERICAN DISABILITIES ACT MECHANICAL ABOVE FINISHED FLOOR METAL HALIDE AIR HANDLING UNIT MAIN LUGS ONLY ACCESS PANEL AFCI ARC FAULT CIRCUIT INTERRUPTER MICROWAVE AMPERES INTERRUPTING CAPACITY (SYMMETRICAL) AMP SWITCH, AMP FUSE AS/AF NOT APPLICABLE AMP, A NORMALLY CLOSED ARCHITECTURAL ARCH NATIONAL ELECTRICAL CODE NATIONAL FIRE PROTECTION ASSOCIATION AMG AMERICAN WIRE GAUGE NORMALLY OPEN BFF BELOW FINISHED FLOOR BLDG BUILDING BKR BREAKER PULLBOX PHOTOCELL PHASE CEILING CLG POWER CONDUIT CIRCUIT BREAKER CB CKT RECEPTACLE CIRCUIT REFRIGERATOR DELTA CONNECTED REQD REQUIRED DIST DISTRIBUTION REVOLUTIONS PER MINUTE DEG DEGREE DMG DRAWING D/W DISH WASHER SUMP PUMP SPECIFICATION EXHAUST FAN SYMMETRICAL EG ELEC ELEV EQUIPMENT GROUND ELECTRICAL ELEVATOR TELCOM EQ **TELECOMMUNICATIONS** EQUIPMENT EP EXPLOSION PROOF **TELEVISION** TYPICAL FIRE ALARM CONTROL PANEL UNDERGROUND FDR FLA FULL LOAD AMPS UNINTERRUPTIBLE POWER SUPPLY FLUOR FLUORESCENT G/GND VOLT AMPERE GROUND FAULT CIRCUIT INTERRUPTER VOLTAGE DROP GFCI VOLTS/PHASE/HERTZ HORSE POWER HPS HVAC HIGH PRESSURE SODIUM **WEATHERPROOF** HEATING, VENTILATION, AND AIR CONDITIONING INCAND INCANDESCENT TRANSFORMER TRANSFER JUNCTION BOX JB/JB0X MYE CONNECTED KILOVOLT AMPERES KVA KM KILOWATTS KMH KILOWATTS PER HOUR KCMIL THOUSAND CIRCULAR MILS LCP LIGHTING CONTROL PANEL

LPS

MAX

LTG/LTS

LOW PRESSURE SODIUM

LIGHTING

MAXIMUM

METER

	ELECTRICAL SYMBOLS
	NOTE: 'NL' DENOTES 90 MINUTE BATTERY BACKUP
SYMBOL 1	MEANING
\$	SMITCH
\$ a	3-MAY SMITCH
HD	DIMMER SMITCH
	HIGH EFFICACY FIXTURE (CEILING)
ф.	HIGH EFFICACY FIXTURE (WALL)
Ф	HIGH EFFICACY FIXTURE (RECESS)
- ∲-	PENDANT LIGHT FIXTURE (CEILING)
NL O	I'X4' LED STRIP LIGHT
0	2'X4' LED STRIP LIGHT
NL S	EXHAUST FAN
©	UL 2034/2075 CARBON MONOXIDE ALARM
9	UL 2034/2075 SMOKE DETECTOR
	ELECTRICAL PANEL
	DUPLEX RECEPTACLE
	240V RECEPTACLE
	QUADPLEX RECEPTACLE
	FLOOR RECEPTACLE
	JUNCTION BOX
O _{NL}	RECESSED DOWNLIGHT
HPC-2,4,6	HOMERUN: HPC=PANEL DESTINATION, 2,4,6=CIRCUITS
Ç	CIRCUIT BREAKER
ŷ	FUSE
	EXHAUST FAN/ LED LIGHT COMBO (RECESSED)
- B	DOOR BELL
Ş	MANUAL MOTOR RATED SWITCH
©	VACANCY SENSOR
마	3 POLE DISCONNECT SMITCH
<u> </u>	GROUND

ELECTRICAL GENERAL NOTES

1. The entire installation shall comply with 2017 NEC, 2019 California Energy Code, 2019
California Electrical Code, and all applicable local codes and regulation.

2. All electrical prefabricated equipment shall be designed and constructed in such a manner that all portions, elements, sub-assemblies and/or parts of said equipment, and the equipment as a whole including its attachments, will resist a load which exceeds the force level used to restraint and anchor the equipment to the supporting structure.

3. All electrical materials and equipment shall be new and shall be listed by Underwriter's Laboratories (UL) and bear their label or listed or certified by a nationally recognized testing authority where UL does not have a listing. Custom made equipment shall have complete test data submitted by the manufacturer attesting to its safety. In addition, the materials, equipment, and installation shall comply with the requirements of the following:

American Society of Testing Materials (ASTM) Insulated Power Cable Engineers Association (IPCEA) American Standard Association (ASA) National Fire Protection Association (NFPA) American National Standard Institute (ANSI) NEC National Electrical Code (NEC) Institute of Electrical and Electronic Enginners(IEEE) All local codes having jurisdiction

Where the codes have different levels of requirements, the most stringent rule shall apply.

4. The contractor shall visit the site including all areas indicated on the drawings. He shall thoroughly familiarize himself with the existing conditions and by submitting a bid, accepts the conditions under which he shall be required to perform his work.

5. It shall be contractor's responsibility to obtain a complete set of contract documents, addenda, drawings and specifications. He shall check the drawings of the other trades and shall carefully read the entire specifications and determine his responsibilities. Failure to do so shall not release the contractor from doing the work in complete accordance with the drawings and specifications.

6. The contractor shall coordinate his work with other trades at the site. Any costs to install work to accomplish said coordination which differs from the work as shown on the drawings shall be incurred by the contractor. Any discrepancies, ambiguities or conflicts shall be brought to the attention of the engineer during bid time for clarification. Any such conflicts not clarified prior to bid shall be subject to the interpretation of the engineer at no additional cost to the owner.

7. The contractor shall provide and keep up-to-date a complete record set of drawings. These prints shall be corrected accordingly and show every change from the original drawings. This set of drawing shall be kept on the job site and shall be used only as a record set. This shall not be construed as authorization for the contractor to make changes in the layout without definite instruction in each case. Upon completion of the work, a set of reproducible contract drawings shall be obtained from the engineer, and all changes as noted on the record set of drawings shall be incorporated on reproducible bond with black ink in a neat, legible, understandable and professional manner per Client's request.

8. In some instance, it may be necessary to defer work in certain areas and locations until such time as existing facilities can be temporarily or permanently rearranged by the owner. Therefore, whenever it becomes necessary for the contractor to perform work under this contract in existing areas in which the owner's work is being performed, the contractor shall advise the owner relative to this requirement and shall follow closely the directive issued by the engineer insofar as time and procedure are concerned.

9. All interruption of electrical power shall be kept to a minimum. However, when an interruption is necessary, the shutdown must be coordinated with the owner 7 days prior to the outage. Any overtime pay and work required to be accomplished on weekends shall be included in the contractor's bid. Work in existing switchboards or panelboards shall be coordinated with the owner prior to removing access panels or doors.

10. It shall be responsibility of the contractor to review and to coordinate with the mechanical, fire protection and plumbing drawings for duct lines and equipment.

11. All equipment mounted on roof for connection of HVAC equipment shall be mounted on unistrut stands utilizing approved pitch pockets, flashing, etc..

12. After all requirements of the specifications and/or the drawings have been fully completed. representatives of the owner will inspect the work. The contractor shall provide competent personnel to demonstrate the operation of any item or system to the full satisfactory of each representative. Final acceptance of the work will be made by the owner after receipt of approval and recommendation of acceptance from each representative.

13. The contractor shall furnish a one year written guarantee of materials and workmanship from the date of substantial completion.

14. Coordinate with other trades as to the exact location and configuration of their respective equipment, supply power and make connection to motors and equipment requiring electrical connections as indicated on the single line diagram, electrical drawings and drawings of other trade. Review the drawings of other trades for control diagram, size and locations of equipment. Disconnect switches, starters, wiring, controls and conduit for mechanical and plumbing operations shall be provided. The contractor shall be responsible for obtaining manufacturer's shop drawings prior to roughing in all conduit to this equipment.

15. Exact method and location of conduit penetration and openings in concrete or masonry walls, gradebeams, floors or structural steel members shall be as directed by the structural engineer. Perform coring, sawcutting, patching, and refinished of walls and surfaces wherever it is necessary to penetrate openings shall be sealed in an approved method to meet the fire rating of the particular wall, floor or ceiling. Exact method and locations of conduit penetrations and openings in concrete walls or floors shall be for UL approved systems.

16. Connections to vibrating equipment, mechanical and plumbing equipment and seismic separations:

Liquid-tight conduit in all locations Maximum length of flexible conduit runs shall be 6'-0" u.O.N.

17. Equipment outlets, lighting fixtures, conduit, wire and connection methods in HVAC air-plenums shall be approved for use in plenums and shall conform to 2019 CEC.

18. Conduit shall not be installed in any floor slab. Conduit shall be installed concealed in the ceiling space, concealed in walls, or below slab on grade. Unless otherwise noted.

19. Whenever a discrepancy in quantity or size of conduit, wire, equipment devices, circuit breakers, ground fault protection system, etc., (all materials), arises on the drawings or specifications, the contractor shall be responsible for providing and installing all materials and services required by the strictest conditions noted on the drawings or in the specifications to ensure complete and operable systems as required by the owner and engineer.

20. It shall be contractor's responsibility to verify type of ceiling systems and to furnish approved lighting fixtures of the type required for mounting in subject ceiling. Where fixtures are recessed in plaster or drywall ceilings, they shall be complete with necessary mounting hardware and plaster frames.

21. All recessed lighting fixtures, speakers, receptacles, switches, etc., mounted in the fire rated ceilings or walls shall be enclosed with an approved enclosure carrying the same fire rating as the ceiling or wall by this contractor.

22. Utility penetrations of any kind in fire and smoke partitions and ceiling assemblies, shall be firestopped and sealed with an approved material securely installed. Utility and electrical outlets or boxes shall be securely fastened to the stud of framing of the wall, partition or ceiling assembly. The opening in the gypsum board facing shall be cut so that the clearance between the box and the gypsum board does not exceed 1/8 inch. In smoke walls or partitions, the 1/8 inch clearance shall be filled with an approved fire-rated sealant.

23. Architectural reflected ceiling plans indicating the location of lighting fixtures shall take precedence over the locations of same shown on the electrical drawings. Install the lighting fixtures in any given area to agree with the reflected ceiling plans. Discrepancies shall be brought to the attention of the architect.

24. The exact locations and mounting heights of lighting fixtures located in mechanical equipment spaces and storage shall be coordinated in the field before installation to avoid interferences with ducts, piping and other mechanical equipment and all mounting hardware shall be included in base bid. When locations and mounting heights are determined, obtain approval from the engineer prior to installation.

25. Maximum number of conductors in outlet or junction boxes shall conform to 2019 CEC.

26. The exact locations of all electrical devices and equipment shall be coordinated with the architectural elevations, details or sections prior to installation. All electrical devices and equipment shall be recessed in walls, unless otherwise noted. Outlets not indicated on architectural elevations shall be coordinated with the architect prior to rough-in, unless otherwise noted.

27. Review architectural elevations of casework. Outlets mounted above or below, or adjacent to casework shall be coordinated with the architectural drawings, prior to final rough-in. Electrical drawings shall govern number and type of outlets. However, locations shall be as indicated on architectural elevations. Provide conduit, wires and outlets for work required in casework installations. Reference architectural details for method of routing conduit within casework construction. Provide box extensions through all casework. Finish flush with face of splash, cabinets, etc. Mounting heights of all devices and equipment are from finished floor to center of devices and equipment, unless otherwise noted. Boxes installed in locations not approved by the architect shall be relocated as directed by the architect at no additional cost to the owner.

28. Drawings are diagrammatic only and do not show special conduit routing or lengths required for a complete installation. Routing of raceways shall be at the option of the contractor but shall be in strict compliance with structural requirements and specifications, unless otherwise noted and shall be coordinated with other trades. Do not scale the electrical drawings for locations of any electrical architectural, structural, civil, or mechanical items or features. Refer to architectural and structural dimensional drawings.

29. The equipment grounding conductor runs shall be installed and run continuous from panel to last outlets. This wire shall be pigtailed in each outlet for connection to box and device so that if device is removed, ground will not be interrupted. All equipment grounding conductors shall be insulated green or bare conductors. Alternate methods of identification shall be used.

30. For small ac motors not having built-in thermal overload protection, provide manual motor starters with overload heater elements sized to the nameplate current rating of the motor. Small ac motors with built-in thermal overload protection, provide a horse power rated toggle type disconnect switch.

31. Boxes shall be sized for the number and sizes of conductors and conduit entering the box and equipped with plaster extension rings where required.

32. Lamps: all fixtures shall be high efficacy per CEnC 2019 Table 150.0-A

33. Where lighting fixtures require the use of acrylic plastic lenses, they shall be 100 percent virgin acrylic thermoplastic, not less than 0.125" thick with an unpenetrated depth of not less than 0.045" equal to ksh-k12, unless otherwise noted.

34. Provide sound insulation at all conduit penetrations at sound barrier rated walls. Typical unless otherwise

35. Where outlets occur at tackable wall panels or other wall finishes, provide extension rings as required so that no space will exist between device plate and backbox, per NEC 370.20, typical. See architectural elevations for wall finishes and locations.

36. All conductors for branch circuits shall be THHN/THWN copper AWG or KCML per NEC table 310.16. Grounding shall be "Green wire" or bare copper wire sizes per NEC table 250.122.

37. Grounding System:

The grounding system shall be derived per NEC 250.50:

A) 10' of meter underground water pipe

B) Meter frame of building or structure where effectively grounded C) An electrode encased by at least 2" of concrete located within or near the bottom of a concrete foundation that is in direct contact with the earth. 20' zinc galvanized or other electrically conductive steel reinforcing bar or rod of not less than 1/2" in diameter or bare copper conductor not smaller than #4AWG.

38. Listed or labeled equipment shall be installed and used in accordance with any instructions included in the listing or labeling. Section 110.3(b)

39. Contractor must verify locations of all equipment and points of connection and coordinate with construction manager, architect, civil engineer, landscape architect, and utility consultants prior to start of construction. No compensation will be made for relocation of equipment and associated cost.

40. This document is not for bid or construction until the plan has been reviewed and approved by all authorities having jurisdiction and the permit is obtained. No compensation will be made for additional work due to the violation of this requirement.


ELECTRICAL SHEET INDEX

DESCRIPTION E-1.0 ELECTRICAL GENERAL NOTES, SYMBOLS, & SHEET INDEX ELECTRICAL SINGLE LINE DIAGRAM, LOAD CALCULATION, & PANEL 2 | E-I.I

REVISIONS NO. DATE DESCRIPTION







E-1.0

TABLE 1 120/208V 1 PHASE 3 WIRE ALUMINUM ELECTRICAL VOLTAGE DROP OF 2% THREE WIRE + GROUND

	25AMPS 120/208V 1 PHASE 3 WIRE
DISTANCE	COPPER CONDUCTORS INSULATION PER SPECIFICATIONS
<24'	(3#10 + 1#12G) 3/4"C.
<38'	(3#8 + 1#10G) 3/4"C.
<59	(3#6 + 1#8G) 3/4"C.
<94'	(3#4 + 1#6G) 1"C.
<119'	(3#3 + 1#4G) 1-1/4"C.
<150'	(3#2 + 1#4G) 1-1/4"C.
<190'	(3#1 + 1#2G) 1-1/4"C.
<239'	(3#AWG1/0 + 1#1G) 1-1/2"C.
<302'	(3#AWG2/0 + 1#1G) 2"C.

TABLE 2 120/208V 1 PHASE 3 WIRE ALUMINUM ELECTRICAL VOLTAGE DROP OF 2% THREE WIRE + GROUND

125 AMPS 120/208V 1PHASE 3 WIRE

	125 AMPS 120/208V 1PHASE 3 WIRE
DISTANCE	ALUMINUM CONDUCTORS INSULATION PER SPECIFICATIONS
<60'	(3#2/0 + 1#4G) 2"C.
<76'	(3#3/0 + 1#2G) 2"C.
<96'	(3#4/0 + 1#1G) 2"C.
<113'	(3#250KCMIL + 1#1G) 2-1/2"C.
<136'	(3#300KCMIL + 1#1/0G) 2-1/2"C.
<159'	(3#350KCMIL + 1#2/0G) 3"C.
<181'	(3#400KCMIL + 1#2/0G) 3"C.
<226'	(3#500KCMIL + 1#3/0G) 3"C.
<272'	2[(3#300KCMIL + 1#4/0G) 2-1/2"C.]

TABLE 3 120/208V 1 PHASE 3 WIRE ALUMINUM ELECTRICAL VOLTAGE DROP OF 2%

THREE WIRE + GROUND

	225 AMPS 120/208V 1PHASE 3 WIRE
DISTANCE	ALUMINUM CONDUCTORS INSULATION PER SPECIFICATIONS
<75'	(3#300KCMIL + 1#2G) 2-1/2"C.
<88'	(3#350KCMIL + 1#1G) 3"C.
<101'	(3#400KCMIL + 1#1/0G) 3"C.
<126'	(3#500KCMIL + 1#2/0G) 3"C.
<151'	2[(3#300KCMIL + 1#2/0G) 2-1/2"C.]
<176'	2[(3#350KCMIL + 1#3/0G) 3"C.]
<202'	2[(3#400KCMIL + 1#4/0G) 3"C.]
<252'	2[(3#500KCMIL + 1#250KCMIL G) 3"C.]

SINGLE-LINE DIAGRAM GENERAL NOTES

a) NOT USED.

- b) ALL NEW CIRCUIT BREAKERS, FUSIBLE SWITCHES IN MAINSWITCHBOARD OR PANEL BOARDS SHALL BE SERIES RATED TO MATCH EXISTING AIC RATING OR APPROVED EQUAL OR 65KAIC, UNLESS NOTED OTHERWISE.
- c) MOTOR CIRCUIT PROTECTORS SHALL NOT BE A PART OF A SERIES
- COMBINATION INTERRUPTING RATING.

 d) SERIES COMBINATION AIC RATING SHALL NOT BE USED WHEN THE SECONDARY EQUIPMENT IN THE SERIES IS SUBJECTED TO A TOTAL CONNECTED FULL LOAD MOTOR CURRENT OF MORE THAN 1% OF ITS AIC RATING.
- e) EQUIPMENT ENCLOSURES SHALL BE CLEARLY MARKED "CAUTION-SERIES RATED SYSTEM __KAMPS AVAILABLE, IDENTIFIED REPLACEMENT COMPONENTS REQUIRED", IN COMPLIANCE WITH 2019 CEC (2017 NEC) SECTION 110-22. END USE EQUIPMENT SHALL ALSO BE MARKED WITH THE HIGHER SERIES COMBINATION INTERRUPTING RATING AS PER 2019 CEC SECTION 240-83(C). NO EXCEPTION.
- f) FUSES SHALL BE PROVIDED WITH REJECTION TYPE FUSE HOLDERS.
- g) ELECTRICAL EQUIPMENT SHALL BE LISTED BY THE CITY, WHERE THE PROJECT IS LOCATED, RECOGNIZED ELECTRICAL TESTING LABORATORY OR APPROVED BY THE DEPARTMENT
- h) NO PIPING, DUCTS OR EQUIPMENT FOREIGN TO ELECTRICAL EQUIPMENT SHALL BE PERMITTED TO BE LOCATED WITHIN THE DEDICATED SPACE ABOVE THE ELECTRICAL EQUIPMENT.

SINGLE-LINE DIAGRAM KEYED NOTES


- THE EQUIPMENT SHOWN IS EXISTING UNDER A PREVIOUS APPROVED CONSTRUCTION PERMIT, NOT A PART OF THIS SUBMITTAL, UNLESS NOTED AS NEW.
- VERIFY WITH SERVICE PLANNER FOR AIC RATING AND ELECTRICAL INFORMATION BEFORE ISSUING ANY BID. NOTIFY ENGINEER IMMEDIATELY IF ANY MAJOR
- DISCREPANCIES OCCUR.

 (3) VERIFY DISTANCES IN FIELD.

	LOAD SUMMARY (MSA)											
1.	EXISTING	370KVA*										
2.	NEW ADU'S @25A X 18	92.5 KVA										
	SUBTOTAL	462.5 KVA										
	POWER FACTOR(80%)	SUBTOTAL×1.2 = 555 KVA										
AMF	PERAGE @120/208V 3 PHASE 4 WIRE	1541 AMPS										
SE	RVICE @120/208V 3 PHASE 4 WIRE	1600 AMPS										
	*BASED ON AN AS-BUILT DRAWING. CONTRACTOR TO DO A LOAD TEST BEFORE ISSUING BID.											

LOAD SUMMARY (DB-600)											
l.	EXISTING	125KVA*									
2.	NEW ADU'S @25A X IO	51.4 KVA									
	SUBTOTAL	176.4 KVA									
	POWER FACTOR(80%)	SUBTOTAL×1.2 = 211.7 KVA									
AMF	PERAGE @120/208V 3 PHASE 4 WIRE	588 AMPS									
SE	RVICE @120/208V 3 PHASE 4 WIRE	600 AMPS									
*	*BASED ON AN AS-BUILT DRAWING. CONTRACTOR TO DO A LOAD TEST BEFORE ISSUING BID.										

PANEL 'PA1'	LOCATI MAIN (L.O.			BUS	S RAT	TING	1	25 A		120/240V 1 2 3 W MOUNTING: REC			
DESCRIPTION	VOLT	TAMPS ZB	L T G	R E C	M I S	CVT	BKR	Вl Па	JS ØB	BKR	CKT NO	M I S	R E C	L T G	VOLT Øa	AMPS ØB	DESCRIPTION
GENERAL LTG 1	500				Ť		15-1	<u> </u>	Ŧ	20-1	2	Ť	Ť	Ť	5 0 0		KITCHEN 1
GENERAL LTG 2		500				3	15-1	+	-	20-1	4					5 0 0	KITCHEN 2
HEAT	900					5	15/	•	\bot	20-1	6				800		MICROWAVE
		900				7	/2	+	-	20-1	8					360	OFFICE PLUGS
OFFICE HEAT	180					9	20-1	•	\bot	25/	10				2880		SUBPANEL 'PA4'
SUBPANEL 'PA2'		2880					25/	+	—	/2	12					2260	
	2260					13	/2	-		25/	14				2880		SUBPANEL 'PA5'
SUBPANEL 'PA3'		2880					25/	+	-	/2	16					2260	
	2260					17	/2	•	+		18				0		SPACE
SPACE		0				19		+	—		20				·	0	SPACE
SPACE	0					21		—	+		22				0		SPACE
SPACE		0				23		\perp	-		24					0	SPACE
SUB-TOTAL		ØA=					•			12540							
TOTAL CONNECTED VA	= 2	25700	┧┟╵	TON	ES:	(1)	REFE	R TC	MEC	CHAN	IICAL	. DF	RAW	ING	S FOR I	DETAIL	ED EQUIPMENT
LCL @ 125 %	= (0	JL				INFO	RMA	ΓΙΟΝ	BEF	ORE	BID	ANI	D R	DUGH II	٧.	
TOTAL OTHER LOAD	= (0	IJĹ			2	REFE	R TC	SIN	GLE I	LINE	FO	R AI	C R	ATING.		
PANEL LOAD	= 2	25.7KVA	<u> </u>														
FEEDER AMPS	= ^	110A	Ш														
YPICAL FOR ALL UN	ITS																
		LOCAT			D				BLIC	S RAT	LINIC	1	00 A	\	120/240V 1 🛭 3 W		
PANEL 'PA2'			A B 4 F	٥١	25	iΑ			ВОС	ואונ	IIVG			MOUNTING: REC			
PANEL 'PA2'		MAIN (AIVII			"`								- 1 1	VOLT		
	VOLT	MAIN (L	Ŕ	M	CVT		Bl			СКТ	M	R F	ŤΙ	VOLI	AMPS	
PANEL 'PA2' DESCRIPTION	VOLT ØA	· `	L T G			CVT	BKR	Bl ∄ A		BKR	CKT NO	M I S	E C	T G	ØA.	AMPS ØB	DESCRIPTION
		TAMPS	L T	R	M I	CVT	BKR 15-1			BKR 20-1		- 1	E				
DESCRIPTION	ØΑ	TAMPS	L T	R	M I	CKT NO					NO	- 1	E		ØA		DESCRIPTION
DESCRIPTION GENERAL LTG 1	ØΑ	AMPS ØB	L T	R	M I	CKT NO 1	15-1			20-1	NO 2	- 1	E		ØA	Øв	DESCRIPTION KITCHEN 1
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2	ØA 500	AMPS ØB	L T	R	M I	CKT NO 1	15-1 15-1			20-1	NO 2 4	- 1	E		ØA 500	Øв	DESCRIPTION KITCHEN 1 KITCHEN 2
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2 HEAT	ØA 500	AMPS ØB 500	L T	R	M I	CKT NO 1 3 5 7	15-1 15-1 15			20-1 20-1 20-1	NO 2 4 6	- 1	E		ØA 500	ØB 500	DESCRIPTION KITCHEN 1 KITCHEN 2 MICROWAVE
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2 HEAT	ØA 500 900	AMPS ØB 500	L T	R	M I	CKT NO 1 3 5 7	15-1 15-1 15/ 2			20-1 20-1 20-1	NO 2 4 6 8	- 1	E		ØA 500 800	ØB 500	DESCRIPTION KITCHEN 1 KITCHEN 2 MICROWAVE OFFICE PLUGS
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2 HEAT OFFICE HEAT	ØA 500 900	500 900	L T G	R E C	M I	CKT NO 1 3 5 7	15-1 15-1 15/ 2	ØA →		20-1 20-1 20-1 15-1	NO 2 4 6 8 10	- s	E		ØA 500 800	ØB 500 360	DESCRIPTION KITCHEN 1 KITCHEN 2 MICROWAVE OFFICE PLUGS SPACE
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2 HEAT OFFICE HEAT SPACE	ØA 500 900 180	500 900	2880	R E C	M I S	CKT NO 1 3 5 7 9	15-1 15-1 15/ 2 20-1	ØA •	ØB → → ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓ ✓	20-1 20-1 20-1 15-1 2260	NO 2 4 6 8 10 12 V/	S	E C	G	ØA 500 800 0	ØB 500 360	DESCRIPTION KITCHEN 1 KITCHEN 2 MICROWAVE OFFICE PLUGS SPACE
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2 HEAT OFFICE HEAT SPACE SUB-TOTAL	ØA 500 900 180	FAMPS	2880	R E C	M I S	CKT NO 1 3 5 7 9 11	15-1 15-1 15/ 2 20-1	ØA	ZB = 2 D ME(20-1 20-1 20-1 15-1 2260	NO 2 4 6 8 10 12 V/	S S	E C	G	ØA 500 800 0	ØB 500 360 0	DESCRIPTION KITCHEN 1 KITCHEN 2 MICROWAVE OFFICE PLUGS SPACE SPACE
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2 HEAT OFFICE HEAT SPACE SUB-TOTAL TOTAL CONNECTED VA	ØA 500 900 180	MPS	2880	R E C	M I S	CKT NO 1 3 5 7 9 11	15-1 15-1 15/ 2 20-1 REFE	ØA FR TC MATI	ØB ØB= 2 Ø MECON B	20-1 20-1 15-1 15-1 2260 CHAN	10 12 V/	S A	E C	ING	ØA 500 800 0	ØB 500 360 0	DESCRIPTION KITCHEN 1 KITCHEN 2 MICROWAVE OFFICE PLUGS SPACE SPACE
DESCRIPTION GENERAL LTG 1 GENERAL LTG 2 HEAT OFFICE HEAT SPACE SUB-TOTAL TOTAL CONNECTED VA LCL @ 125 %	ØA 500 900 180 = 8 = 0	MPS	2880	R E C	M I S	CKT NO 1 3 5 7 9 11	15-1 15-1 15/ 2 20-1 REFE	ØA FR TC MATI	ØB ØB= 2 Ø MECON B	20-1 20-1 15-1 15-1 2260 CHAN	10 12 V/	S A	E C	ING	ØA 500 800 0 S FOR I	ØB 500 360 0	DESCRIPTION KITCHEN 1 KITCHEN 2 MICROWAVE OFFICE PLUGS SPACE SPACE

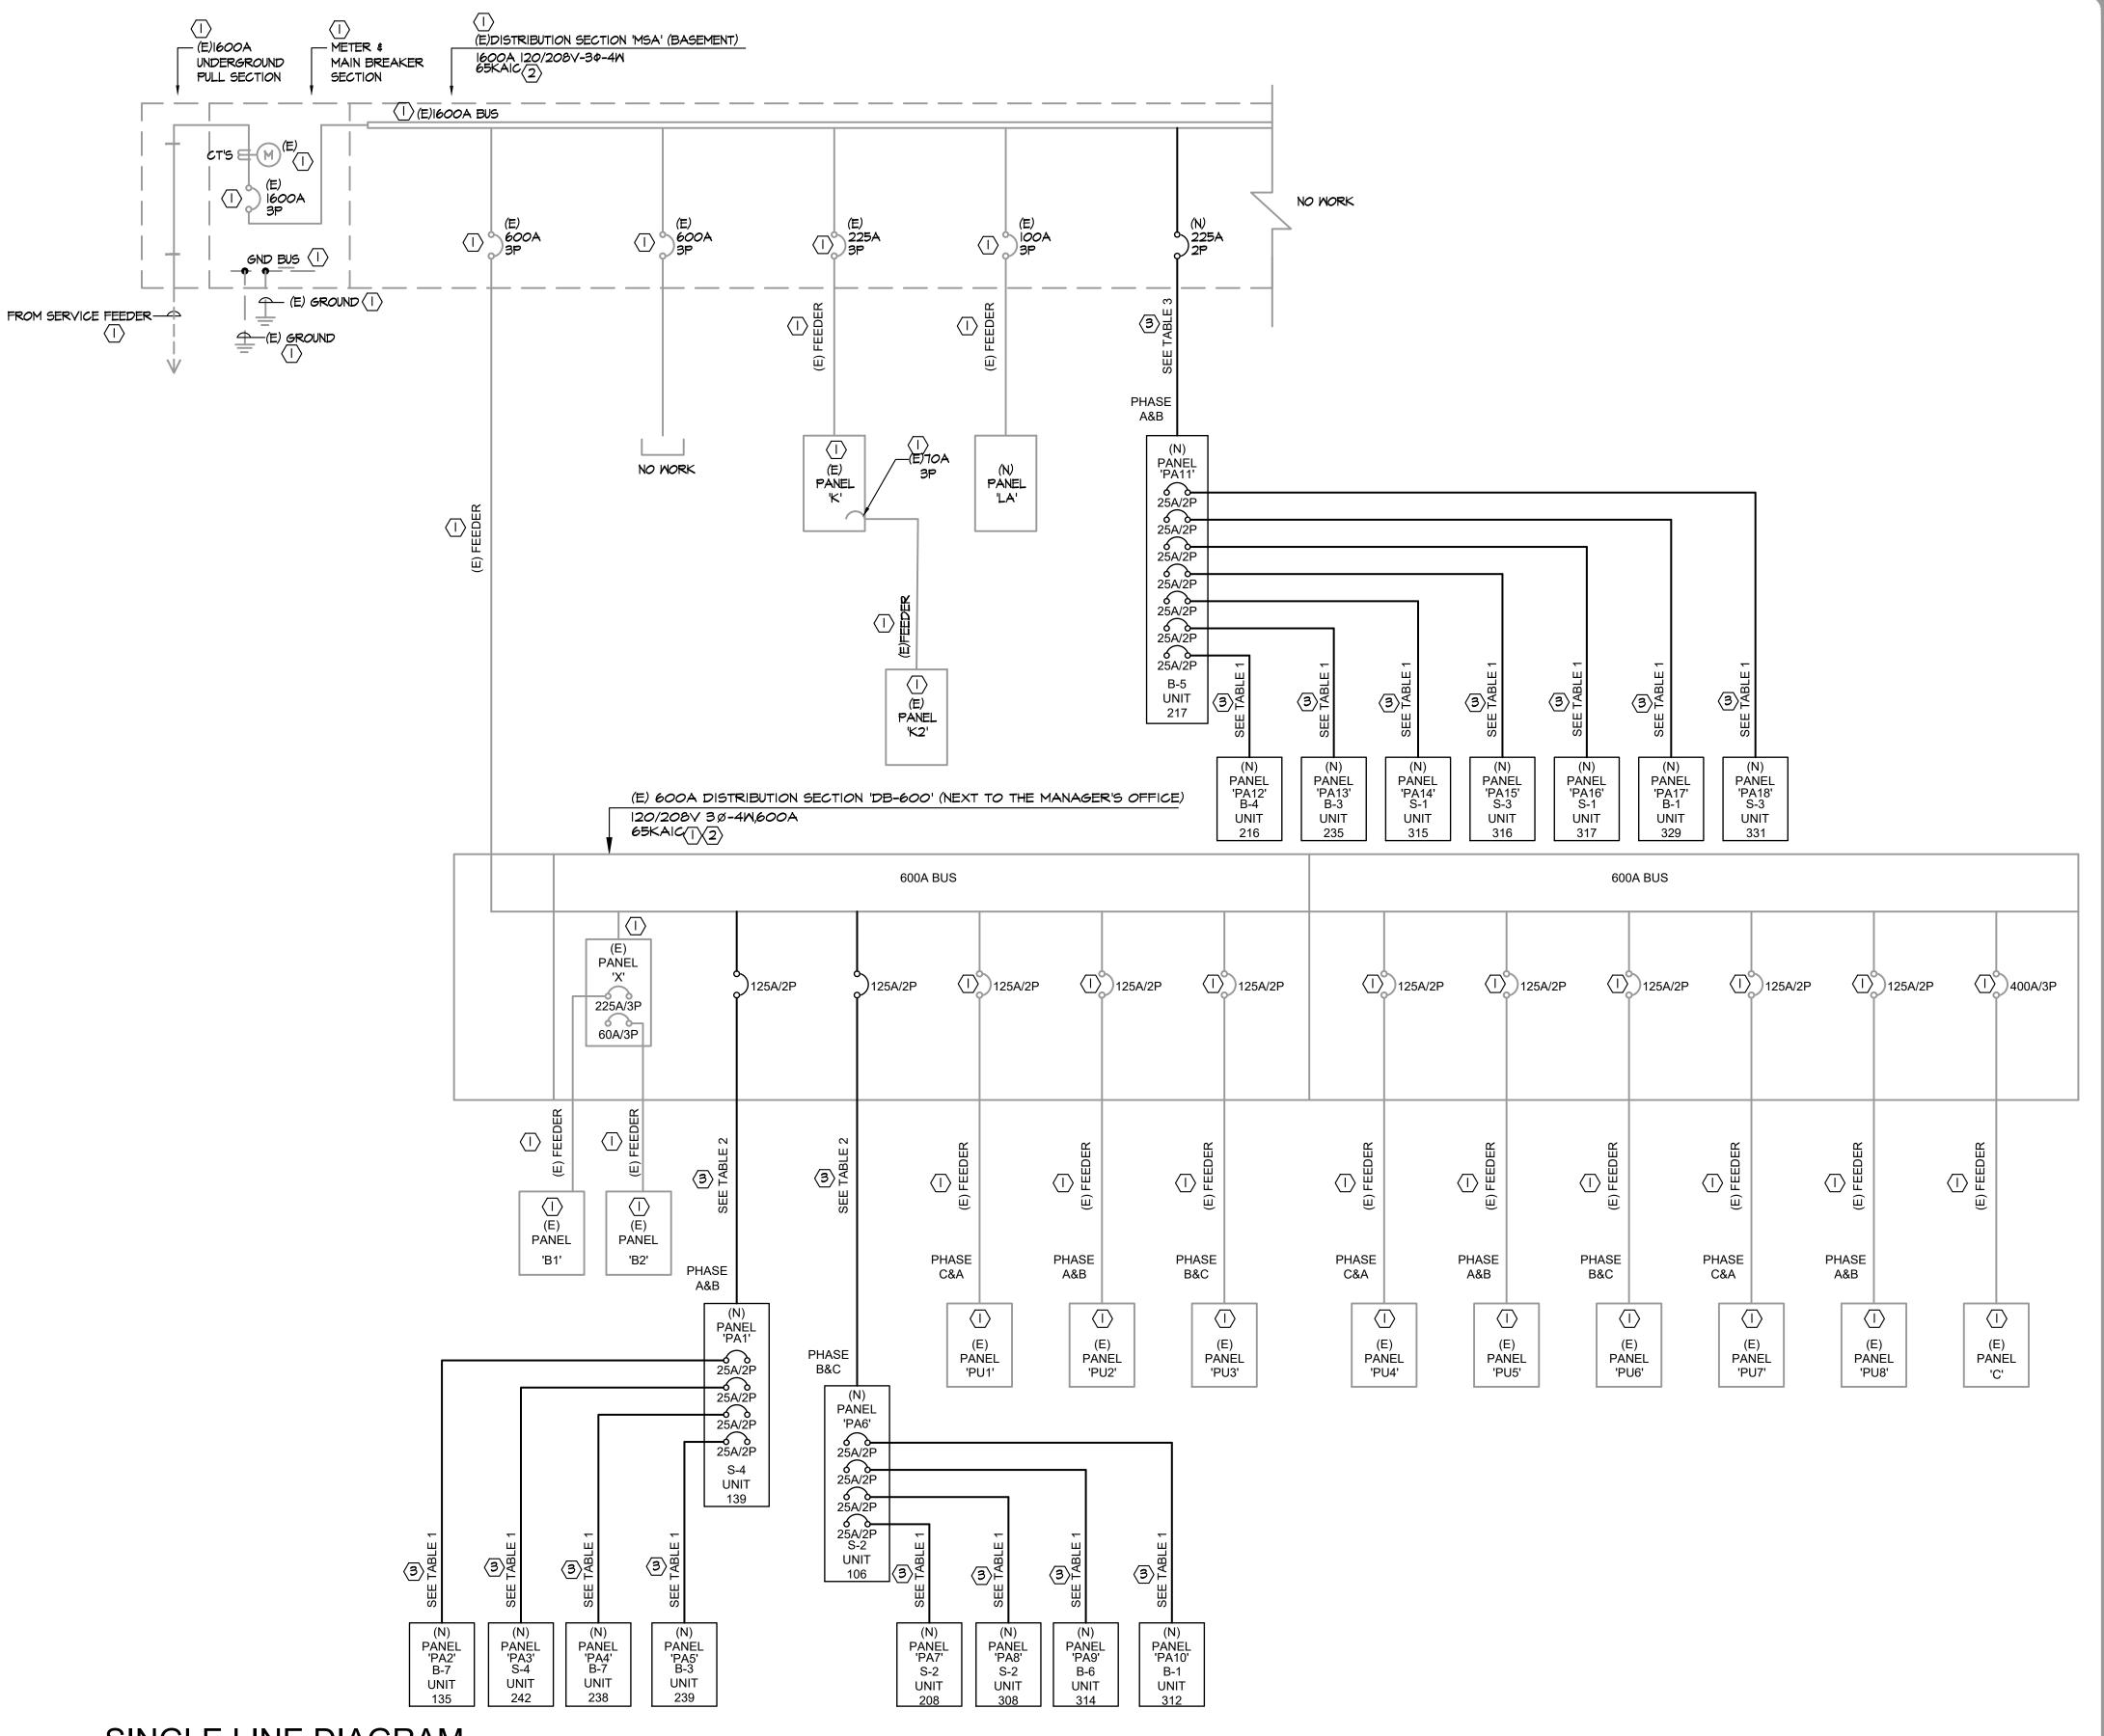


SINGLE LINE DIAGRAM

SCALE: NONE

PANEL 'PA6' LOCATION MAIN (A												ΓING	1	125 /	٩MF	'S	120/240V 1 2 3 W MOUNTING: REC	
DESCRIPTION	VOLT Øa	AMPS ØB	L T G	R E C	M I S	CKT	BKR		BUS	ľВ	BKR	CKT NO	M I S	R E C	L T G	VOLT Øa	AMPS ØB	DESCRIPTION
GENERAL LTG 1	5 0 0					1	15-1	-		_	20-1	2				500		KITCHEN 1
GENERAL LTG 2		5 0 0				3	15-1	+	-	-	20-1	4					5 0 0	KITCHEN 2
HEAT	9 0 0					5	15/	-		_	20-1	6				800		MICROWAVE
		9 0 0				7	/2	+	•	-	20-1	8					360	OFFICE PLUGS
OFFICE HEAT	180					9	20-1	-		_	25/	10				2880		SUBPANEL 'PA12'
SUBPANEL 'PA7'		2880				11	25/	+	-	-	/2	12					2260	
	2260					13	/2	-		_	25/	14				2880		SUBPANEL 'PA13'
SUBPANEL 'PA8'		2880				15	25/	+	 ∳	-	/2	16					2260	
	2260					17	/2	-		_		18				0		SPACE
SPACE		0				19		+	•	-		20					0	SPACE
SPACE	0					21		-		-		22				0		SPACE
SPACE		0				23			-	-		24					0	SPACE
SUB-TOTAL		Ø A=	131	60	VA				Øв	3= 1	2540) V	Α					
TOTAL CONNECTED VA	= :	25700		TON	ES:		REFE	ER 1	ΓΟ Μ	1E(CHAN	IICAL	L DF	RAW	'ING	S FOR	DETAILI	ED EQUIPMENT
LCL @ 125 %	= (0	JE				INFO	RM	ATIC	NC	BEF	ORE	BID	AN	D R	OUGH II	N.	
TOTAL OTHER LOAD	= (0	JĹ			2	REFE	ER I	ro s	IN	GLE I	LINE	FO	R Al	C R	ATING.		
PANEL LOAD	= :	25.7KVA	J [
FEEDER AMPS	=	110A	JĹ															

PANEL 'PA11'	LOCATI MAIN (TB		L.O.			ВЦ	IS RA	TING	2	225 /	AMP	S	120/240V 1 🛭 3 W MOUNTING: REC		
I VOLT		AMPS	L	R	M	.L.O.		BI		1		М	R	L	VOLT	AMPS	TING. REC
DESCRIPTION	ZA	ДВ	T G	E C	I S	CKT NO	BKR			BKF	CKT NO	l S	E C	T G	ØA.	ДВ	DESCRIPTION
GENERAL LTG 1	5 0 0					1	15-1	•		20-	2				5 0 0		KITCHEN 1
GENERAL LTG 2		5 0 0				3	15-1	+	•	20-1	4					5 0 0	KITCHEN 2
HEAT	900					5	15/	-		20-1	6				800		MICROWAVE
		9 0 0				7	/2	l -	•	20-1	8					360	OFFICE PLUGS
SUBPANEL 'PA12'	2880					9	25/	🔶			10				0		SUBPANEL 'PA12'
		2260				11	/2	l - 	•	25/	12					2880	SPACE
SUBPANEL 'PA13'	2880					13	25/	🔶		/2	14				2260		
		2260				15	/2	l 	-	25/	16					2880	SUBPANEL 'PA13'
SUBPANEL 'PA14'	2880					17	25/	│ - ♦-		/2	18				2260		
		2260				19	/2	l -	-	25/	20					2880	SUBPANEL 'PA14'
SUBPANEL 'PA15'	2880					21	25/	│ - ♦-		/2	22				2260		
		2260				23	/2		<u> </u>	20-1	24					180	OFFICE HEAT
SUB-TOTAL		ØA=2	2100	00	VA				Øв=	2012	0 V	Α					
TOTAL CONNECTED VA	= 4	11120	7 [TON	ES:	(1)1	REF	ER T	ОМЕ	СНА	VICA	L DF	RAW	ING	S FOR I	DETAILI	ED EQUIPMENT
LCL @ 125 %	= ()	1 🗆				NFC	RMA	OITA	N BEF	ORE	BID	AN	D R	DUGH II	V .	
TOTAL OTHER LOAD	= ()	1 🗆			(2)	REF	ER T	O SI	IGLE	LINE	FO	R AI	C R	ATING.		
PANEL LOAD	= 4	11.1KVA															
FEEDER AMPS																	

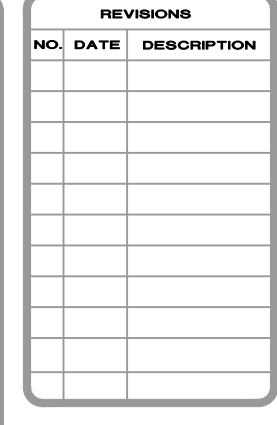





PALO ALTO
COMMONS PHASE 2
4075 EL CAMINO WAY,
PALO ALTO, CA 94306

ELECTRICAL SINGLE LINE DIAGRAM, LOAD CALCULATIONS, & PANEL SCHEDULE

